


Office of Drinking Water Contacts by County



Drinking Water Offices and Staff

Click the county number to view
contact information.

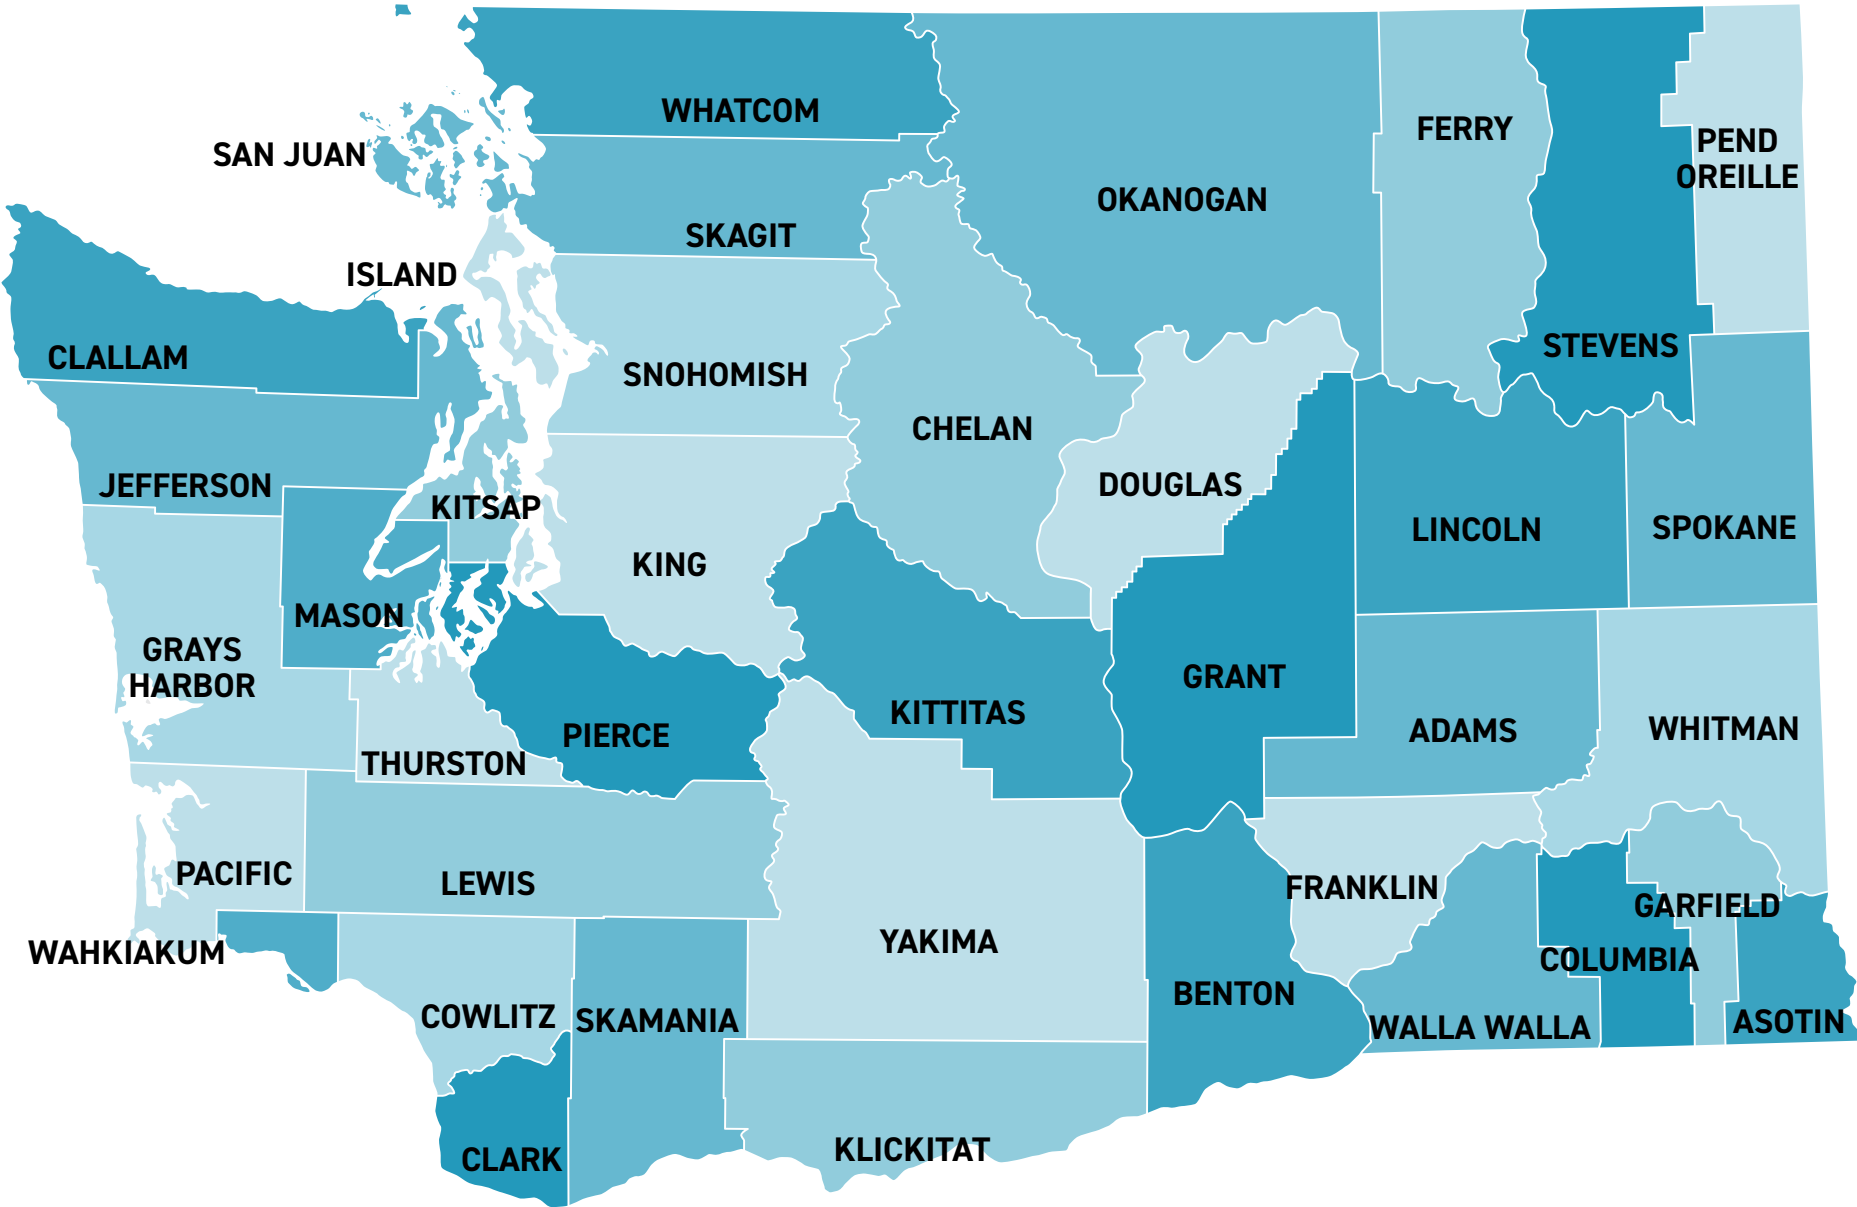


Main Line

Main Phone 360-236-3100 or
Toll Free 800-521-0323
(inside Washington)
FAX: 360-236-2252

TTY: Relay Service 1-800-833-6388

[Office of Drinking Water Website](#)

Office of Drinking Water Contacts by County

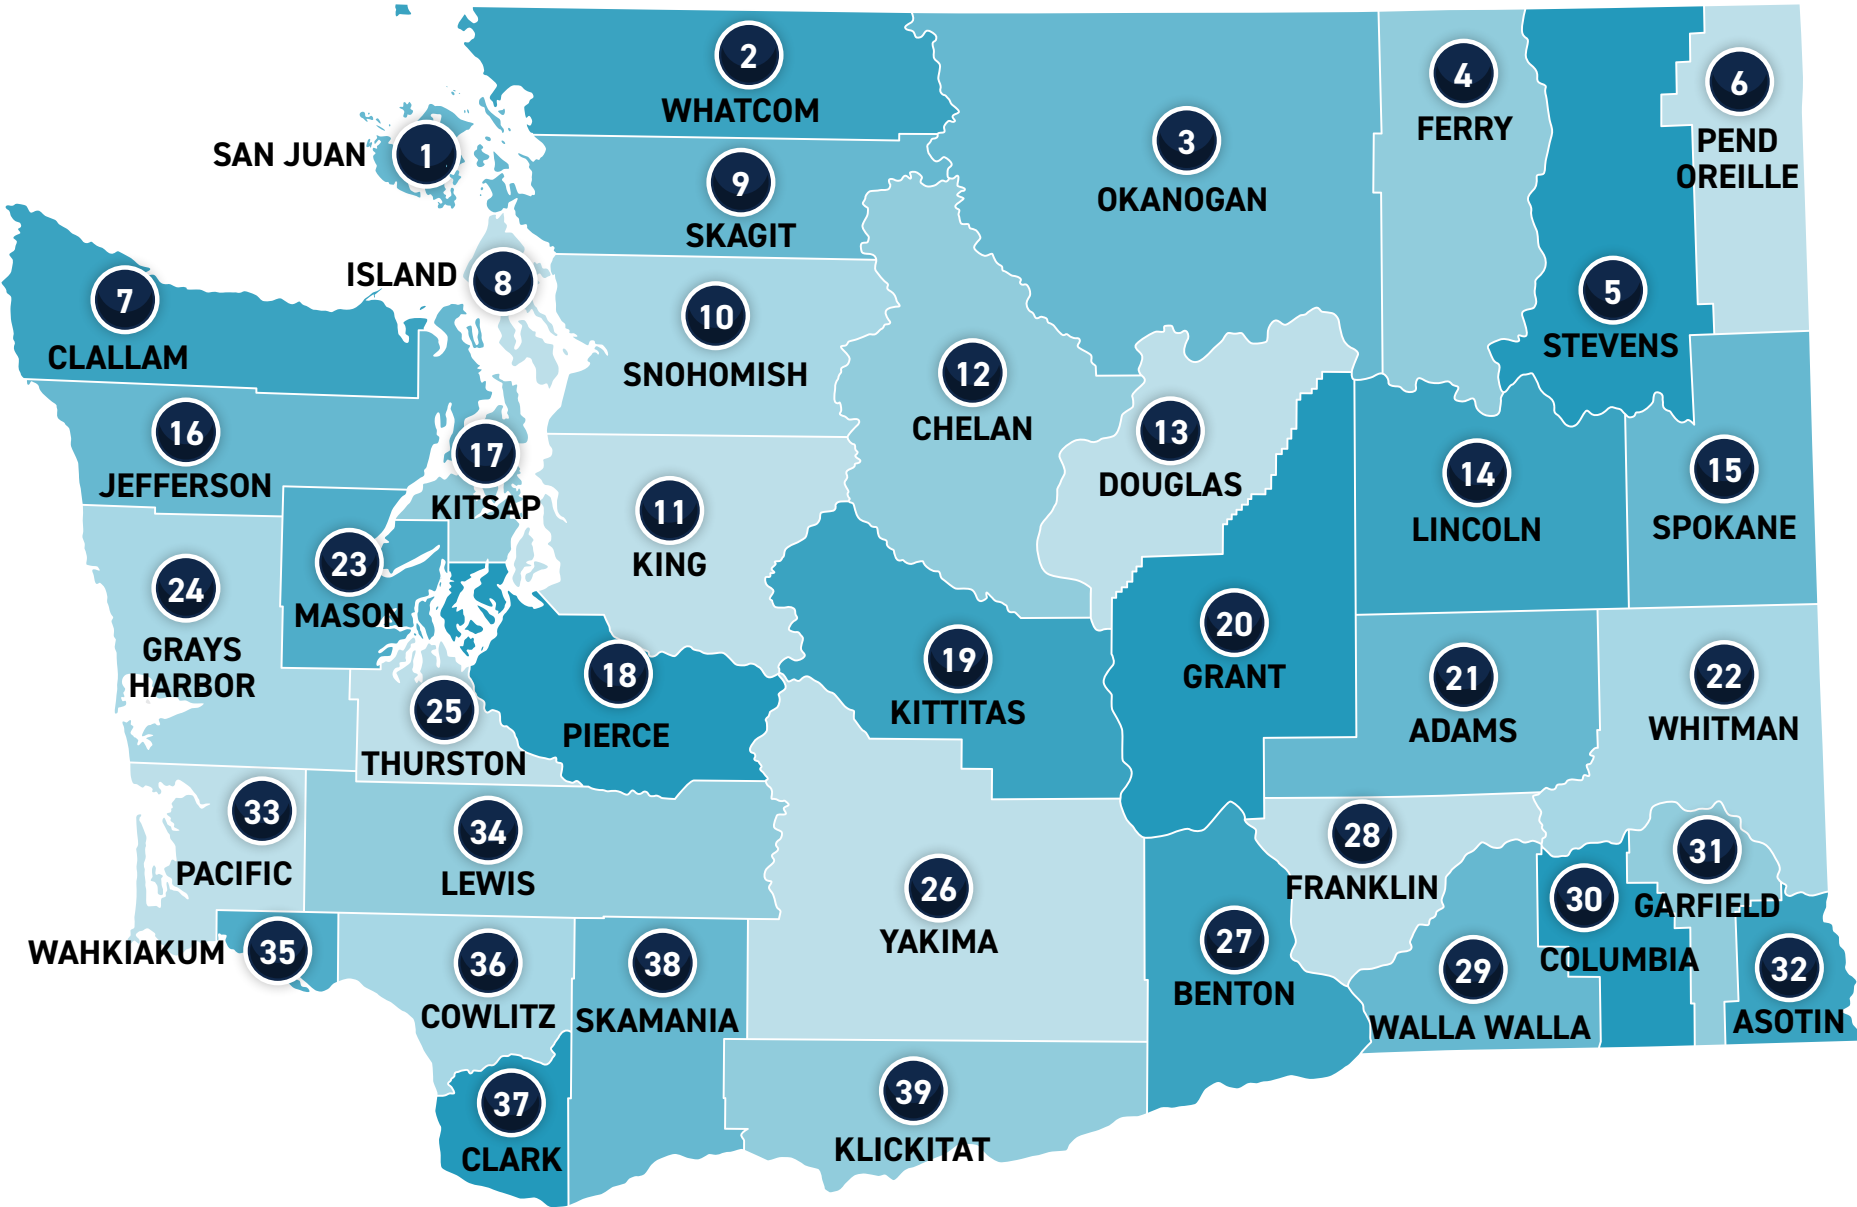

SAN JUAN

Engineer
Raquel Callans, PE
360-800-7482
raquel.callans@doh.wa.gov


Planner
Krista Chavez
564-669-0757
krista.chavez@doh.wa.gov

Source Monitoring Staff
Jeff Roeser
253-395-6775
jeff.roeser@doh.wa.gov

Coliform Staff
Joyful Bell
564-250-5813
joyful.bell@doh.wa.gov

WFI & Disinfection Staff
Mary Rucksdashel
360-742-1672
mary.rucksdashel@doh.wa.gov

Office of Drinking Water Contacts by County

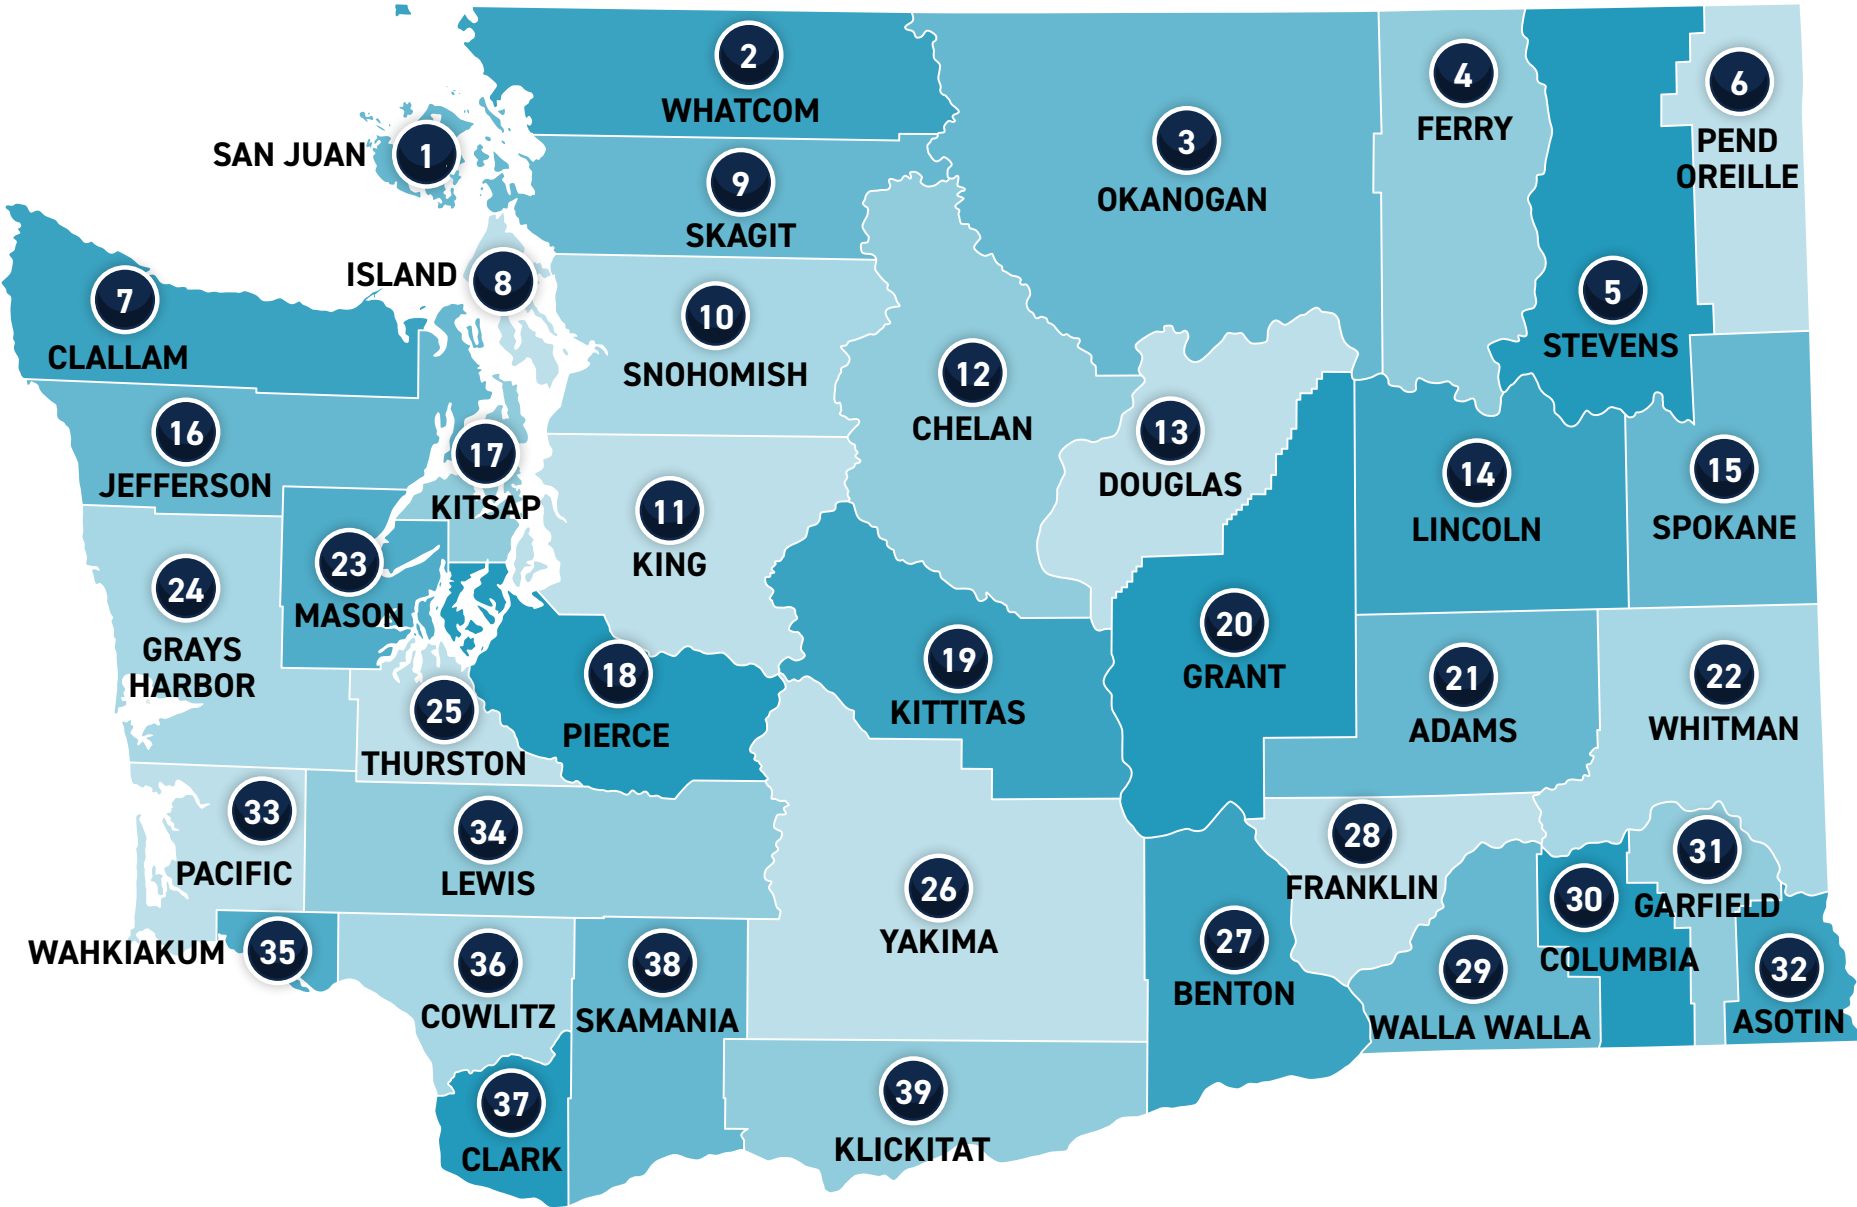

WHATCOM

Engineer
Laura McLaughlin, PE
564-669-0753
laura.mclaughlin@doh.wa.gov


Planner
Krista Chavez
564-669-0757
krista.chavez@doh.wa.gov

Source Monitoring Staff
Jeff Roeser
253-395-6776
jeff.roeser@doh.wa.gov

Coliform Staff
Joyful Bell
564-250-5813
joyful.bell@doh.wa.gov

WFI & Disinfection Staff
Mary Rucksdashel
360-742-1672
mary.rucksdashel@doh.wa.gov

Office of Drinking Water Contacts by County

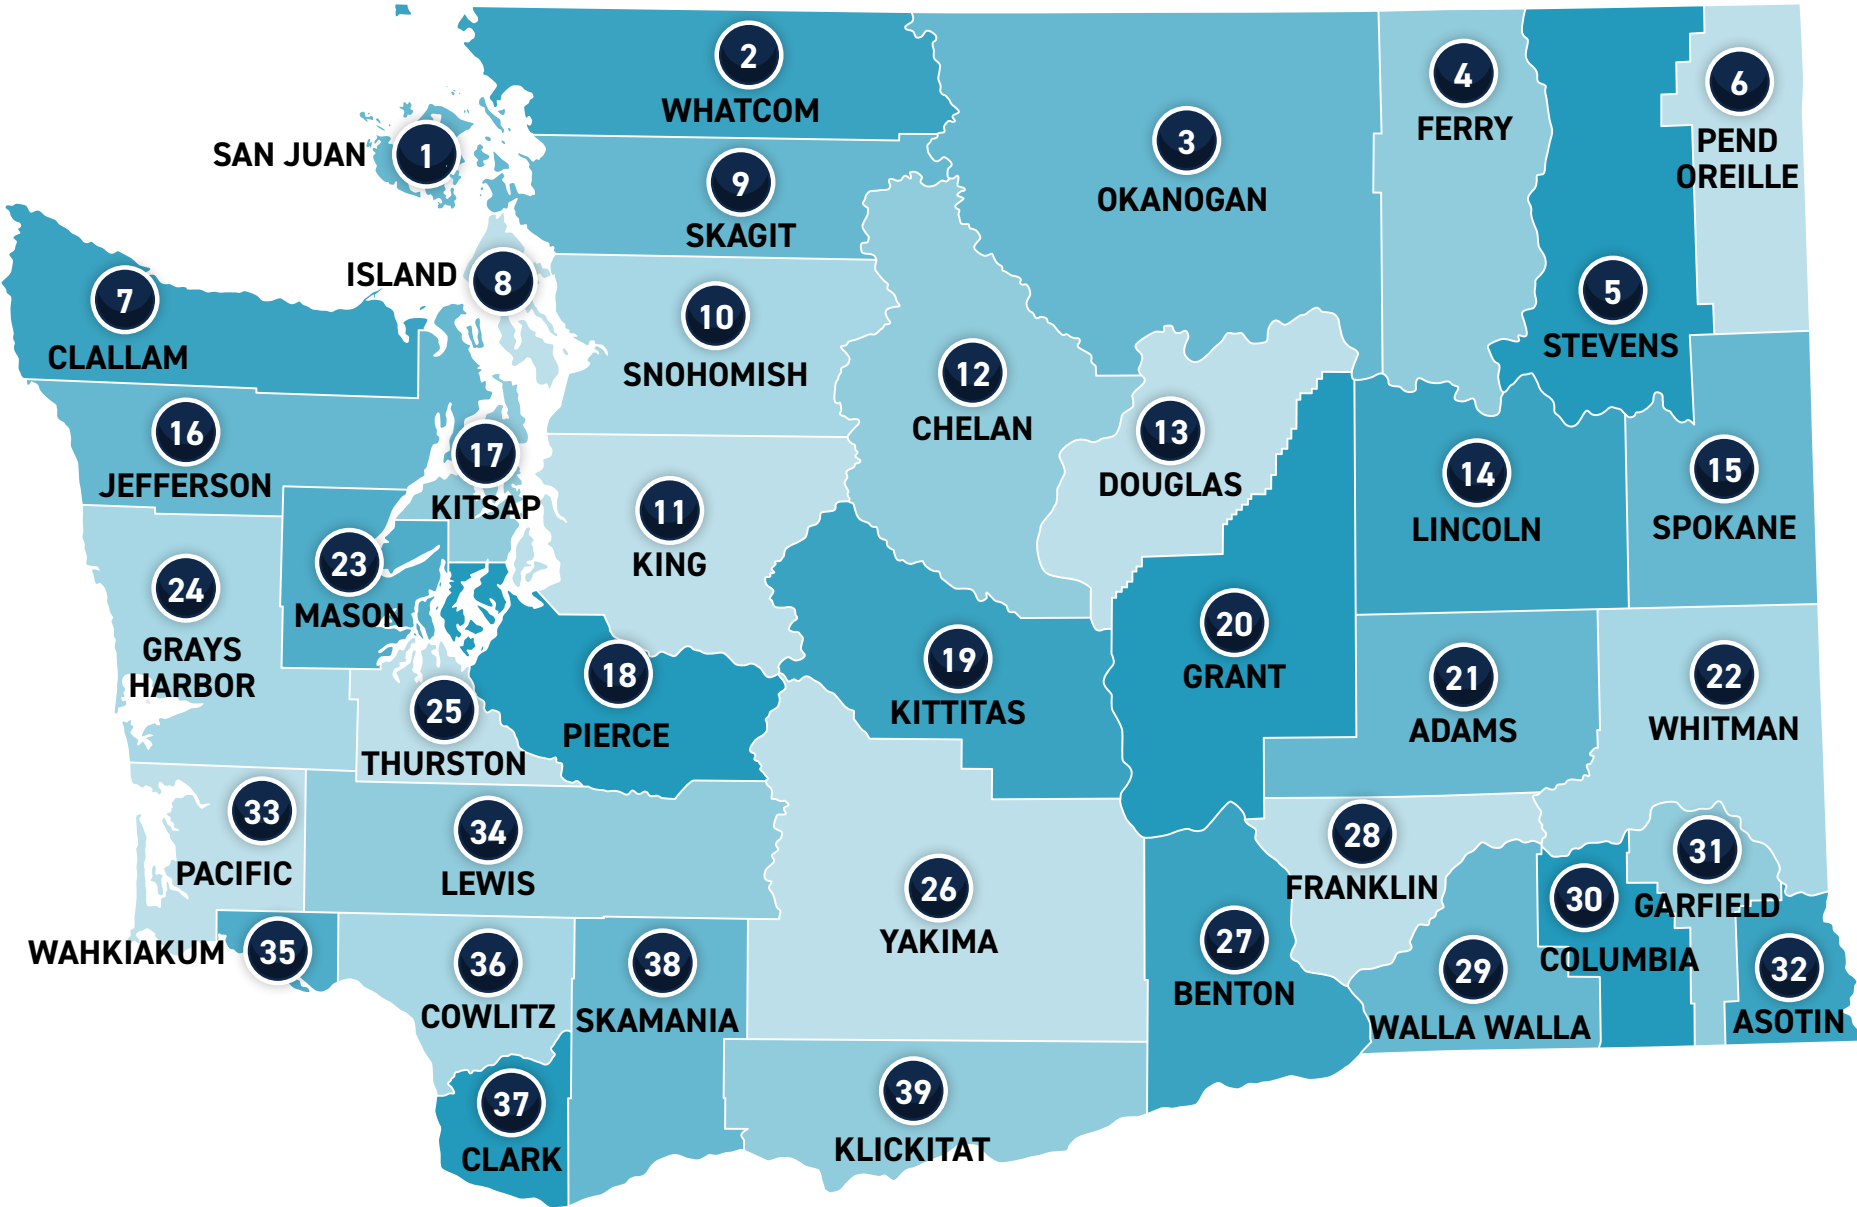

OKANOGAN

Engineer
Sheri Miller, PE
509-407-7160
sheri.miller@doh.wa.gov

Planner
Hollis Staal
564-233-8707
hollis.staal@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

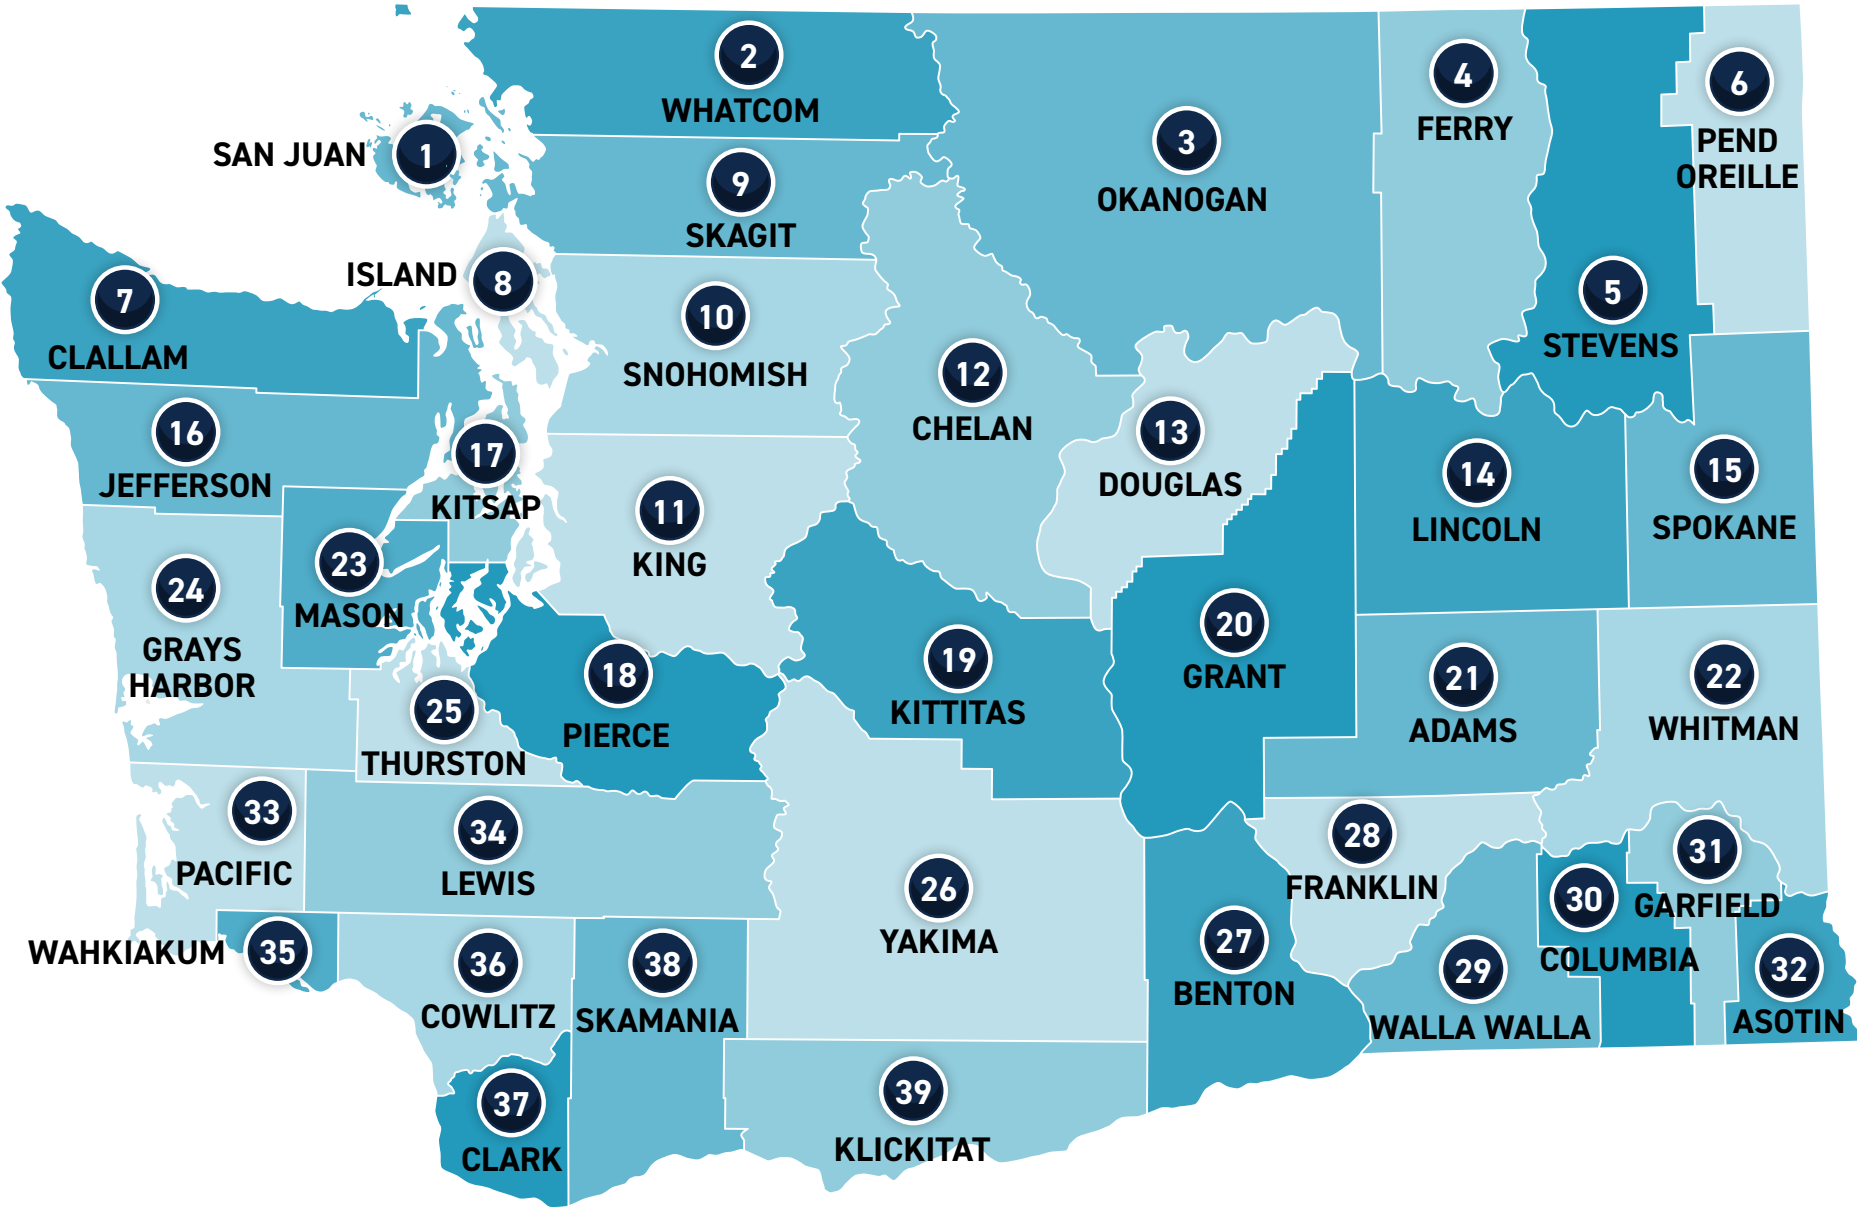

FERRY

Engineer
Nathan Ikehara, PE
564-669-3828
nathan.ikehara@doh.wa.gov

Planner
Hollis Staal
564-233-8707
hollis.staal@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

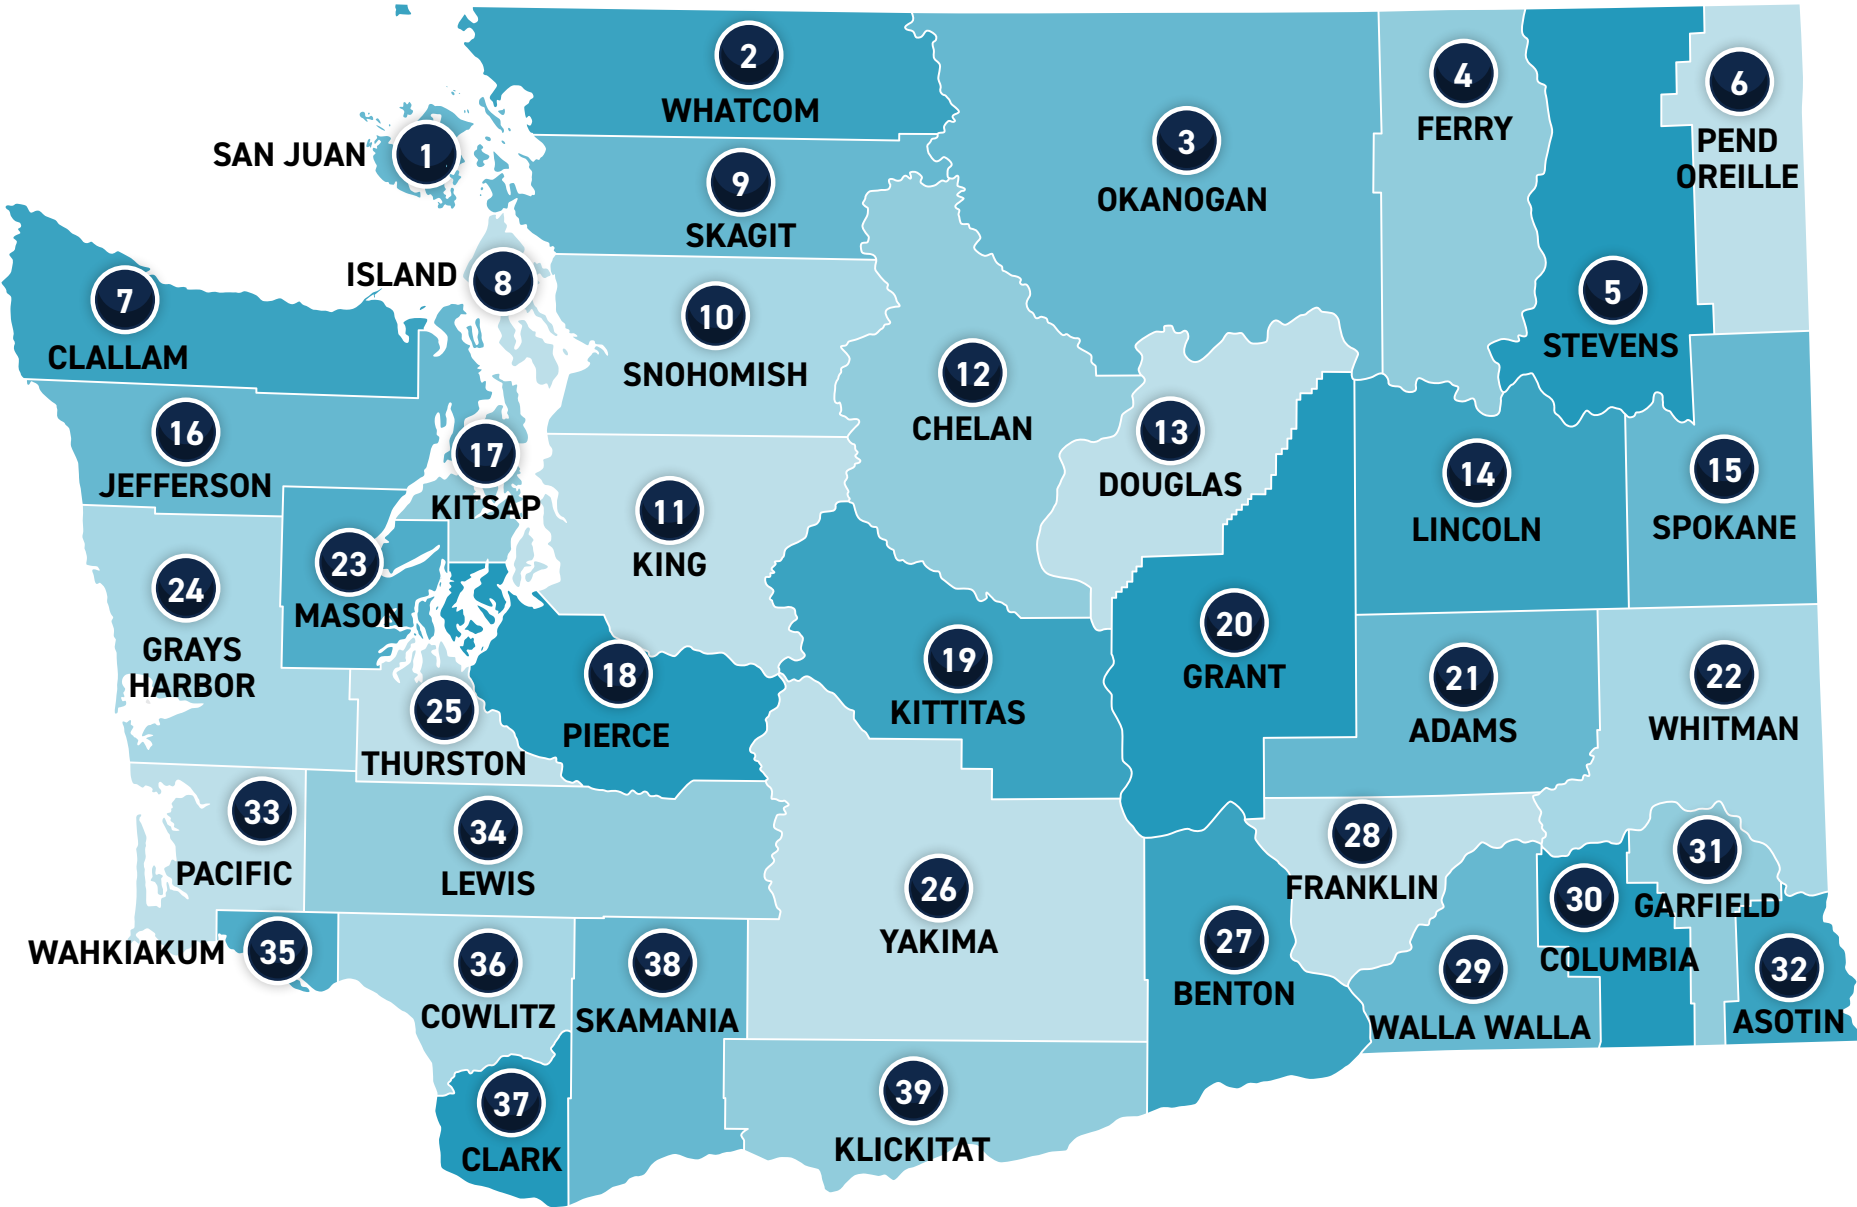

STEVENS

Engineer
Nathan Ikehara, PE
564-669-3828
nathan.ikehara@doh.wa.gov

Planner
Hollis Staal
564-233-8707
hollis.staal@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

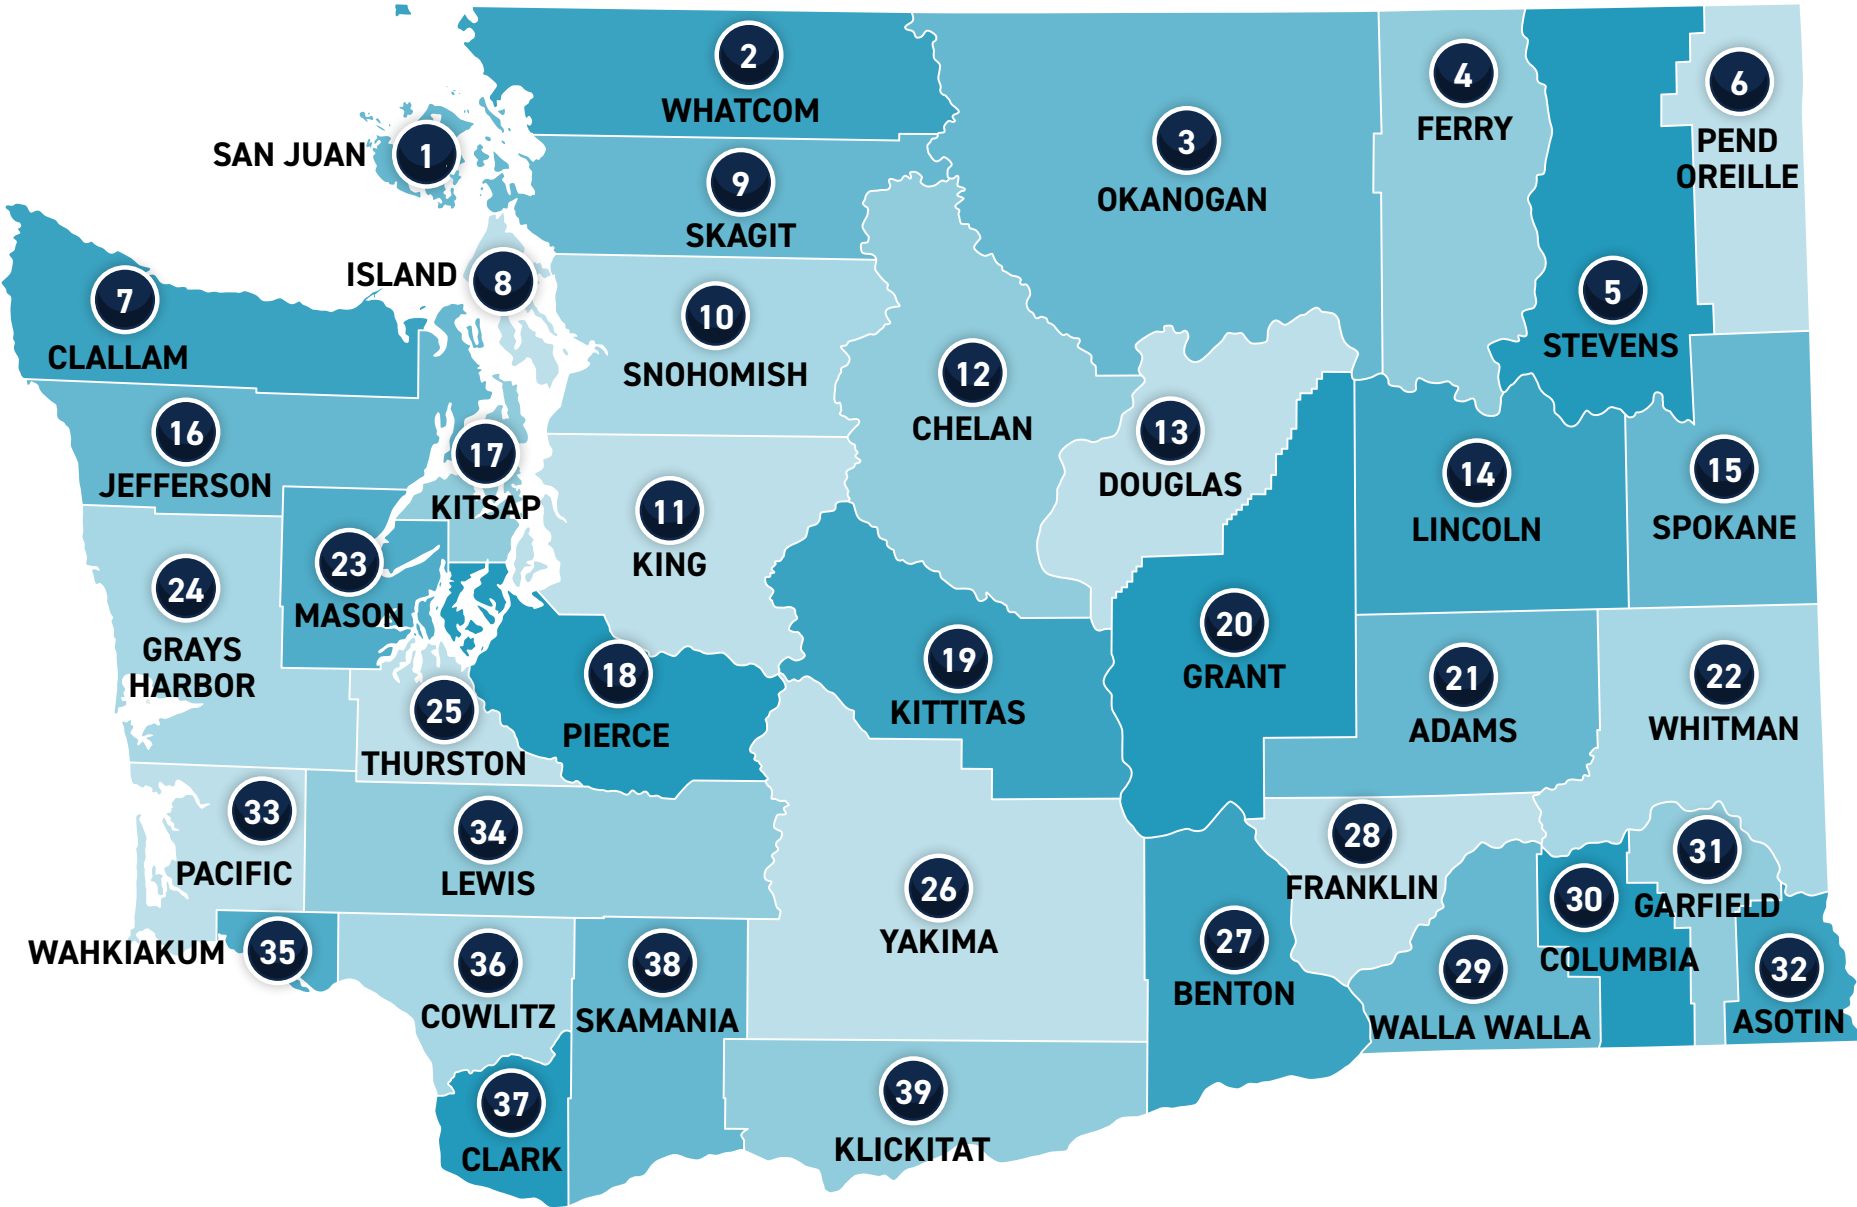

PEND OREILLE

Engineer
Nathan Ikehara, PE
564-669-3828
nathan.ikehara@doh.wa.gov

Planner
Hollis Staal
564-233-8710
hollis.staal@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

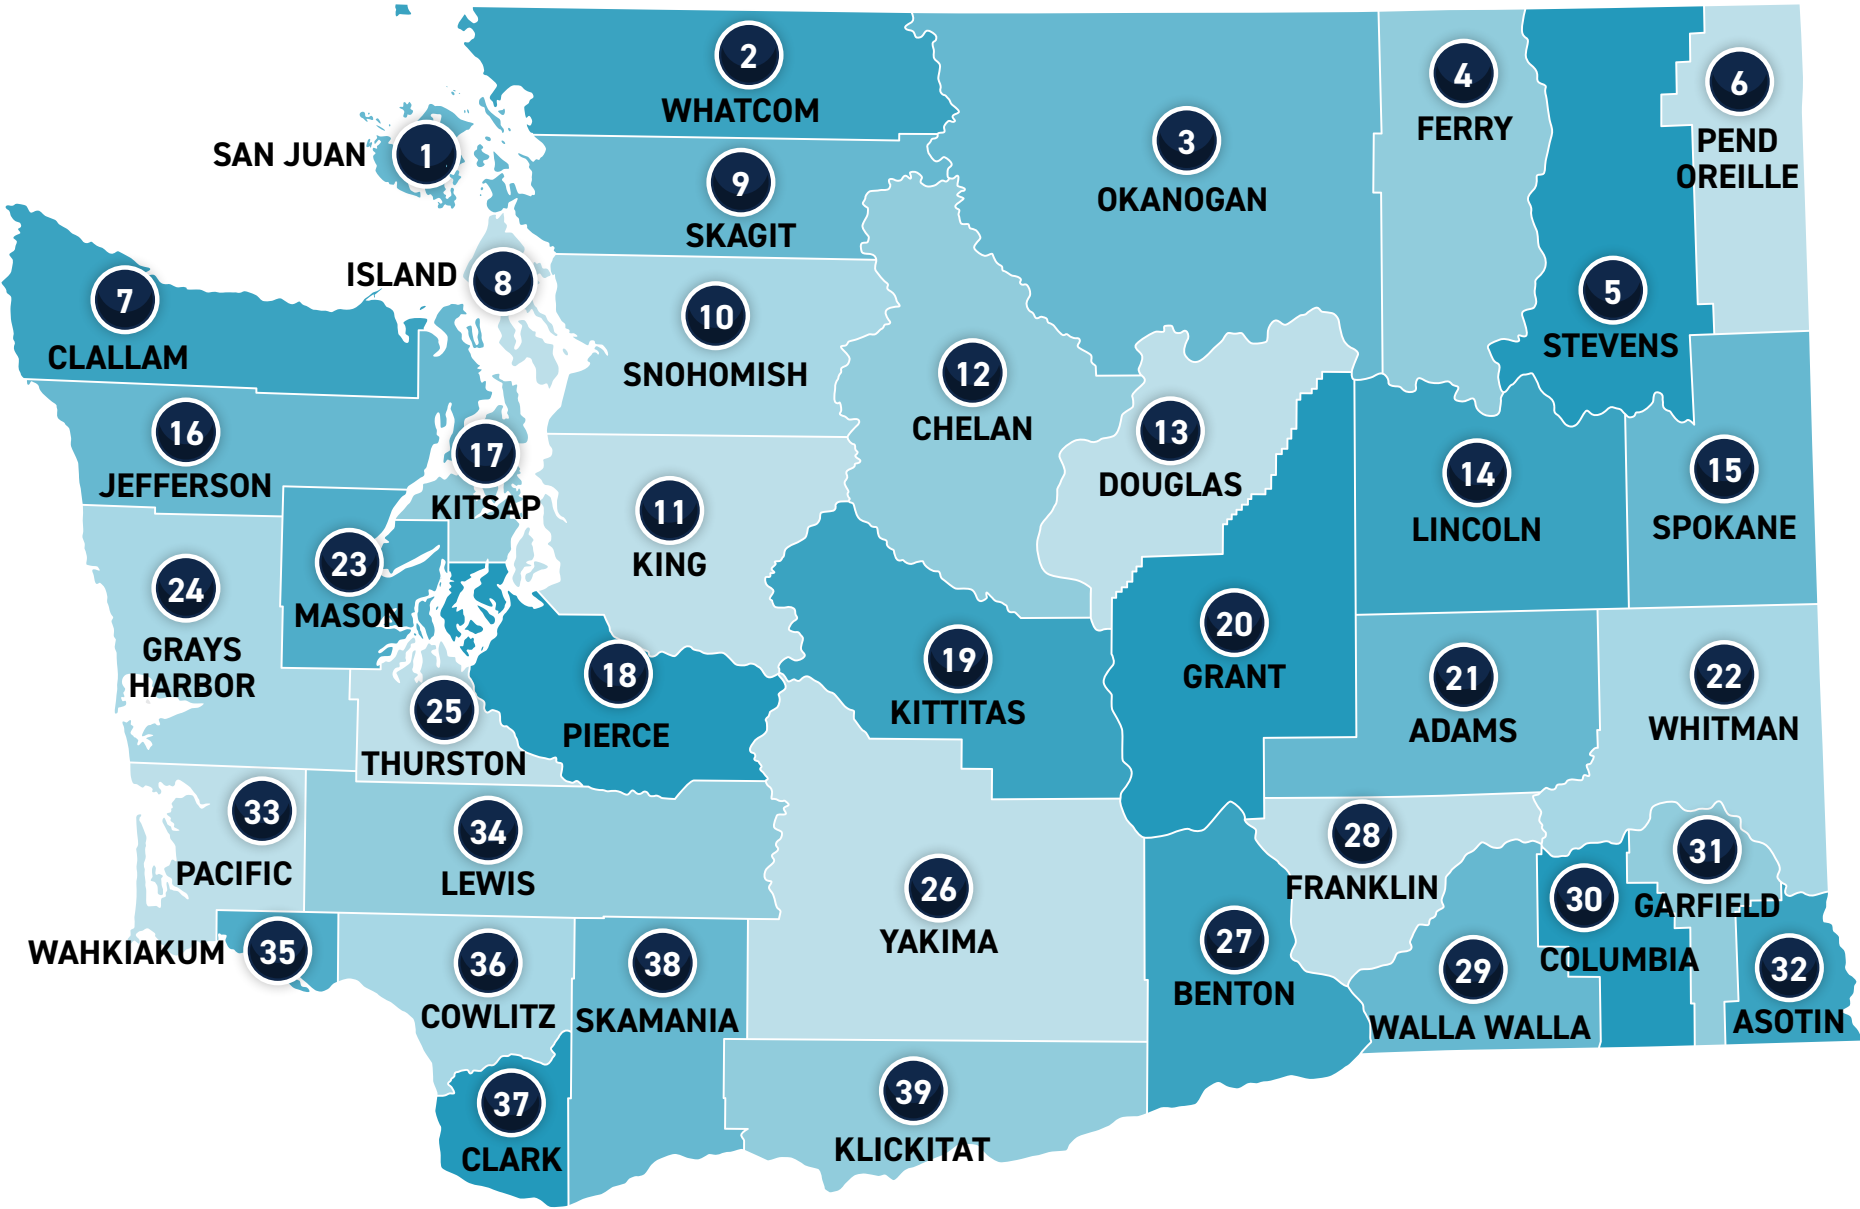

CLALLAM

Engineer
Vacant


Planner
Benjamin Majors
564-669-0855
ben.majors@doh.wa.gov

Source Monitoring Staff
Sophia Petro
564-669-0856
sophia.petro@doh.wa.gov

Coliform Staff
Kacie Seyfert
564-669-0844
kacie.seyfert@doh.wa.gov

WFI & Disinfection Staff
Pi Kosarot (DBP & Surface Water Support)
564-669-3862
pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

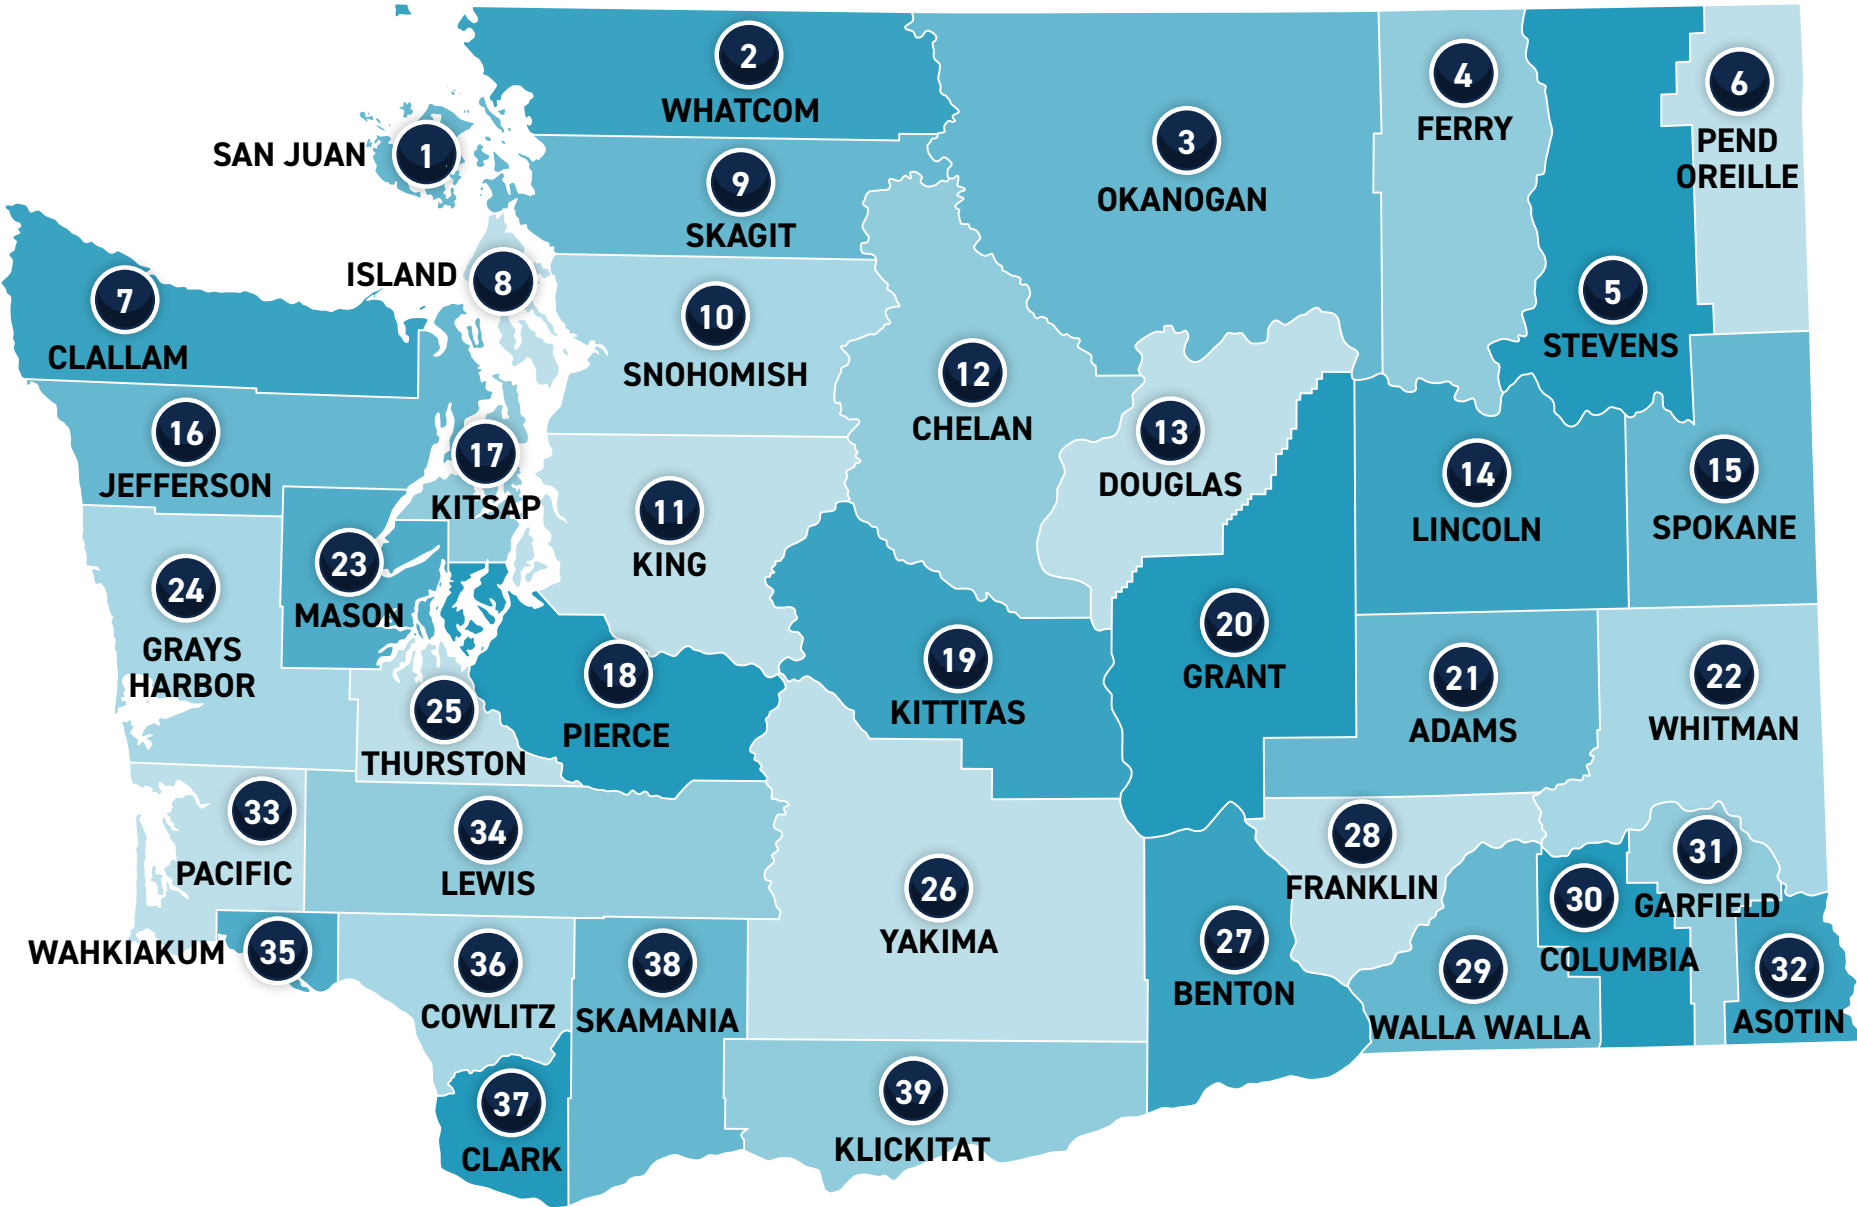

ISLAND

Engineer
Sarah Spotts, PE
564-200-2706
sarah.spotts@doh.wa.gov


Planner
Crystal Nuño
564-233-8696
crystal.nuno@doh.wa.gov

Source Monitoring Staff
Jeff Roeser
253-395-6775
jeff.roeser@doh.wa.gov

Coliform Staff
Joyful Bell
564-250-5813
joyful.bell@doh.wa.gov

WFI & Disinfection Staff
Mary Rucksdashel
360-742-1672
mary.rucksdashel@doh.wa.gov

Office of Drinking Water Contacts by County

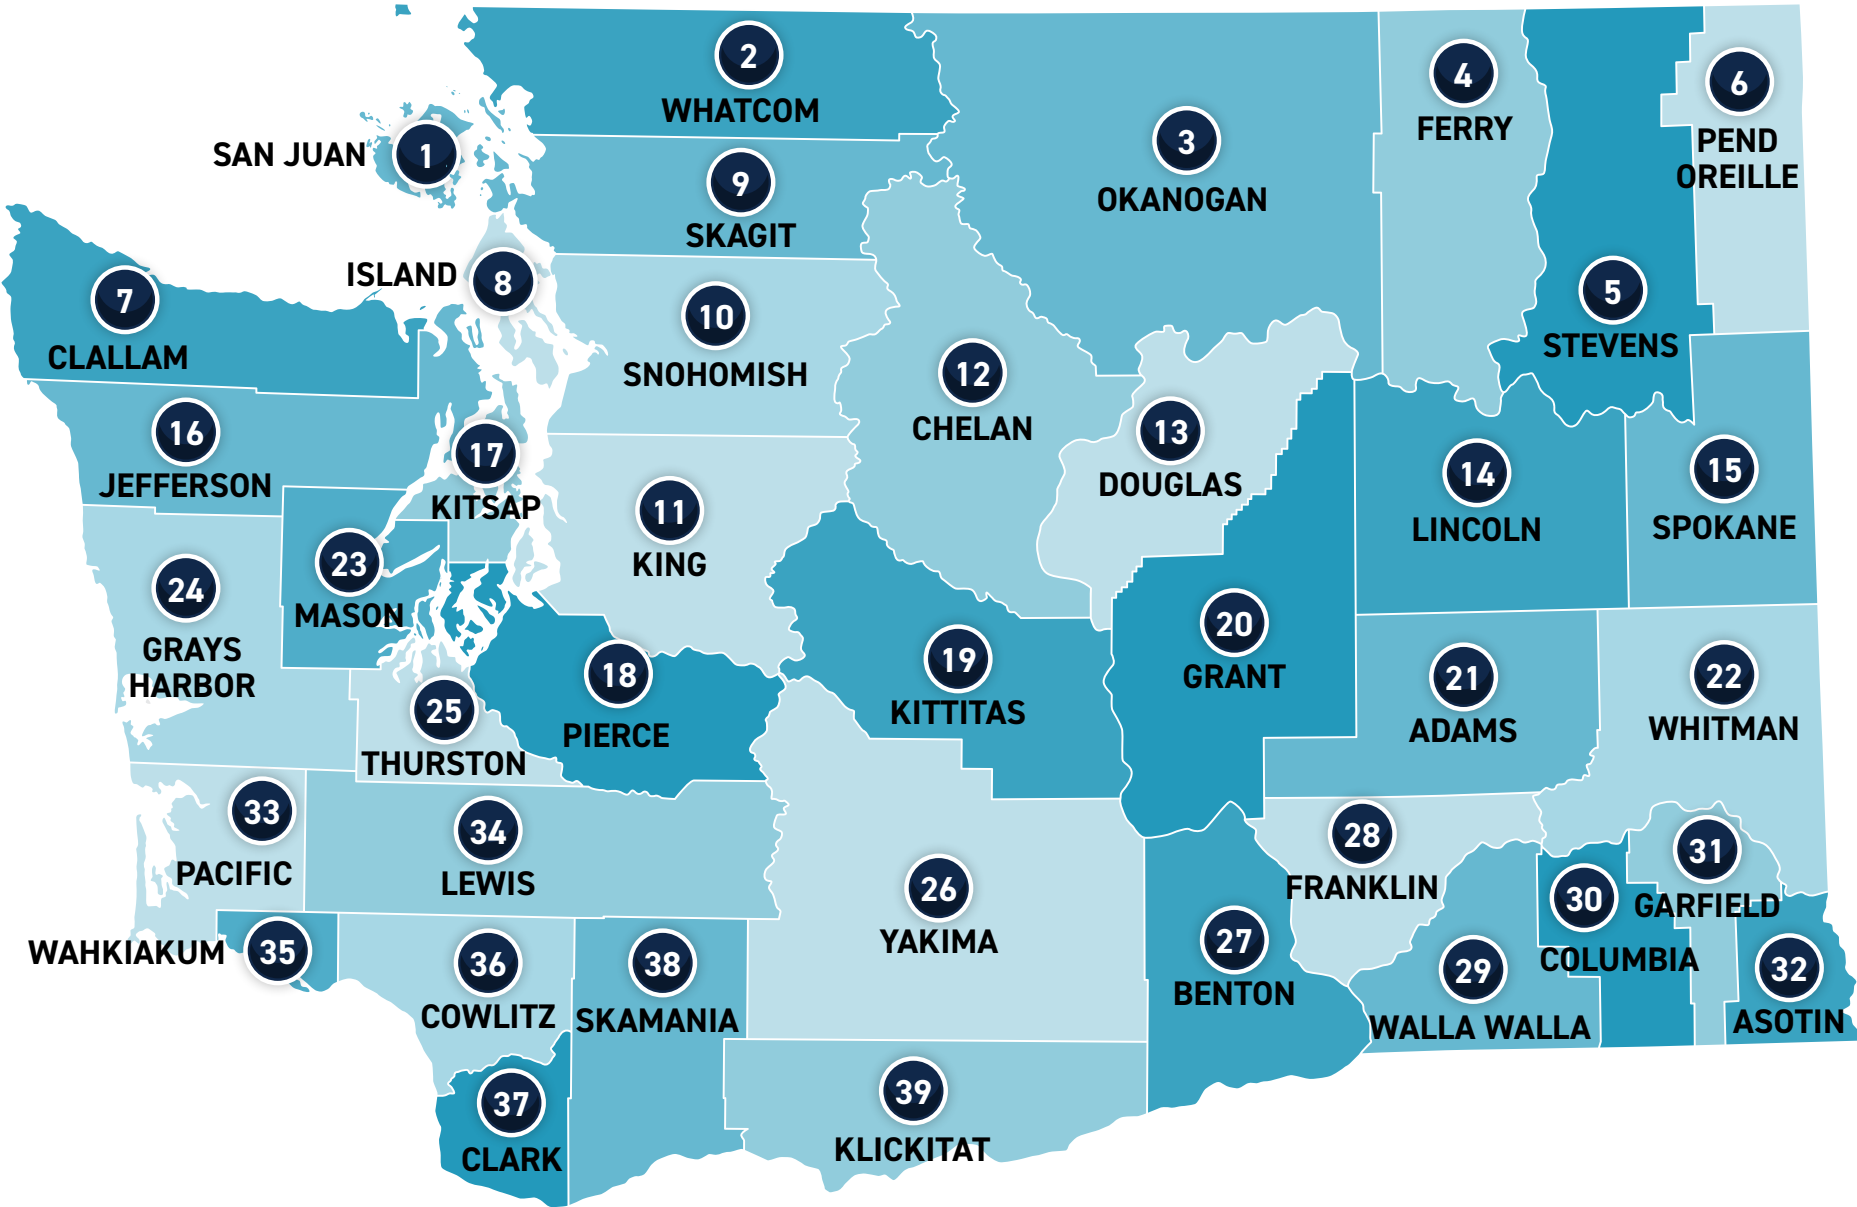

SKAGIT

Engineer
Raquel Callans, PE
(except for Anacortes), 360-800-7482
raquel.callans@doh.wa.gov

Sarah Spotts
(Anacortes only), 564-200-2706
sarah.spotts@doh.wa.gov

Laura McLaughlin
(Anacortes only), 564-669-0753
laura.mclaughlin@doh.wa.gov


Planner
Krista Chavez, 564-669-0757
krista.chavez@doh.wa.gov

Source Monitoring Staff
Jeff Roeser, 253-395-6775
jeff.roeser@doh.wa.gov

Coliform Staff
Joyful Bell, 564-250-5813
joyful.bell@doh.wa.gov

WFI & Disinfection Staff
Mary Rucksdashel, 360-742-1672
mary.rucksdashel@doh.wa.gov

Office of Drinking Water Contacts by County

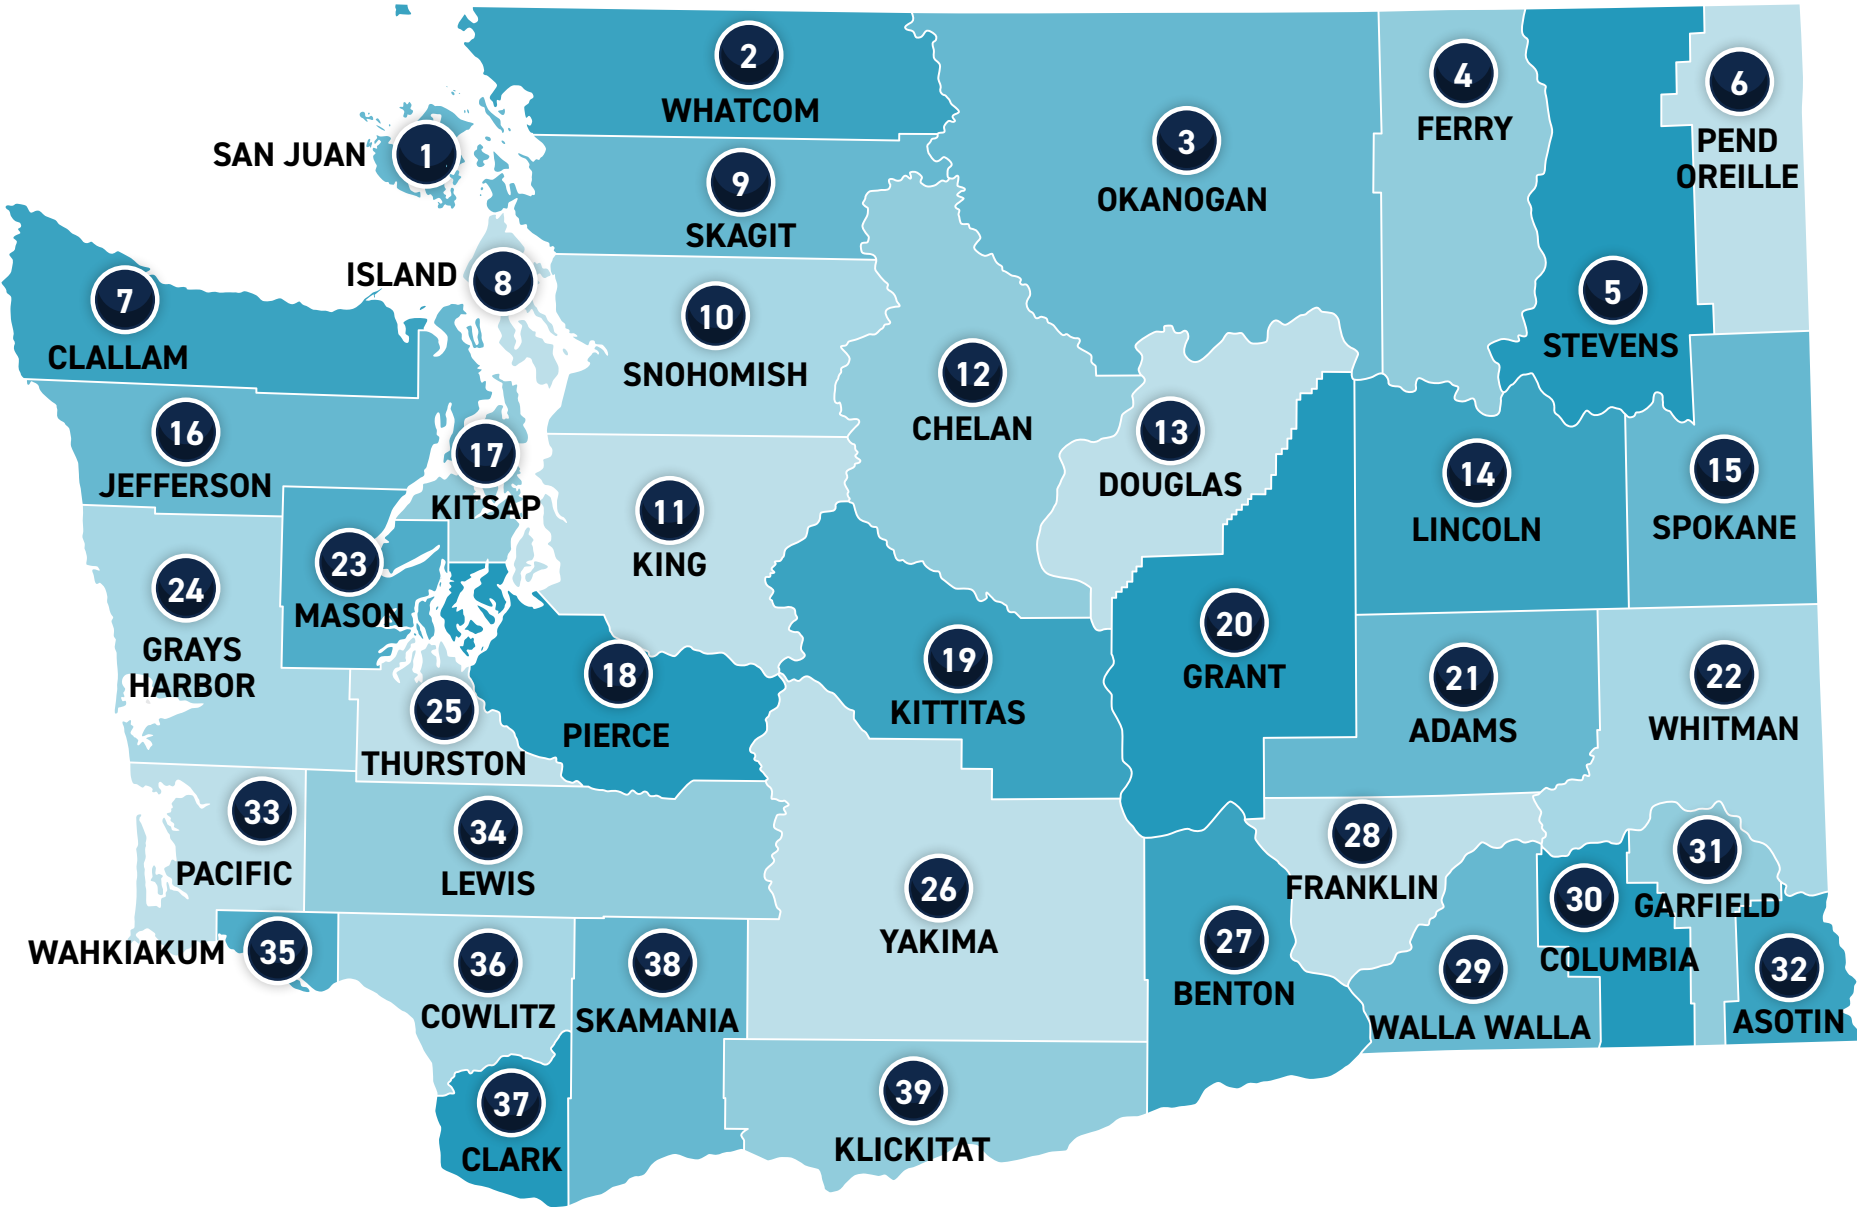

SNOHOMISH

Engineer
PJ Wilkerson, PE
pj.wilkerson@doh.wa.gov

Laura McLaughlin (Everett only)
360-764-9218
laura.mclaughlin@doh.wa.gov


Planner
Crystal Nuño
564-233-8696
crystal.nuno@doh.wa.gov

Source Monitoring Staff
Jeff Roeser
253-395-6775
jeff.roeser@doh.wa.gov

Coliform Staff
Joyful Bell
564-250-5813
joyful.bell@doh.wa.gov

WFI & Disinfection Staff
Mary Rucksdashel
360-742-1672
mary.rucksdashel@doh.wa.gov

Office of Drinking Water Contacts by County

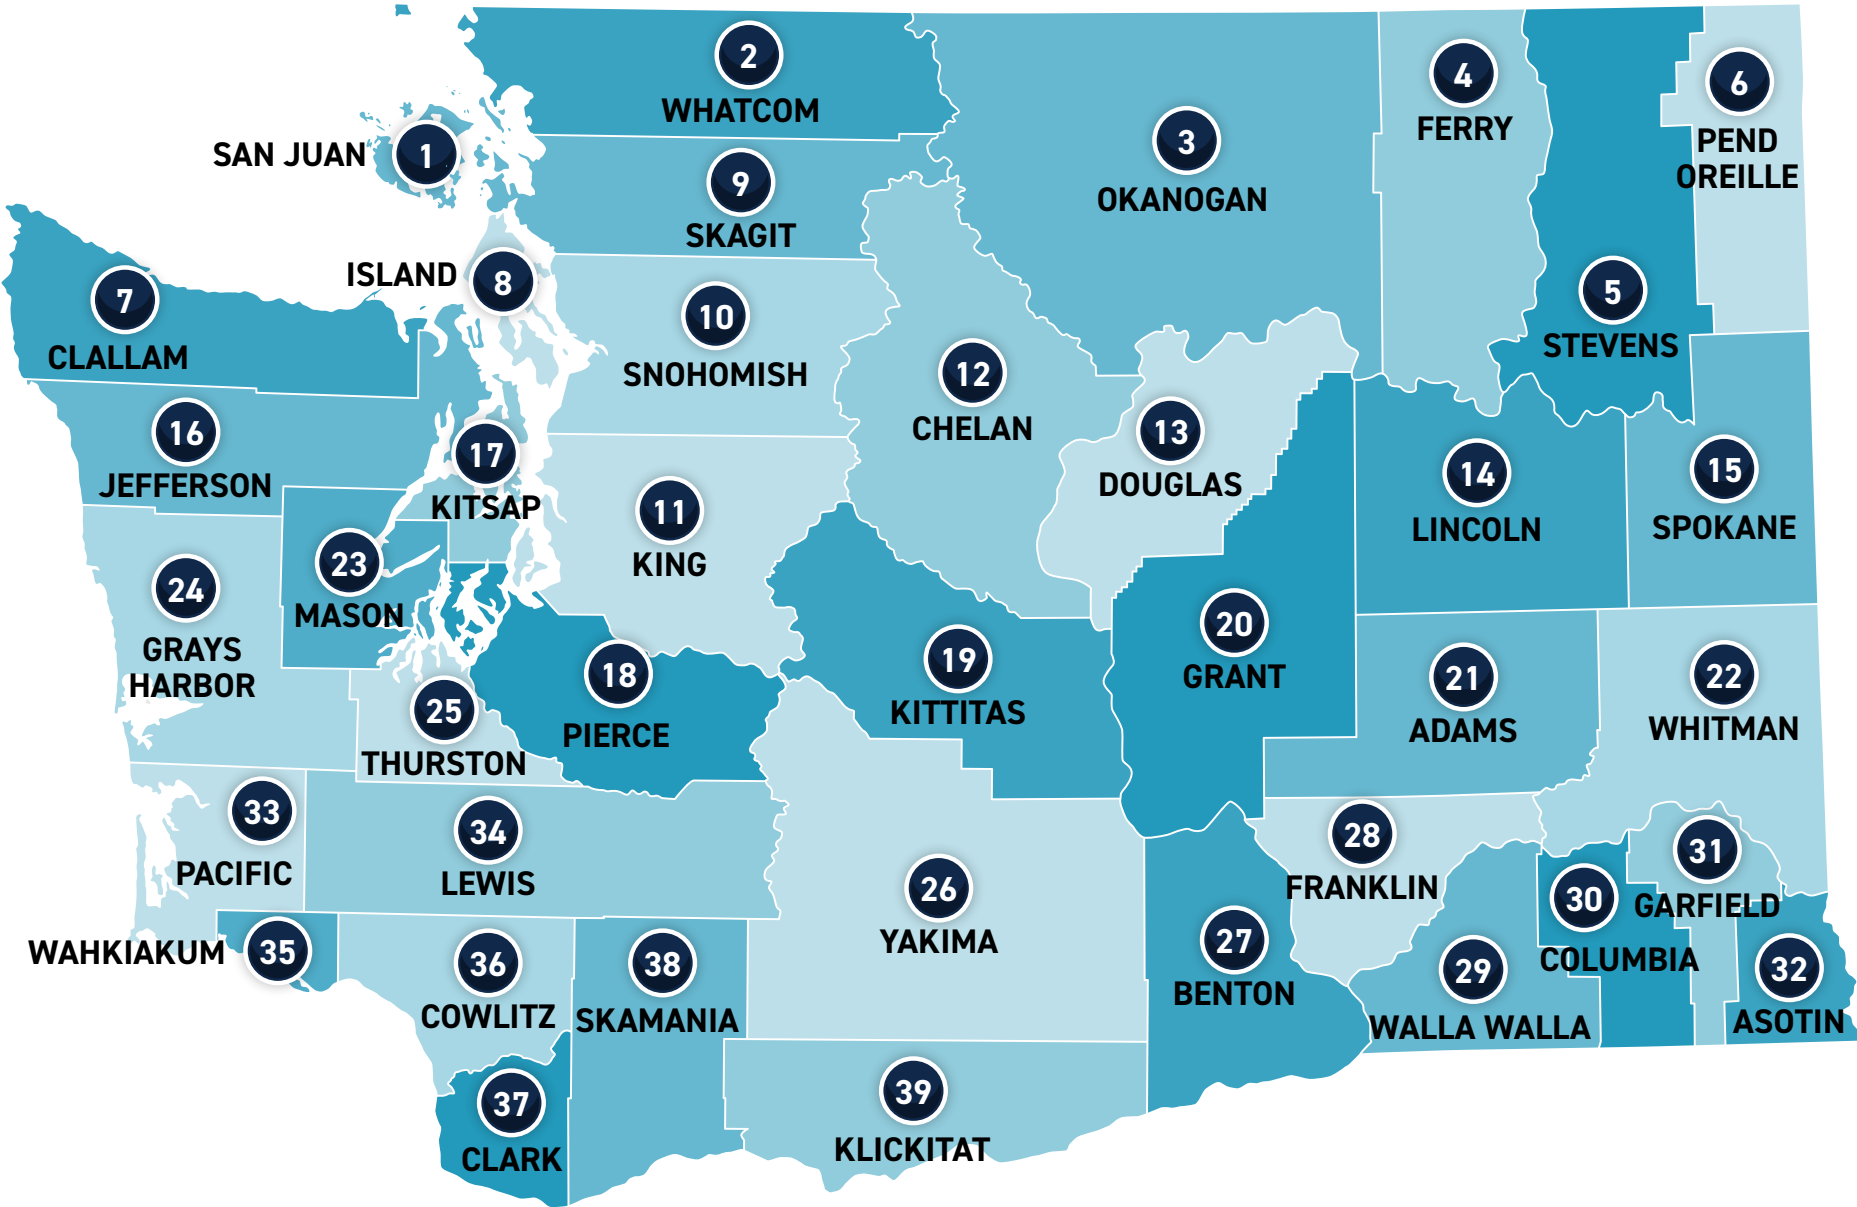

KING

Engineer
Brietta Carter, PE
(All of King County & SPU except for Vashon Island), 564-999-3355
brietta.carter@doh.wa.gov

Sarah Spotts, PE
(Vashon Island), 564-200-2706
sarah.spotts@doh.wa.gov

Laura McLaughlin
(SPU - Seattle Public Utilities only), 564-669-0753
laura.mclaughlin@doh.wa.gov


Planner
Krista Chavez, 564-669-0757
krista.chavez@doh.wa.gov

Source Monitoring Staff
Jeff Roeser, 253-395-6775
jeff.roeser@doh.wa.gov

Coliform Staff
Joyful Bell, 564-250-5813
joyful.bell@doh.wa.gov

WFI & Disinfection Staff
Mary Rucksdashel, 360-742-1672
mary.rucksdashel@doh.wa.gov

Office of Drinking Water Contacts by County

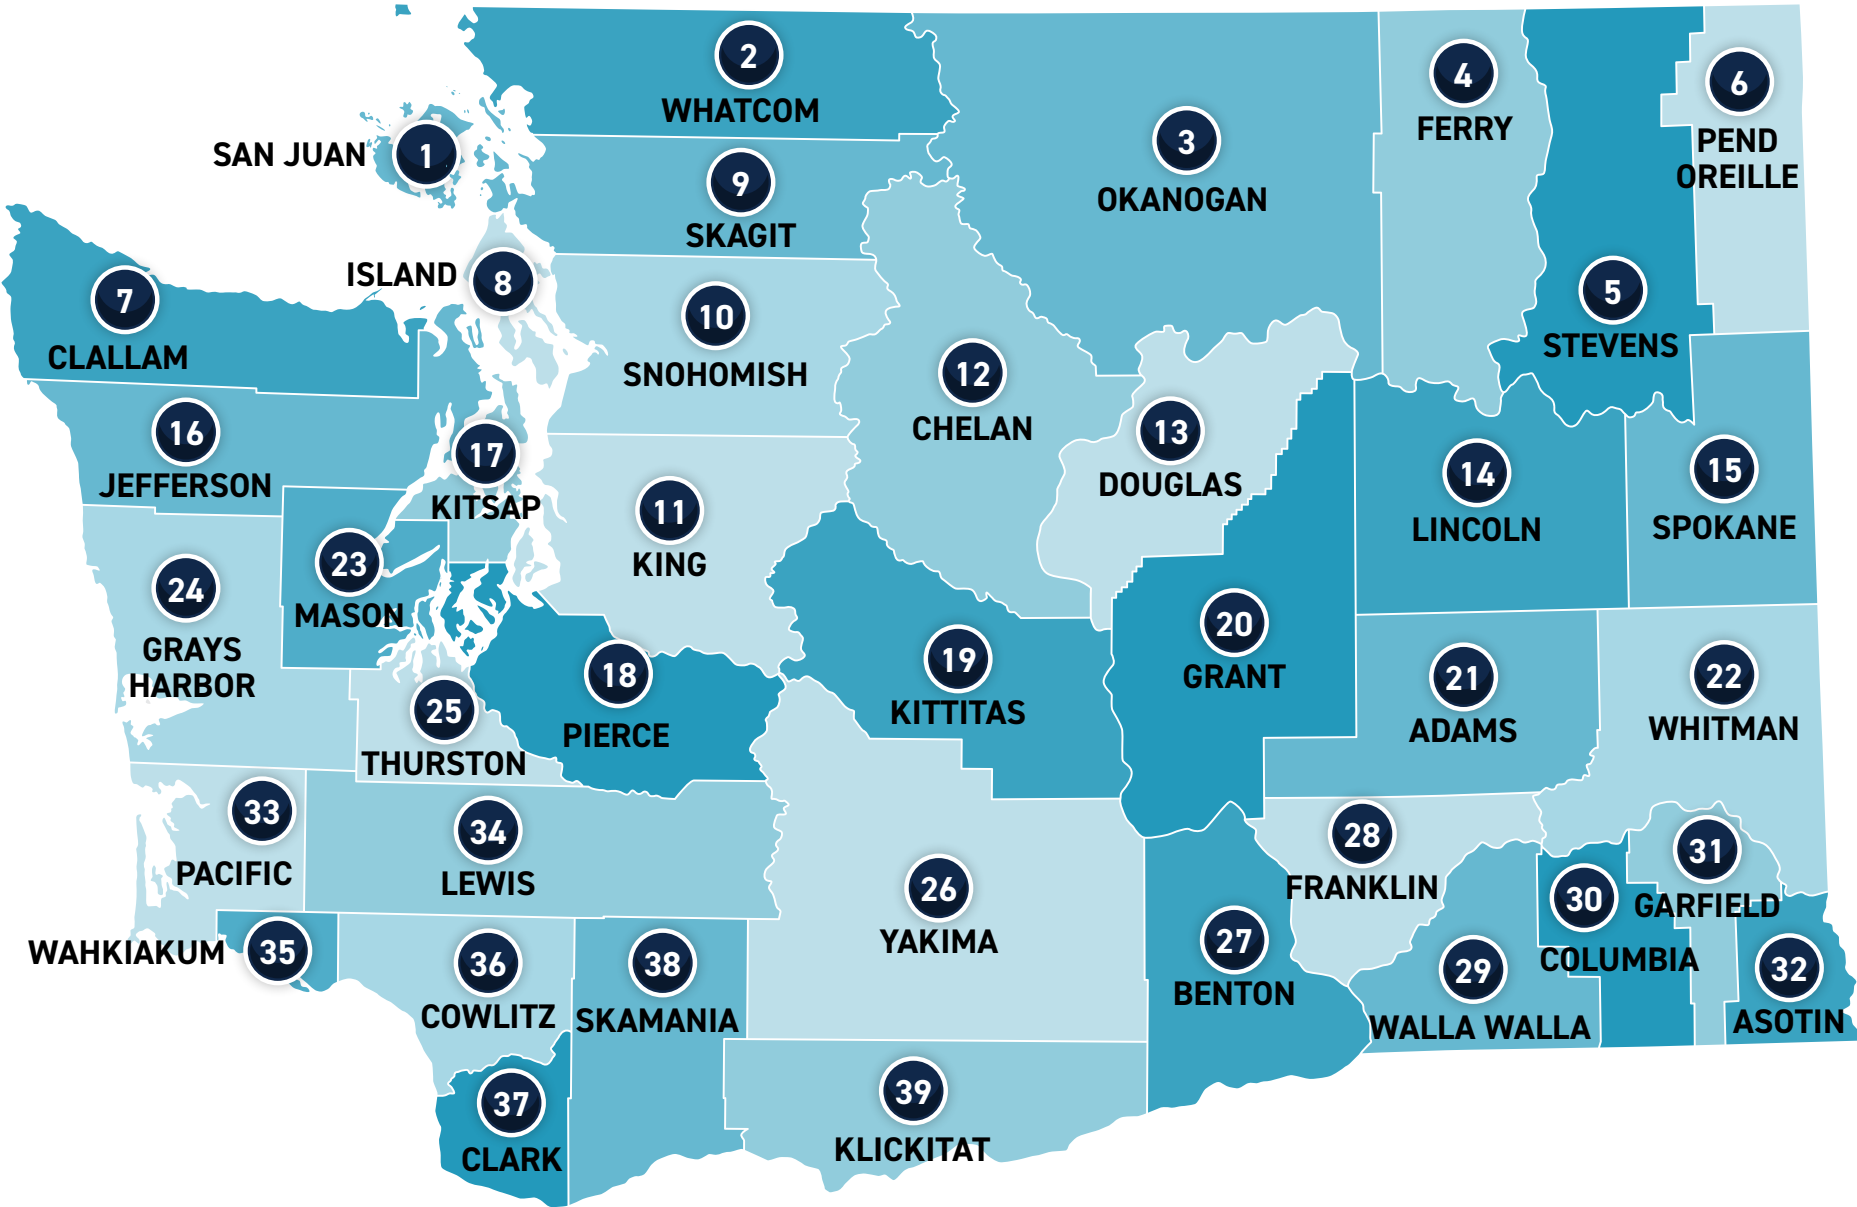

CHELAN

Engineer
Sheri Miller, PE
509-407-7160
sheri.miller@doh.wa.gov

Planner
Hollis Staal
564-233-8707
hollis.staal@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

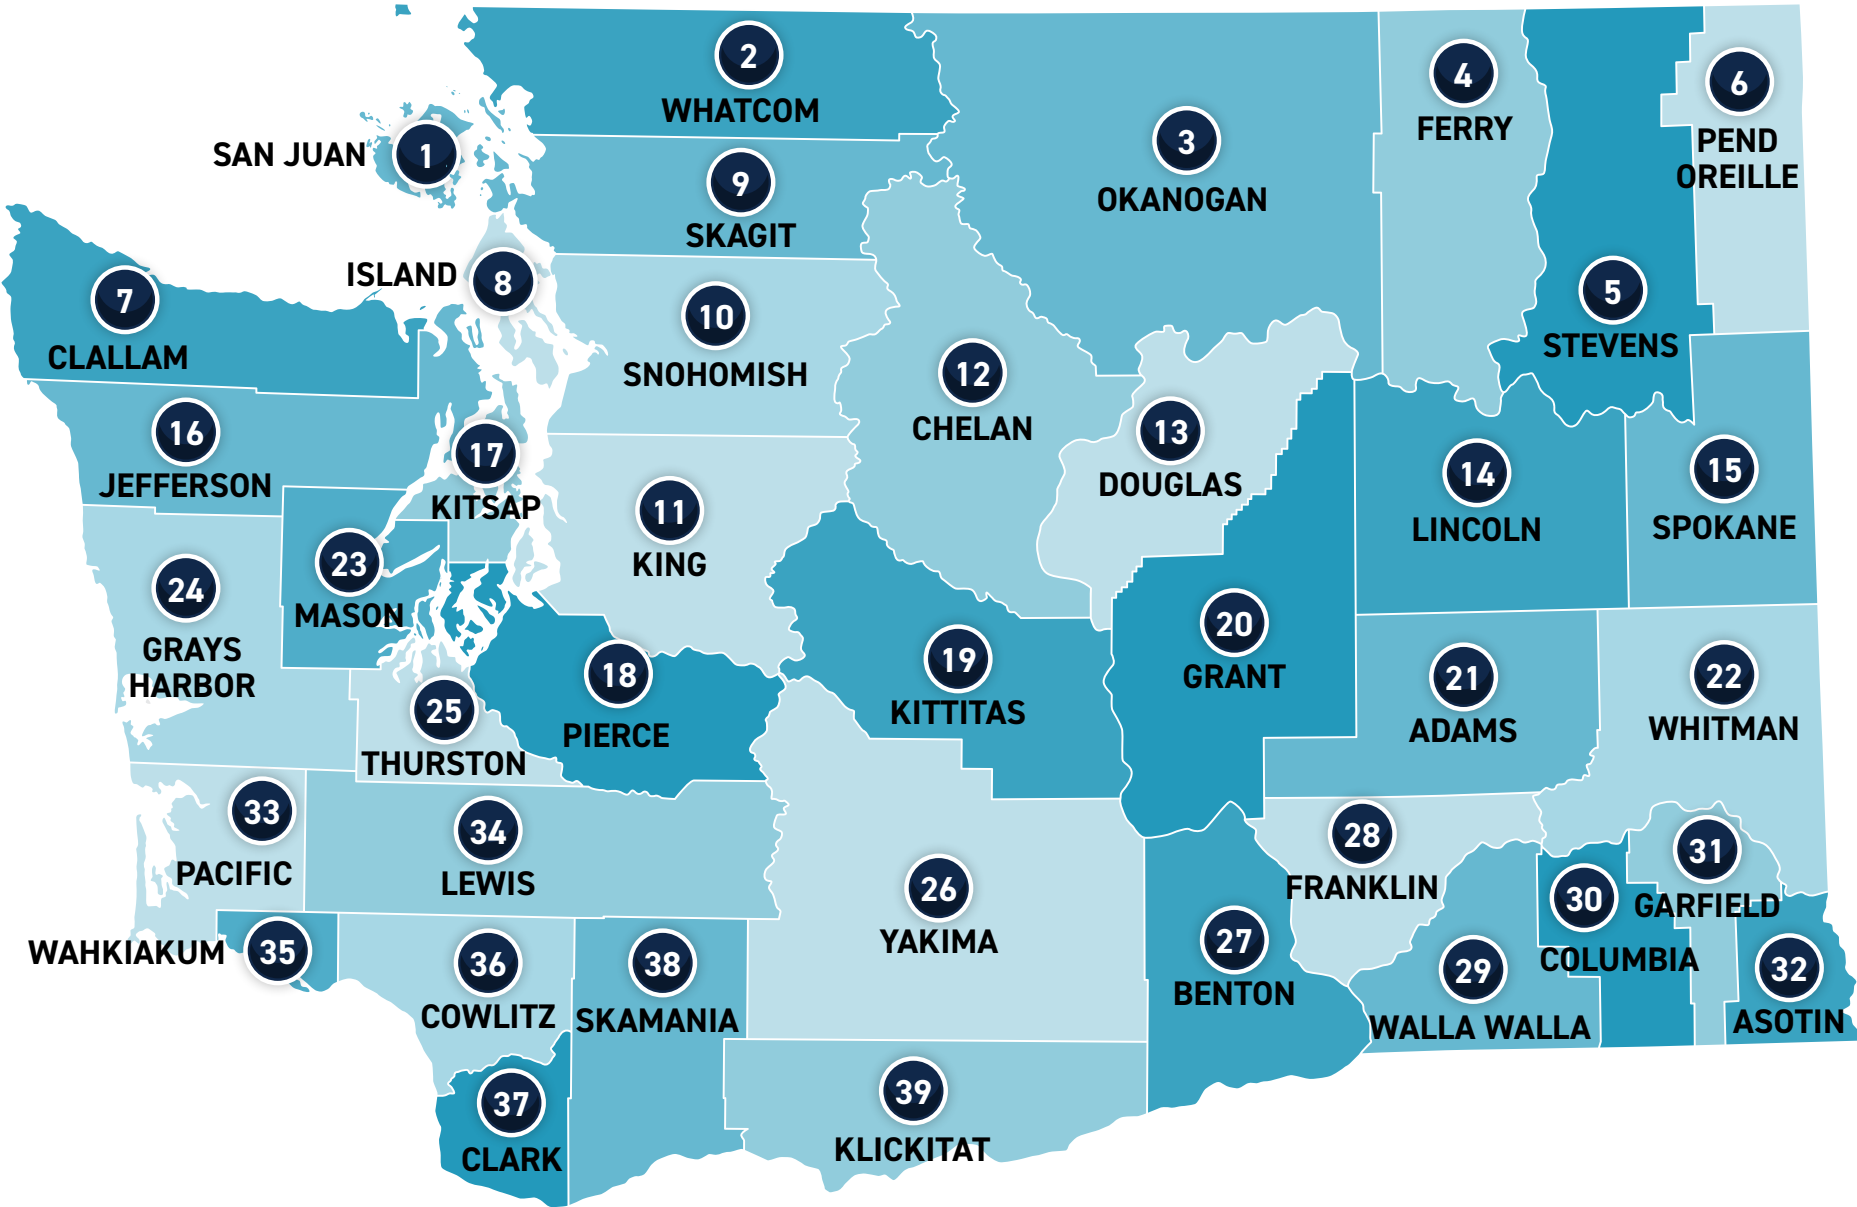

DOUGLAS

Engineer
Sheri Miller, PE
509-407-7160
sherimiller@doh.wa.gov

Planner
Hollis Staal
564-233-8707
hollisstaal@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashlybeebe@doh.wa.gov

Anna Duron
509-507-0504
annaduron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

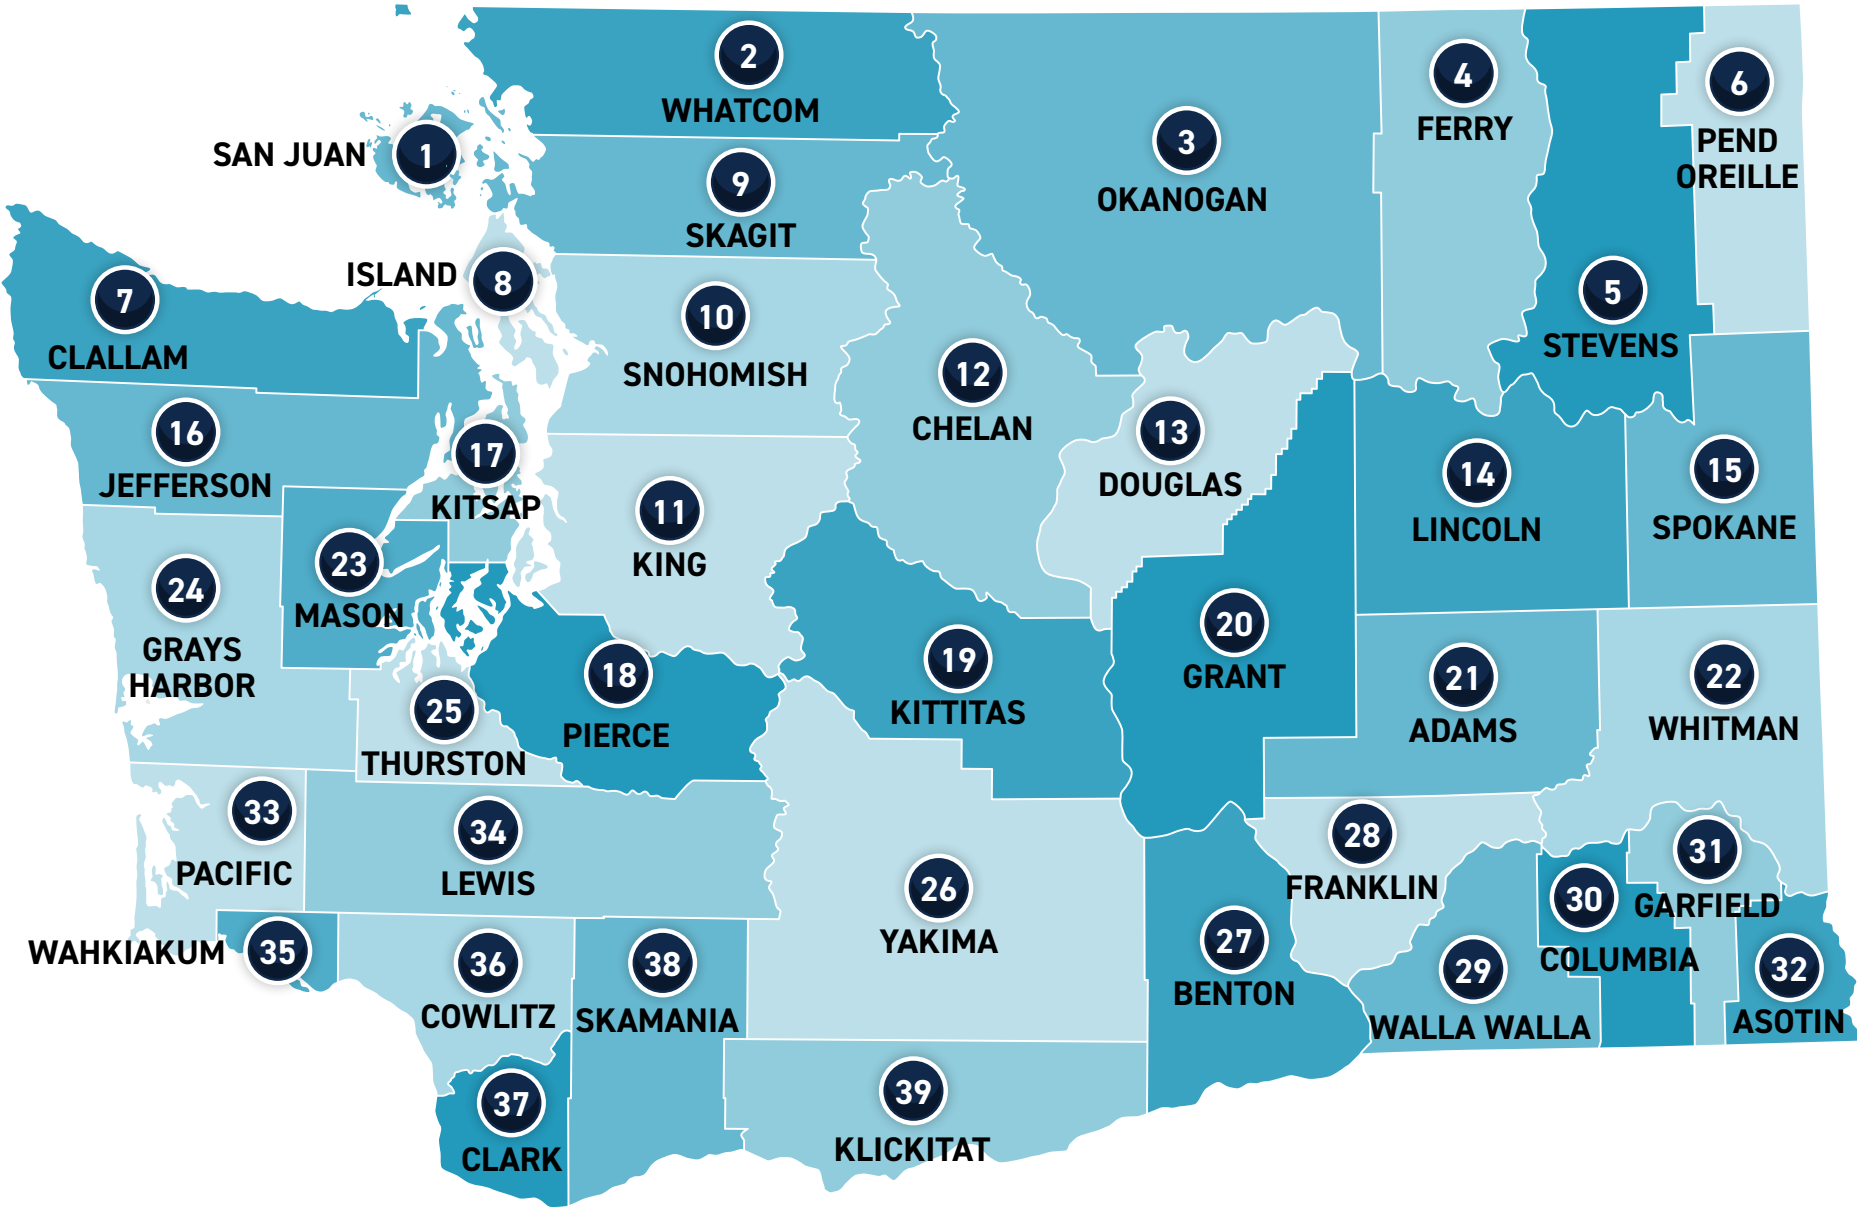

LINCOLN

Engineer
Russell Mau, PE
509-329-2116
russell.mau@doh.wa.gov

Planner
Hollis Staal
564-233-8707
hollis.staal@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

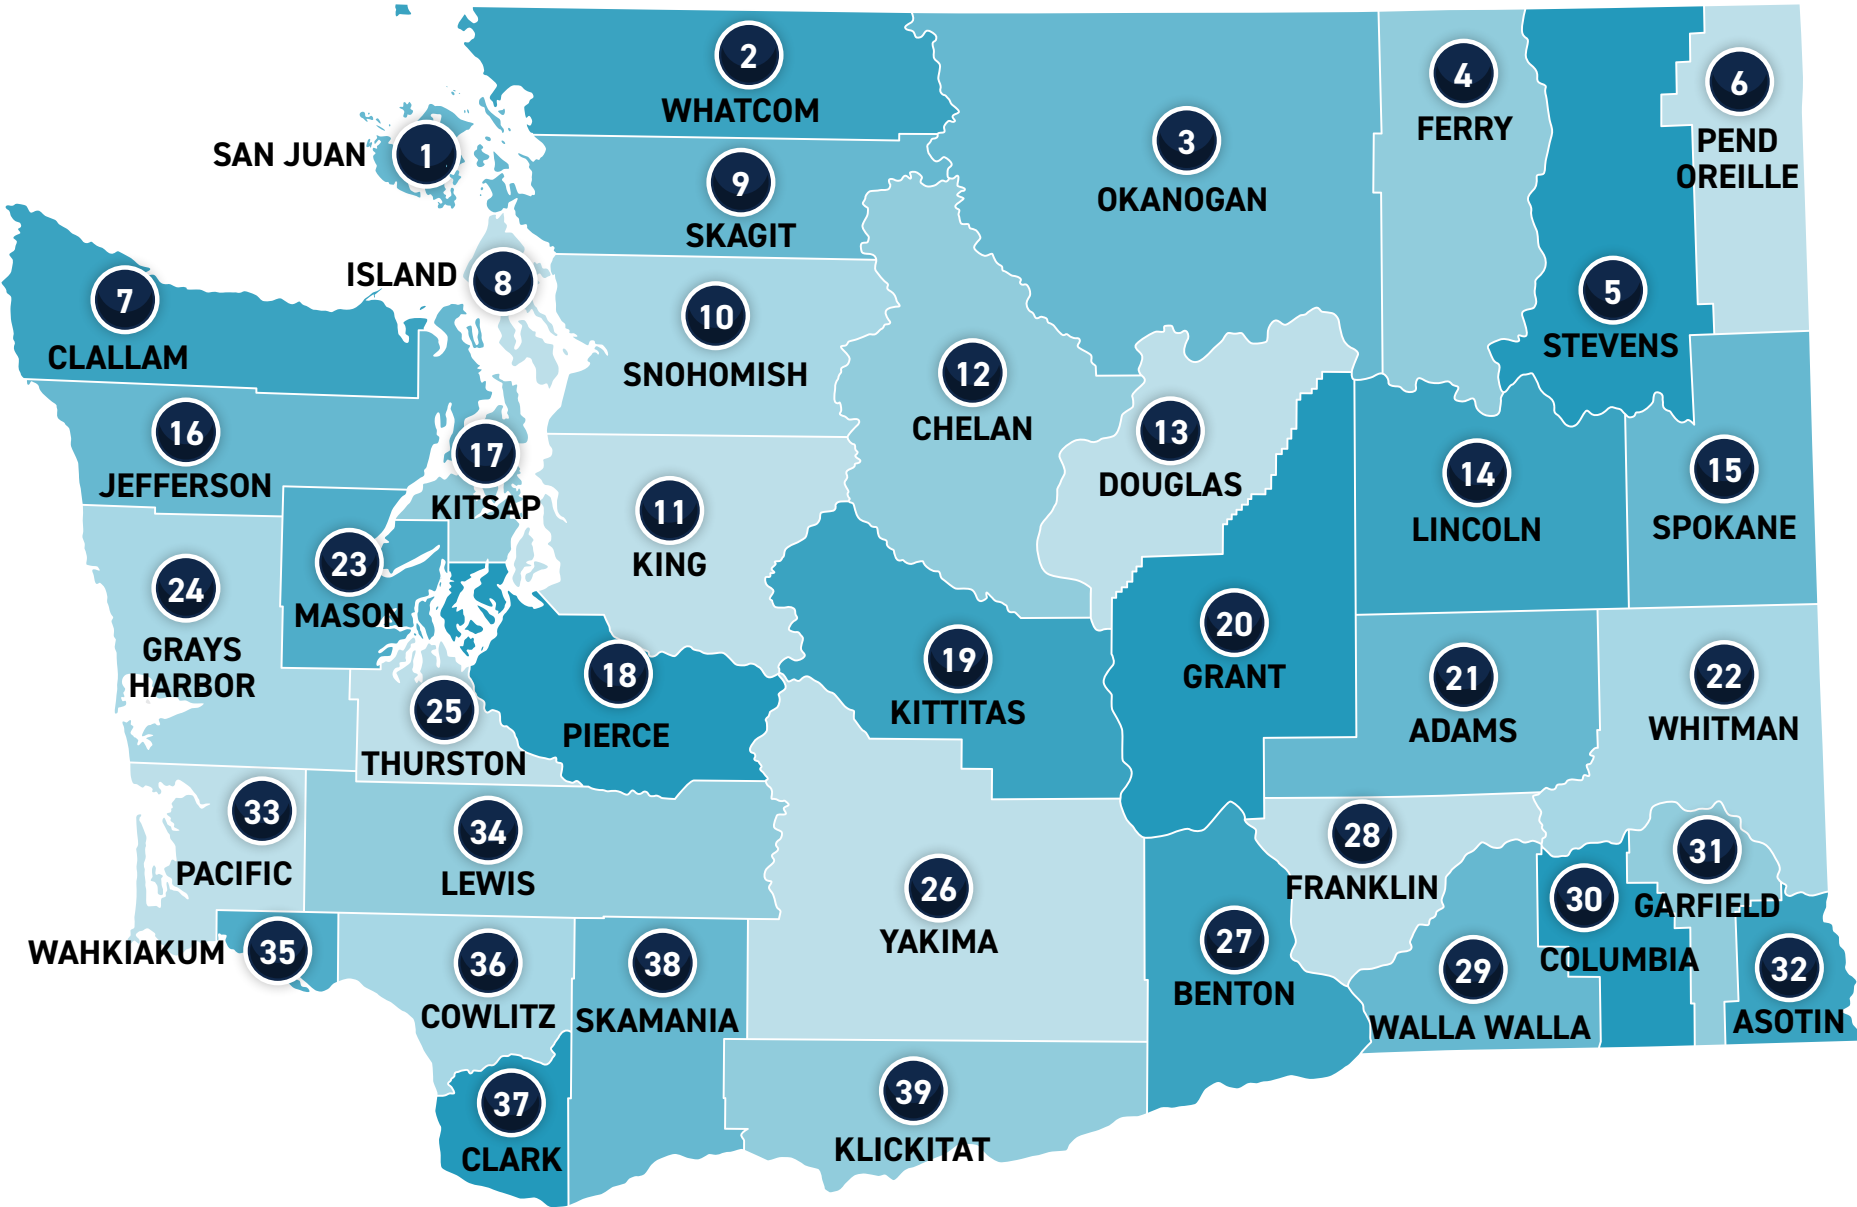

SPOKANE

Engineer
Nathan Ikehara, PE
564-669-3828
nathan.ikehara@doh.wa.gov

Planner
Hollis Staal
564-233-8707
hollis.staal@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

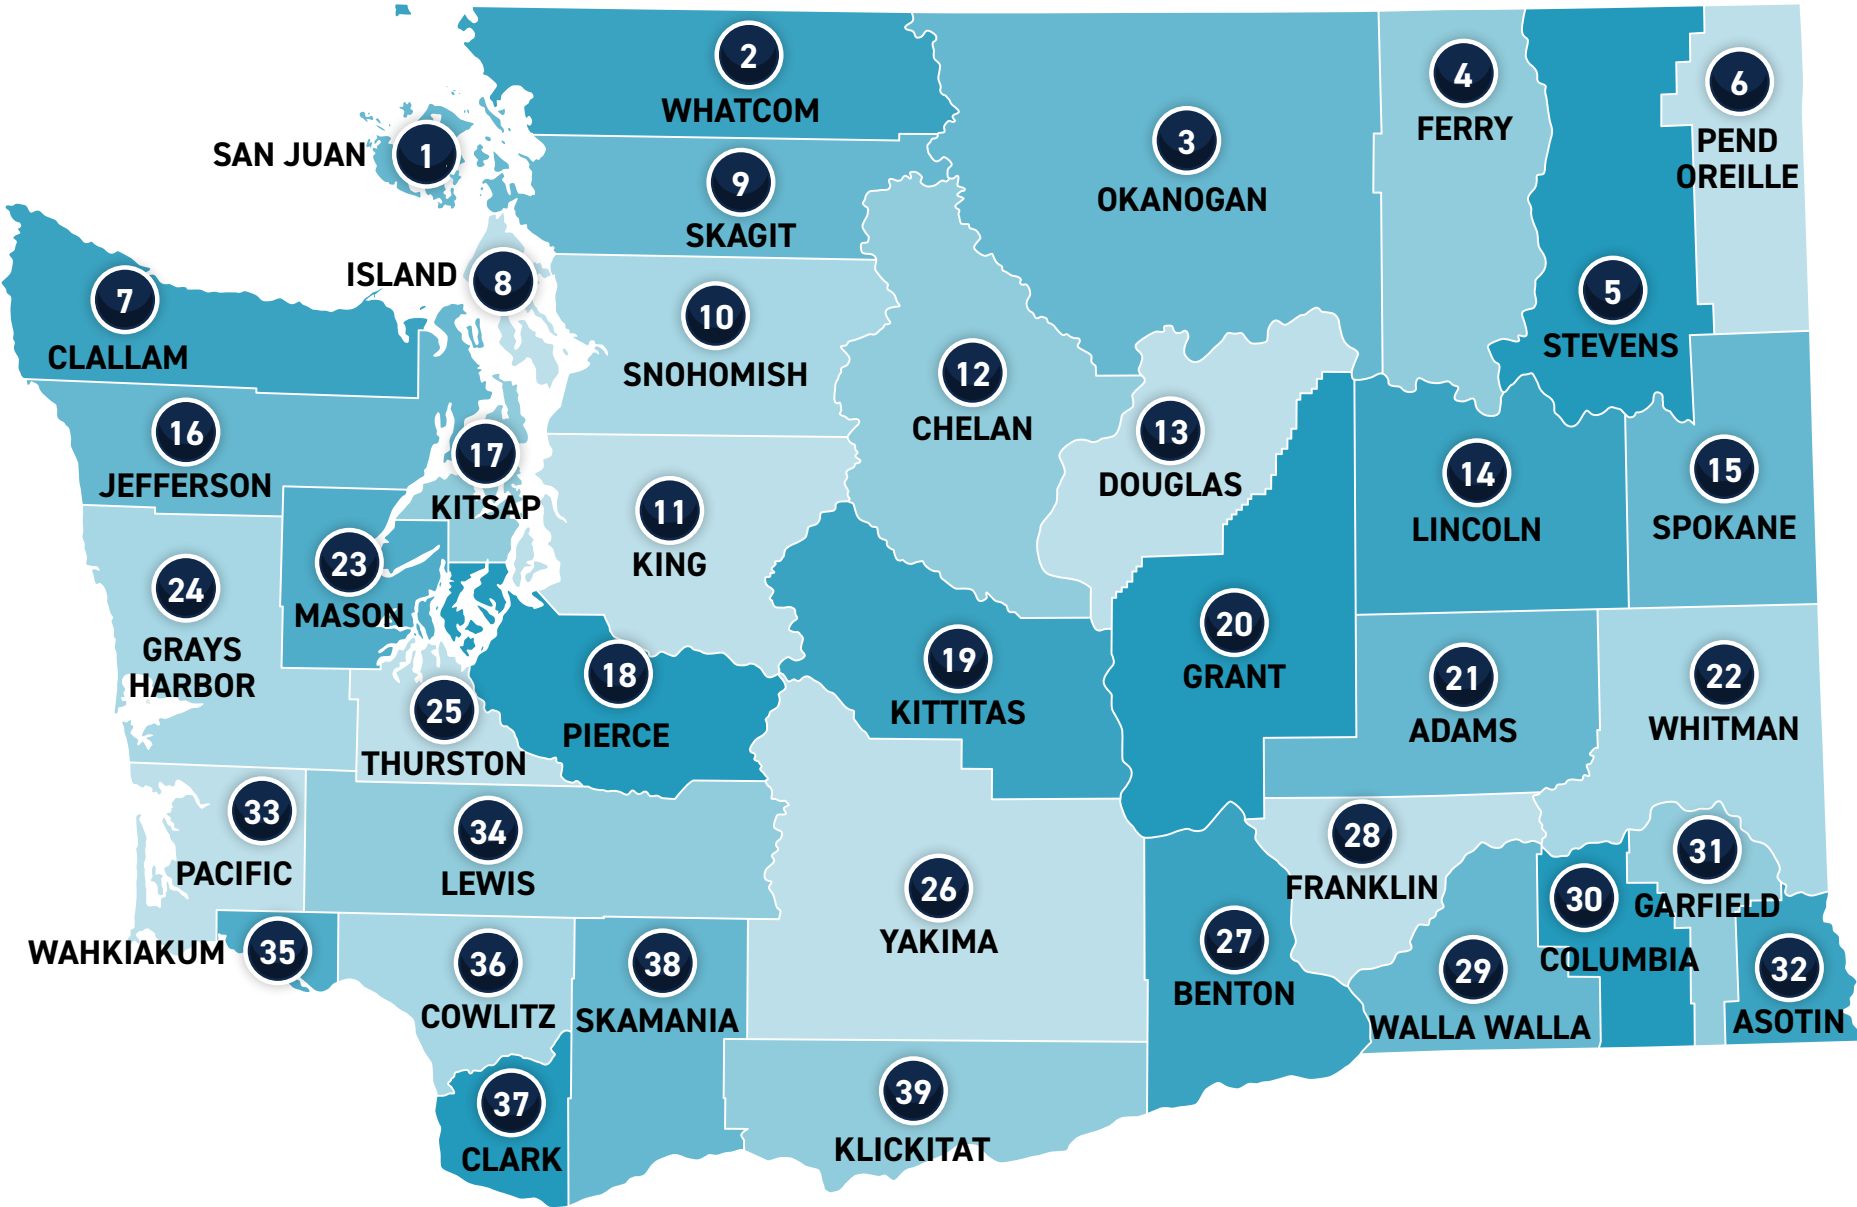

JEFFERSON

Engineer

R. Scott Pollock, PE

564-669-0854

rscott.pollock@doh.wa.gov

Planner

Benjamin Majors

564-669-0855

ben.majors@doh.wa.gov

Source Monitoring Staff

Sophia Petro

564-669-0856

sophia.petro@doh.wa.gov

Coliform Staff

Kacie Seyfert

564-669-0844

kacie.seyfert@doh.wa.gov


WFI & Disinfection Staff

Pi Kosarot (DBP & Surface Water Support)

564-669-3862

pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

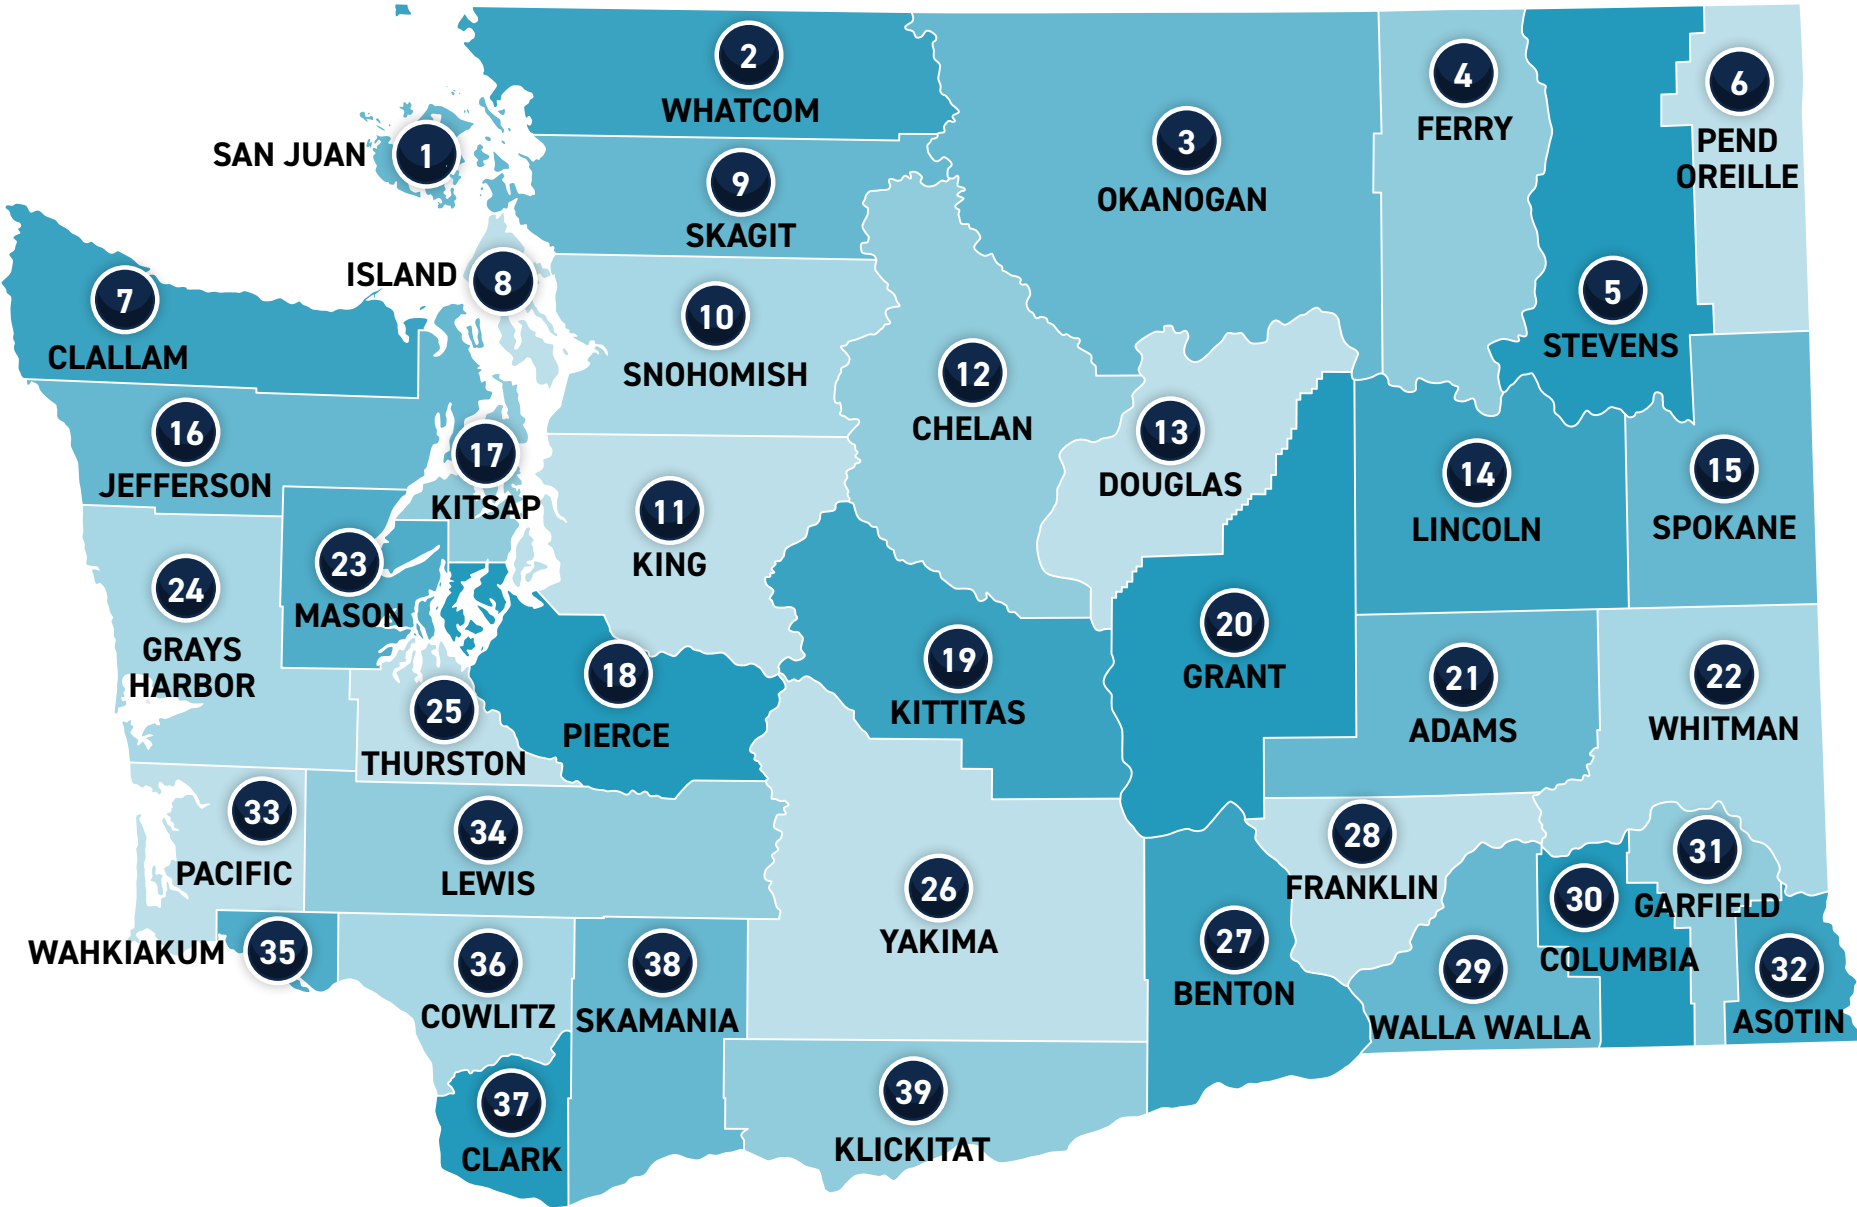

KITSAP

Engineer
Candida Granillo-Dodds, PE
564-669-3170
candida.granillo-dodds@doh.wa.gov


Planner
Benjamin Majors
564-669-0855
ben.majors@doh.wa.gov

Source Monitoring Staff
Sophia Petro
564-669-0856
sophia.petro@doh.wa.gov

Coliform Staff
Kacie Seyfert
564-669-0844
kacie.seyfert@doh.wa.gov

WFI & Disinfection Staff
Pi Kosarot (DBP & Surface Water Support)
564-669-3862
pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

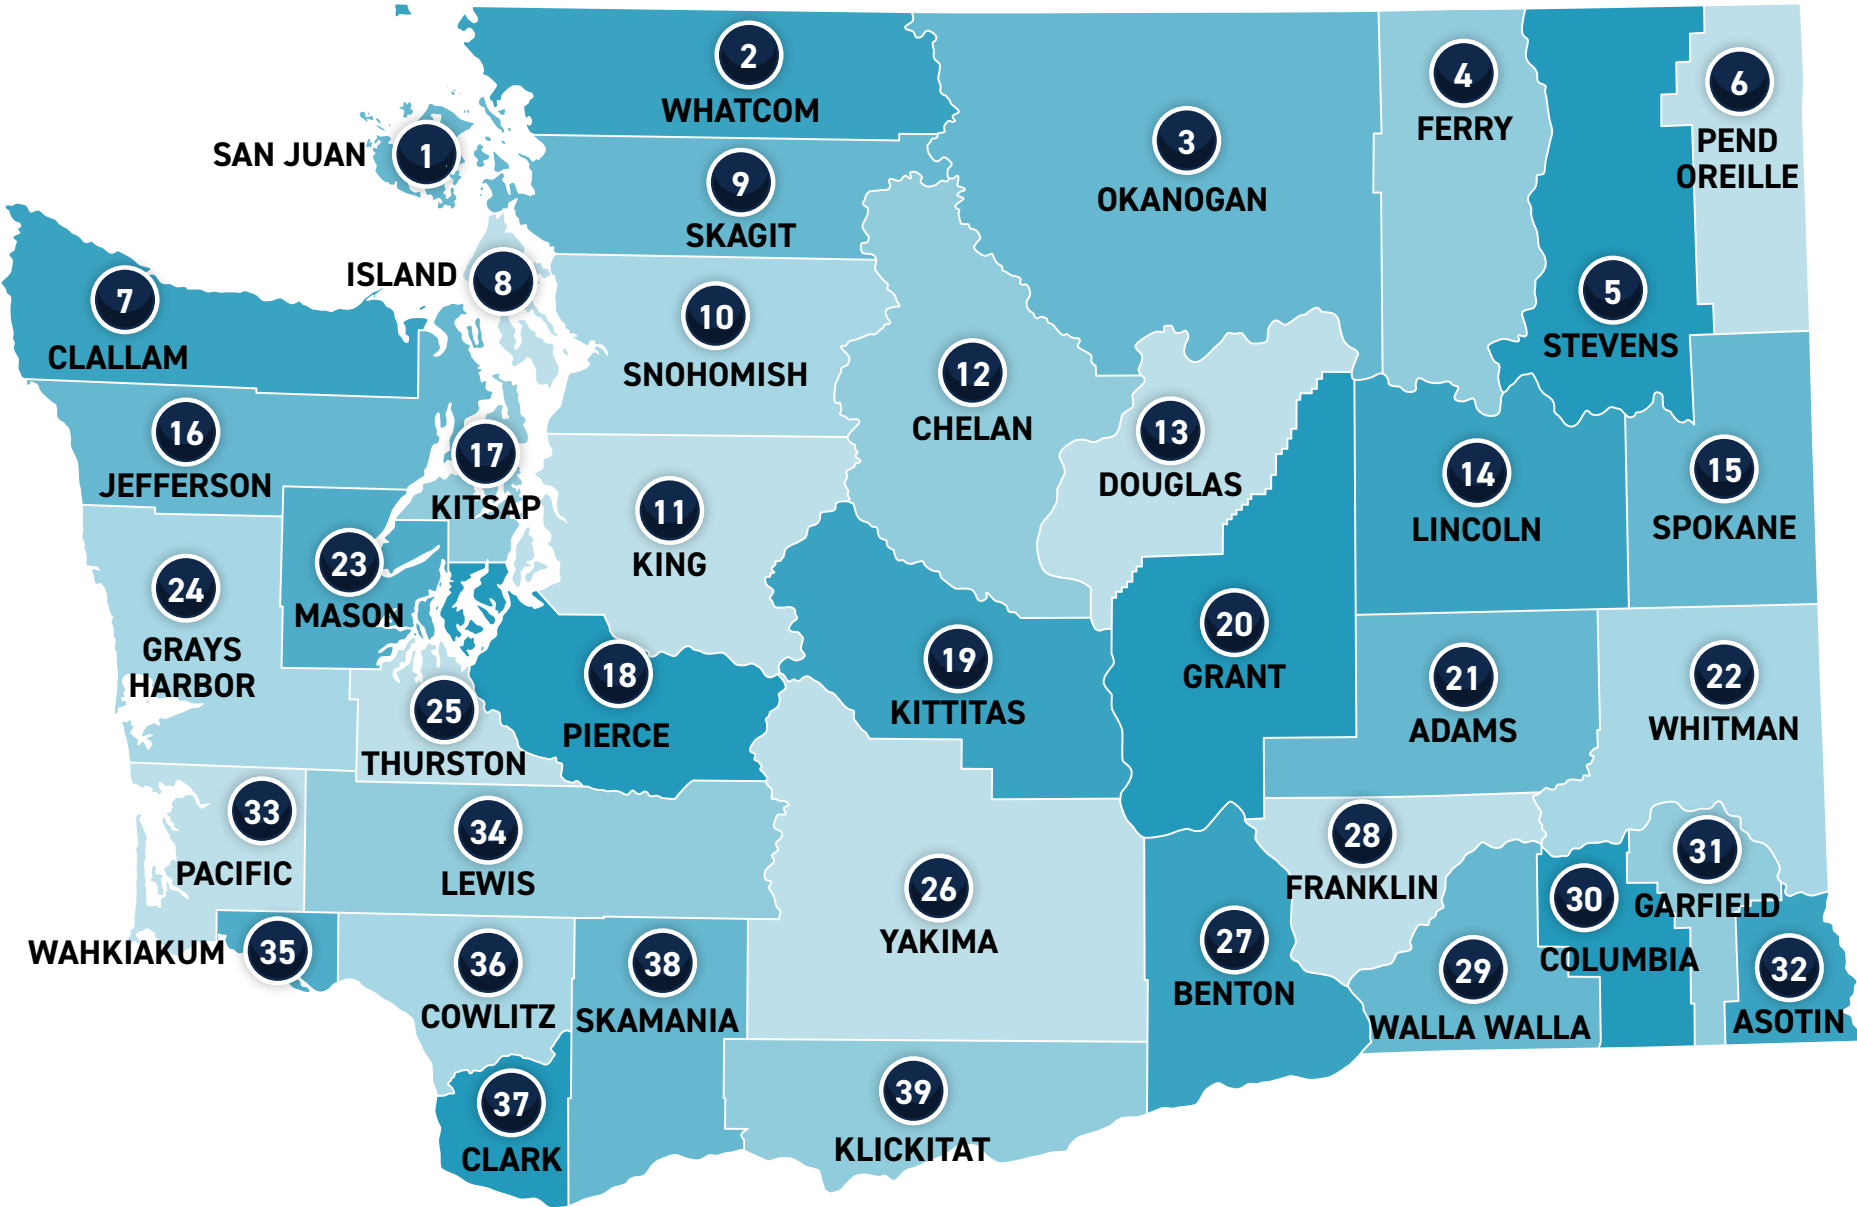

PIERCE

Engineer
Carol Stuckey, PE
360-485-7607
carol.stuckey@doh.wa.gov


Planner
Crystal Nuño
564-233-8696
crystal.nuno@doh.wa.gov

Source Monitoring Staff
Jeff Roeser
253-395-6775
jeff.roeser@doh.wa.gov

Coliform Staff
Joyful Bell
564-250-5813
joyful.bell@doh.wa.gov

WFI & Disinfection Staff
Mary Rucksdashel
360-742-1672
mary.rucksdashel@doh.wa.gov

Office of Drinking Water Contacts by County

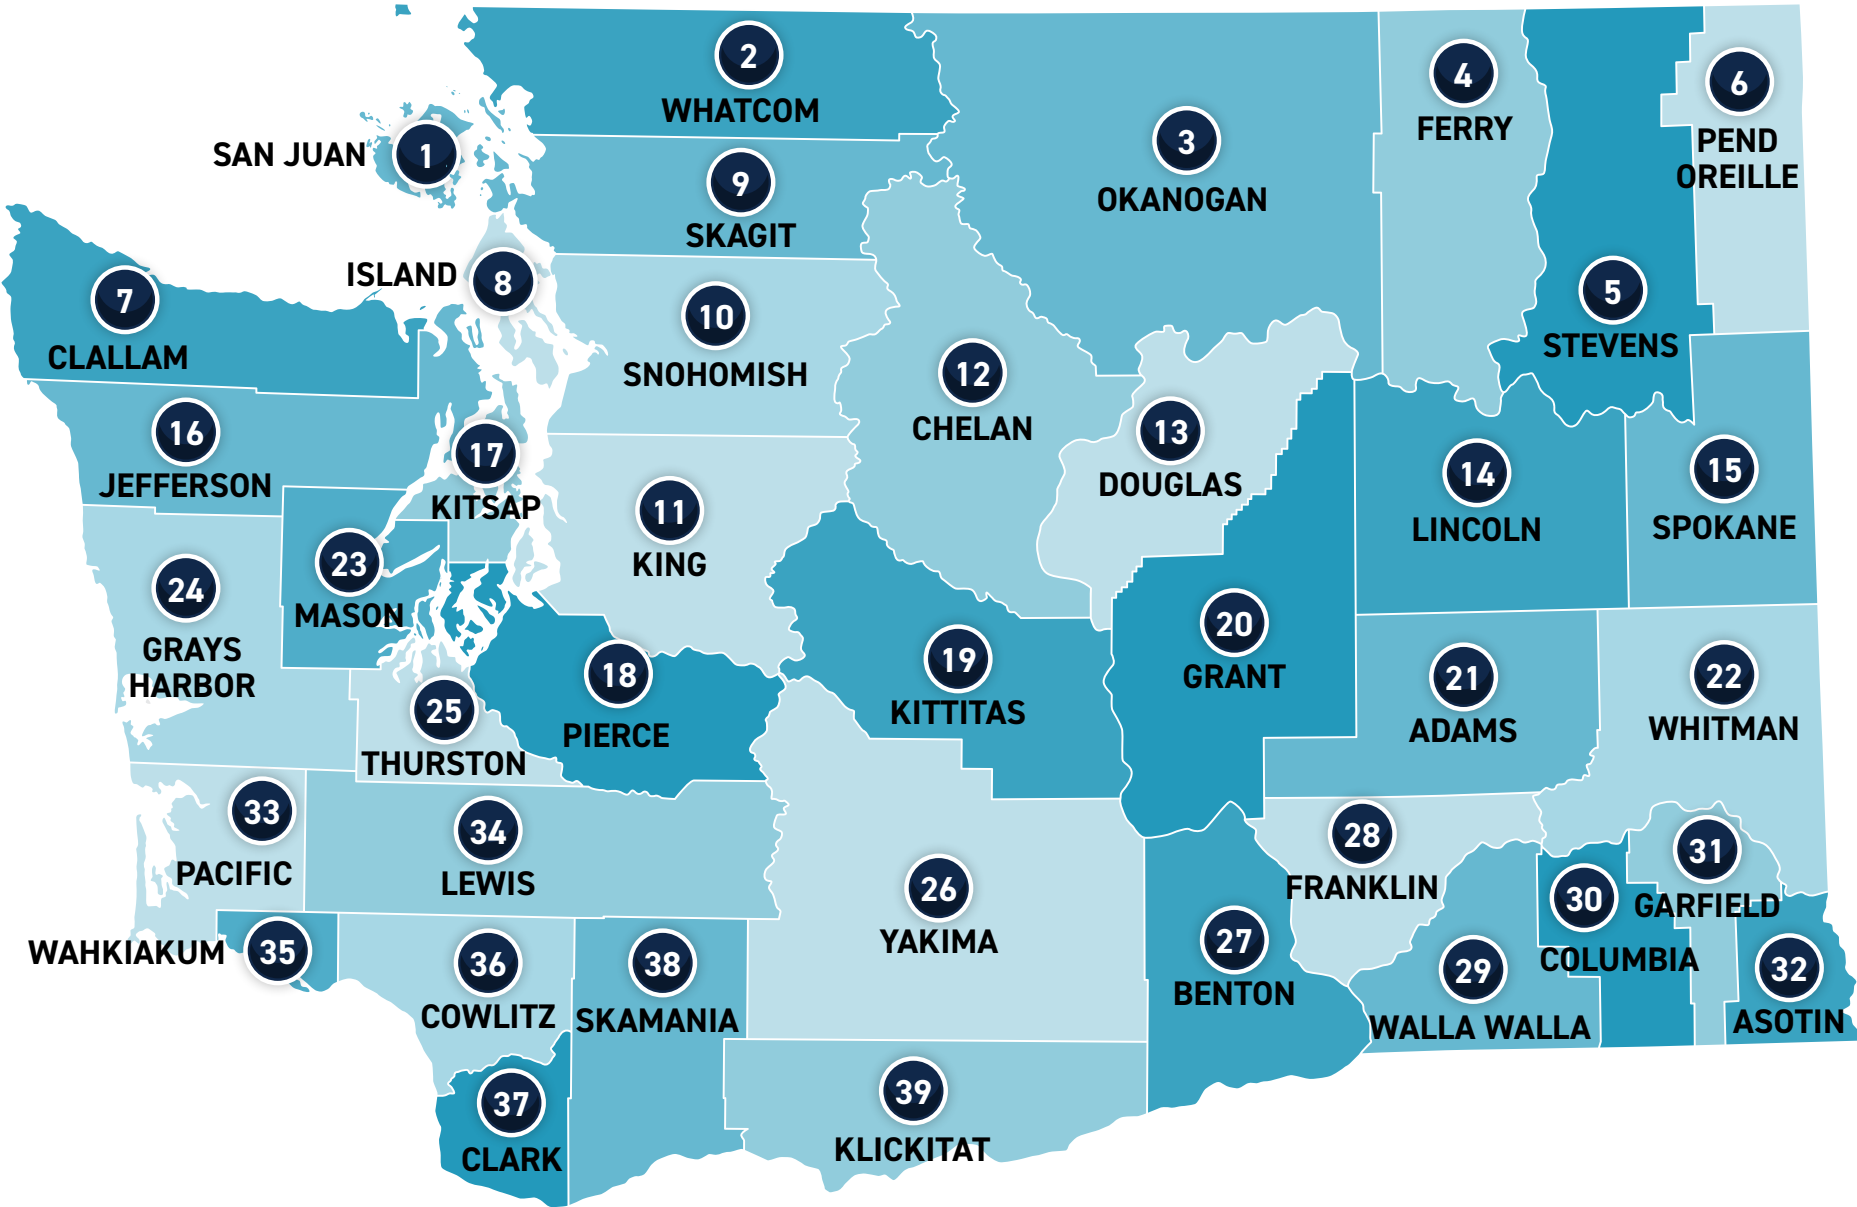

KITTITAS

Engineer
Russell Mau, PE
509-329-2116
russell.mau@doh.wa.gov

Planner
Hollis Staal
564-233-8707
hollis.staal@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

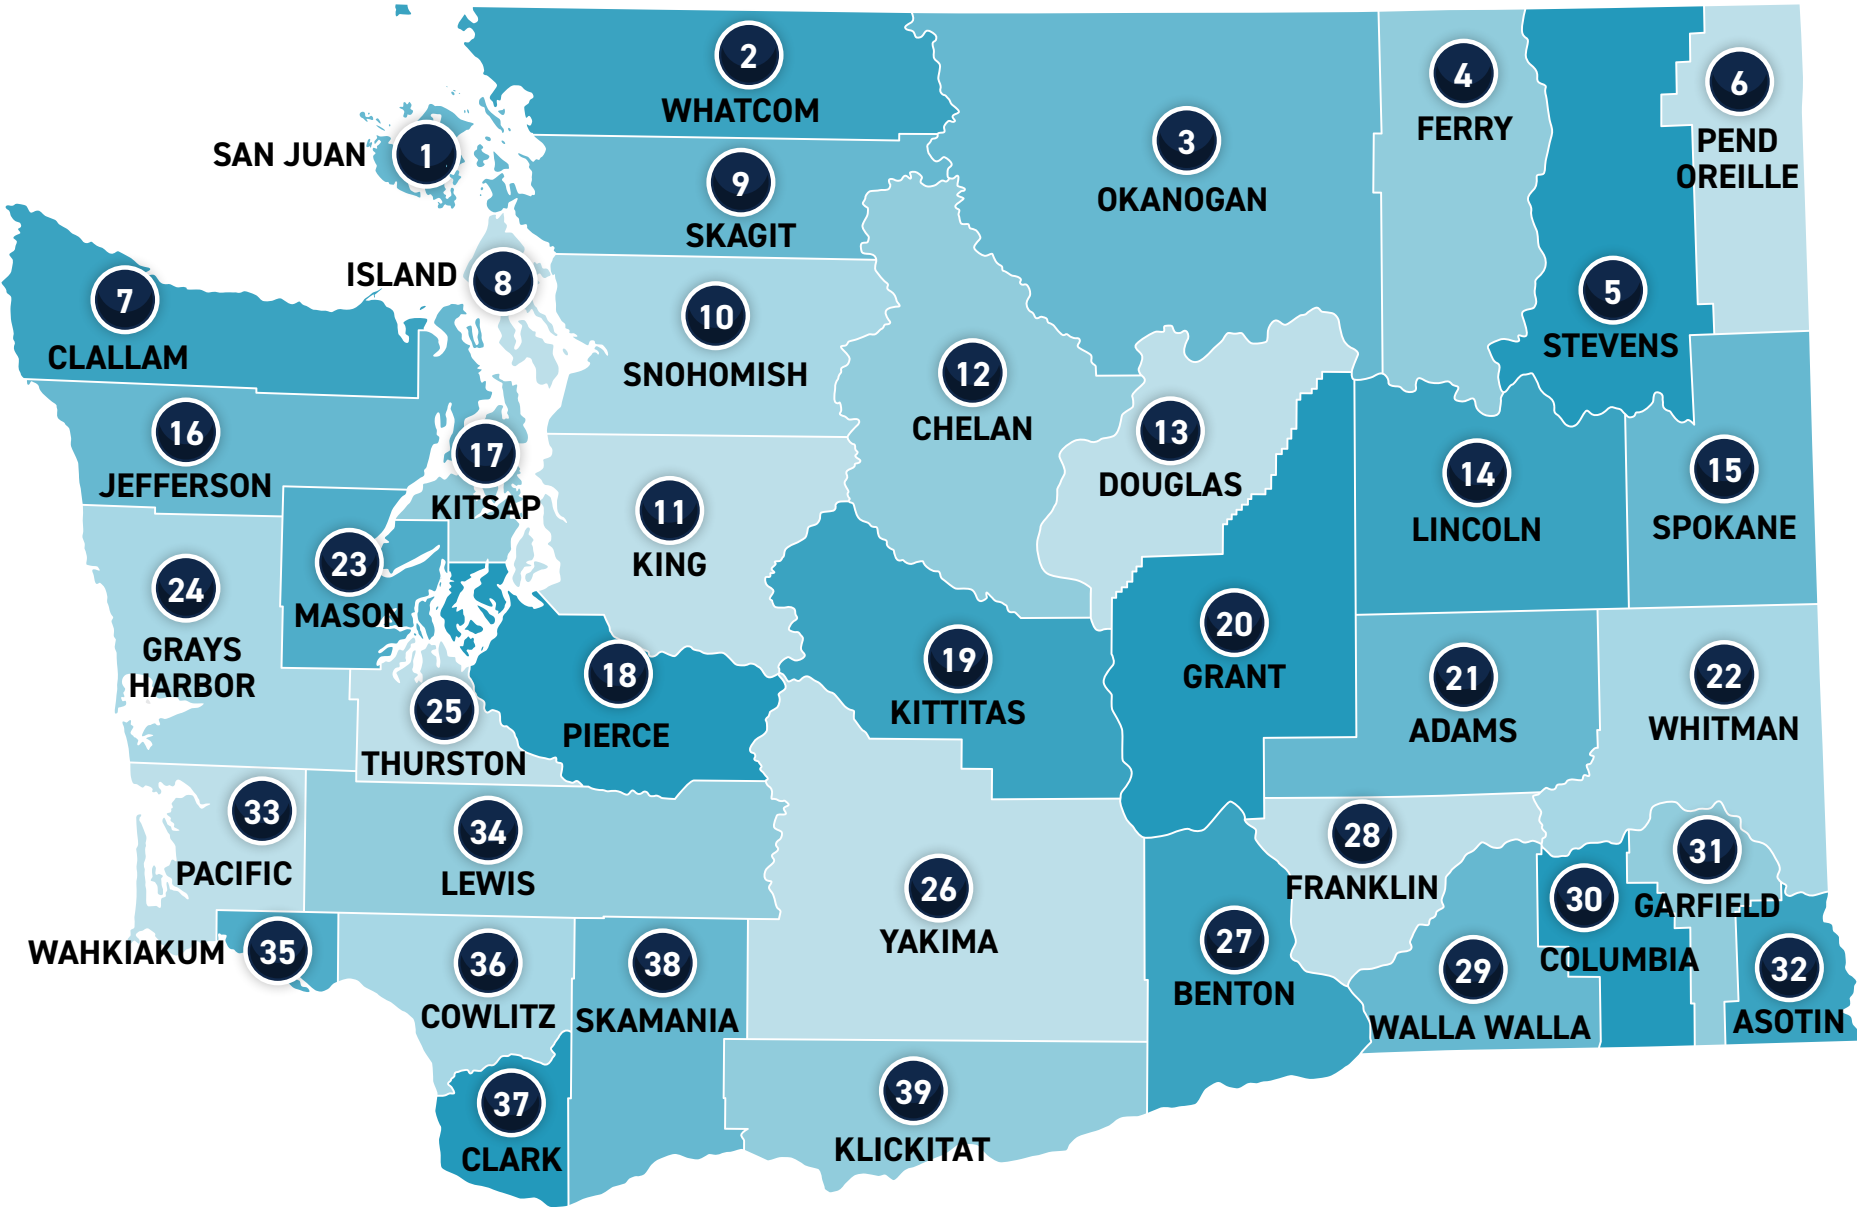

GRANT

Engineer
Russell Mau, PE
509-329-2116
russell.mau@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

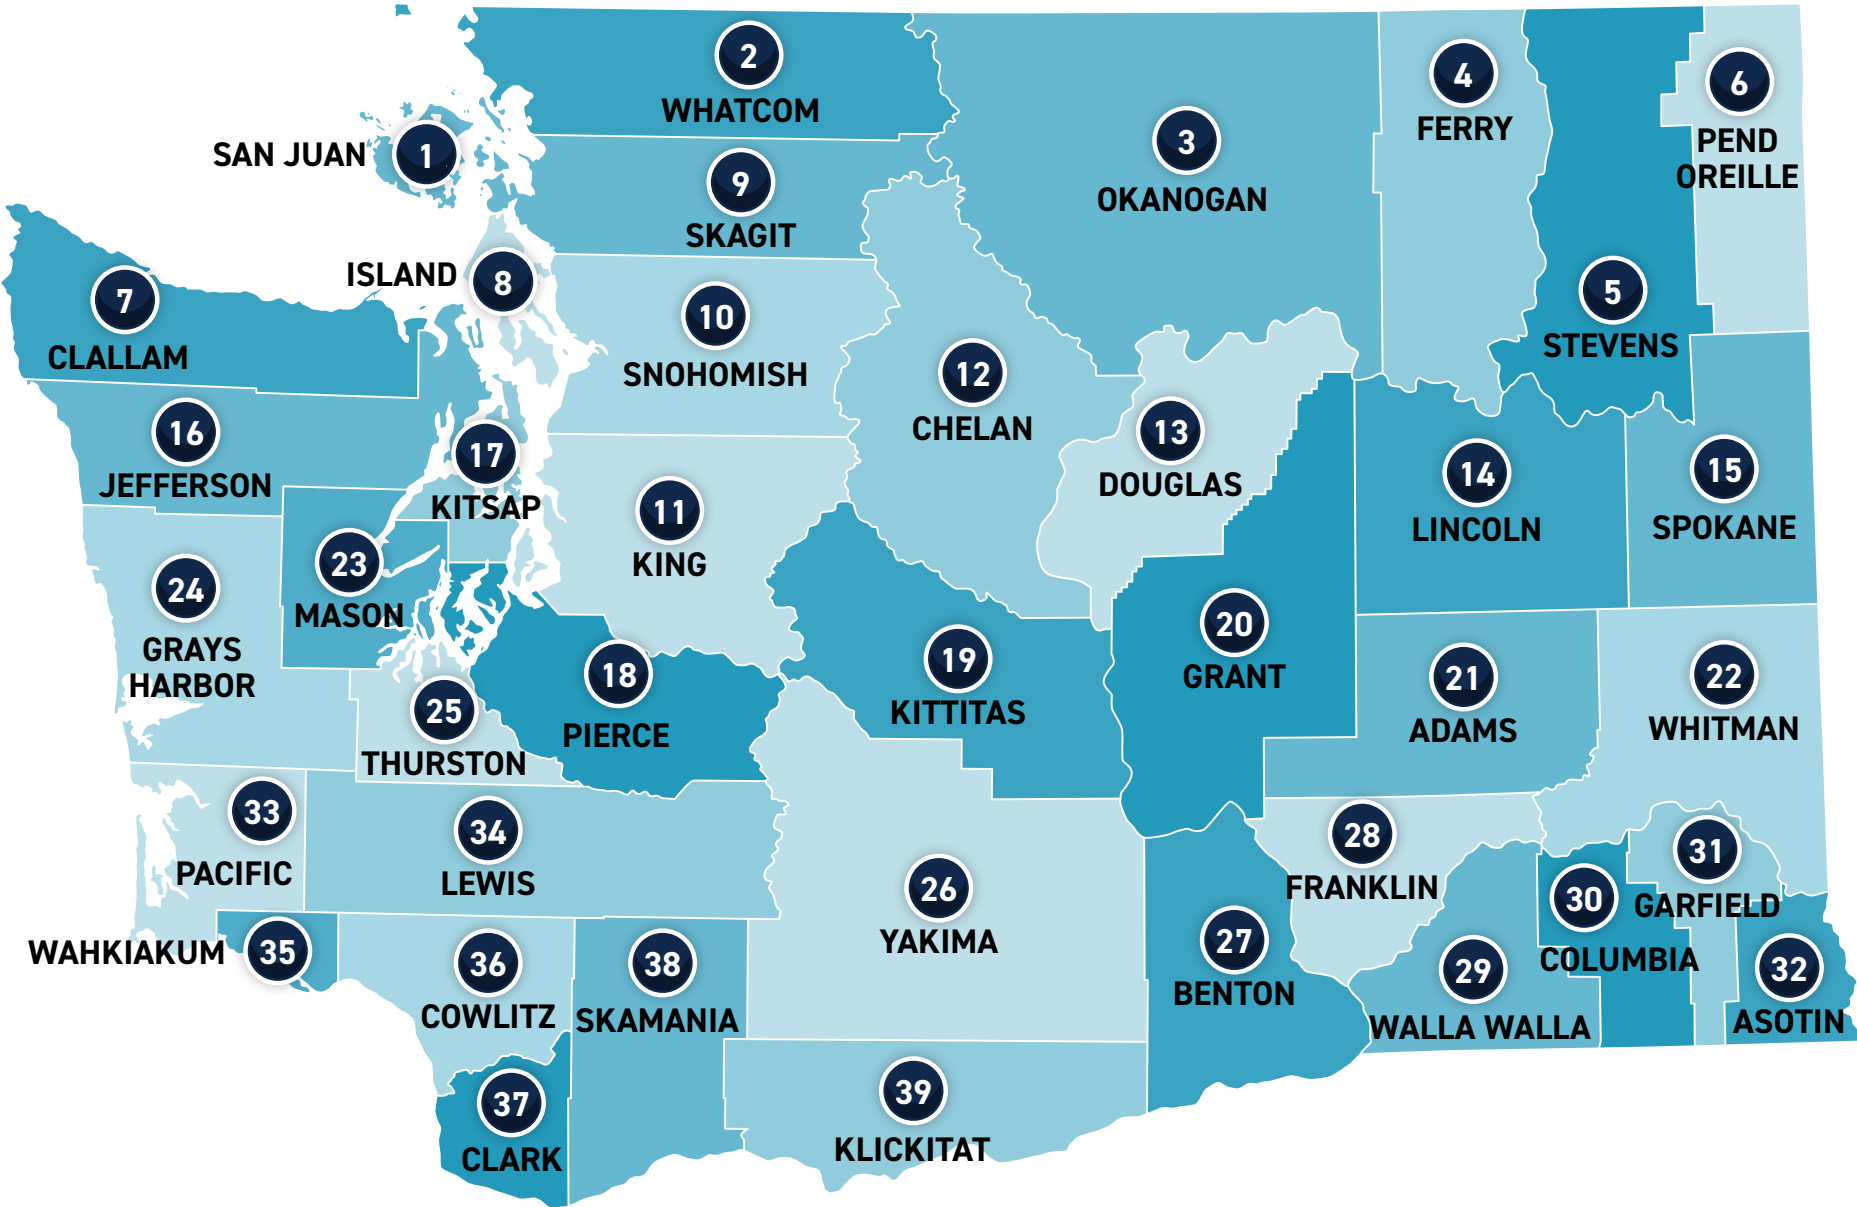

ADAMS

Engineer
Andy Cervantes, PE
509-329-2120
andres.cervantes@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

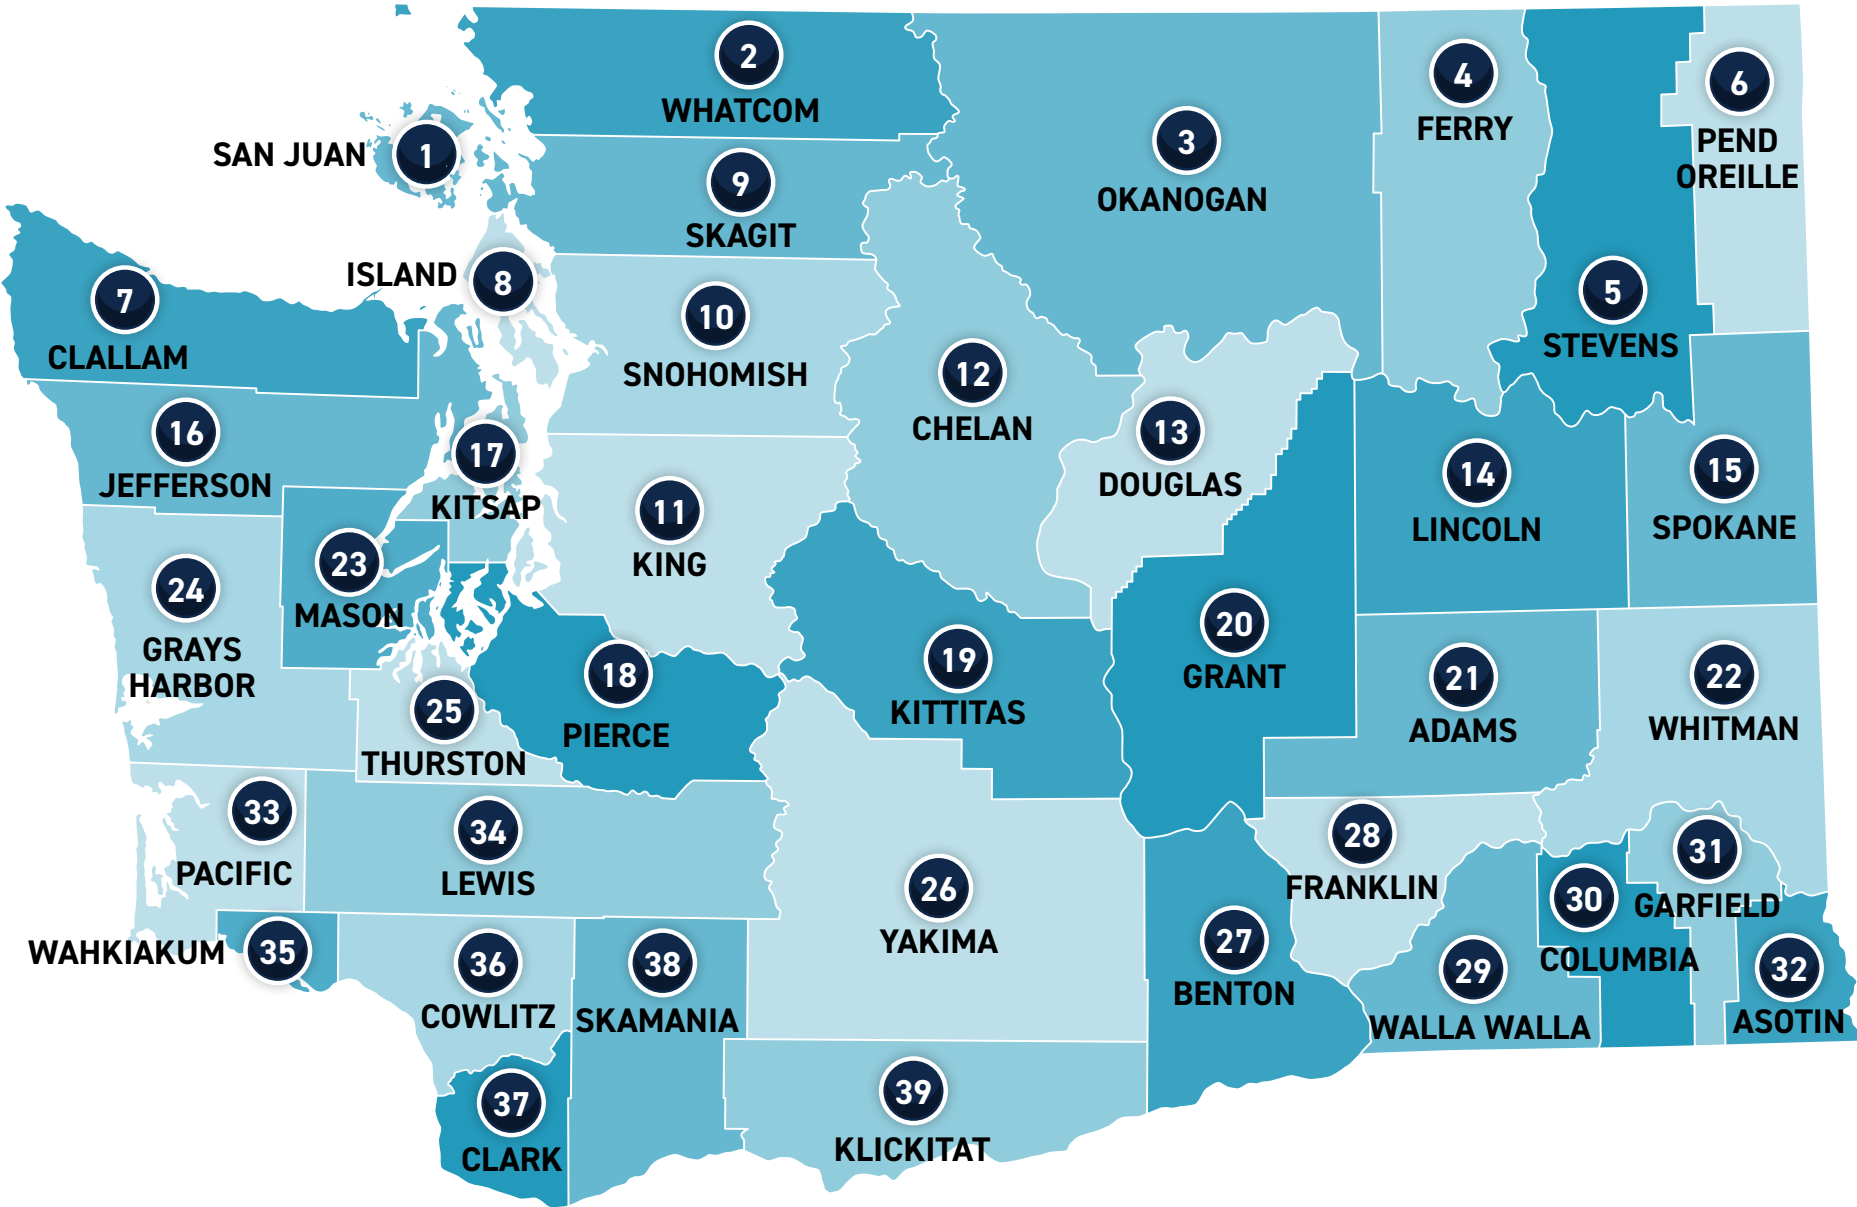

WHITMAN

Engineer
Andy Cervantes, PE
509-329-2120
andres.cervantes@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

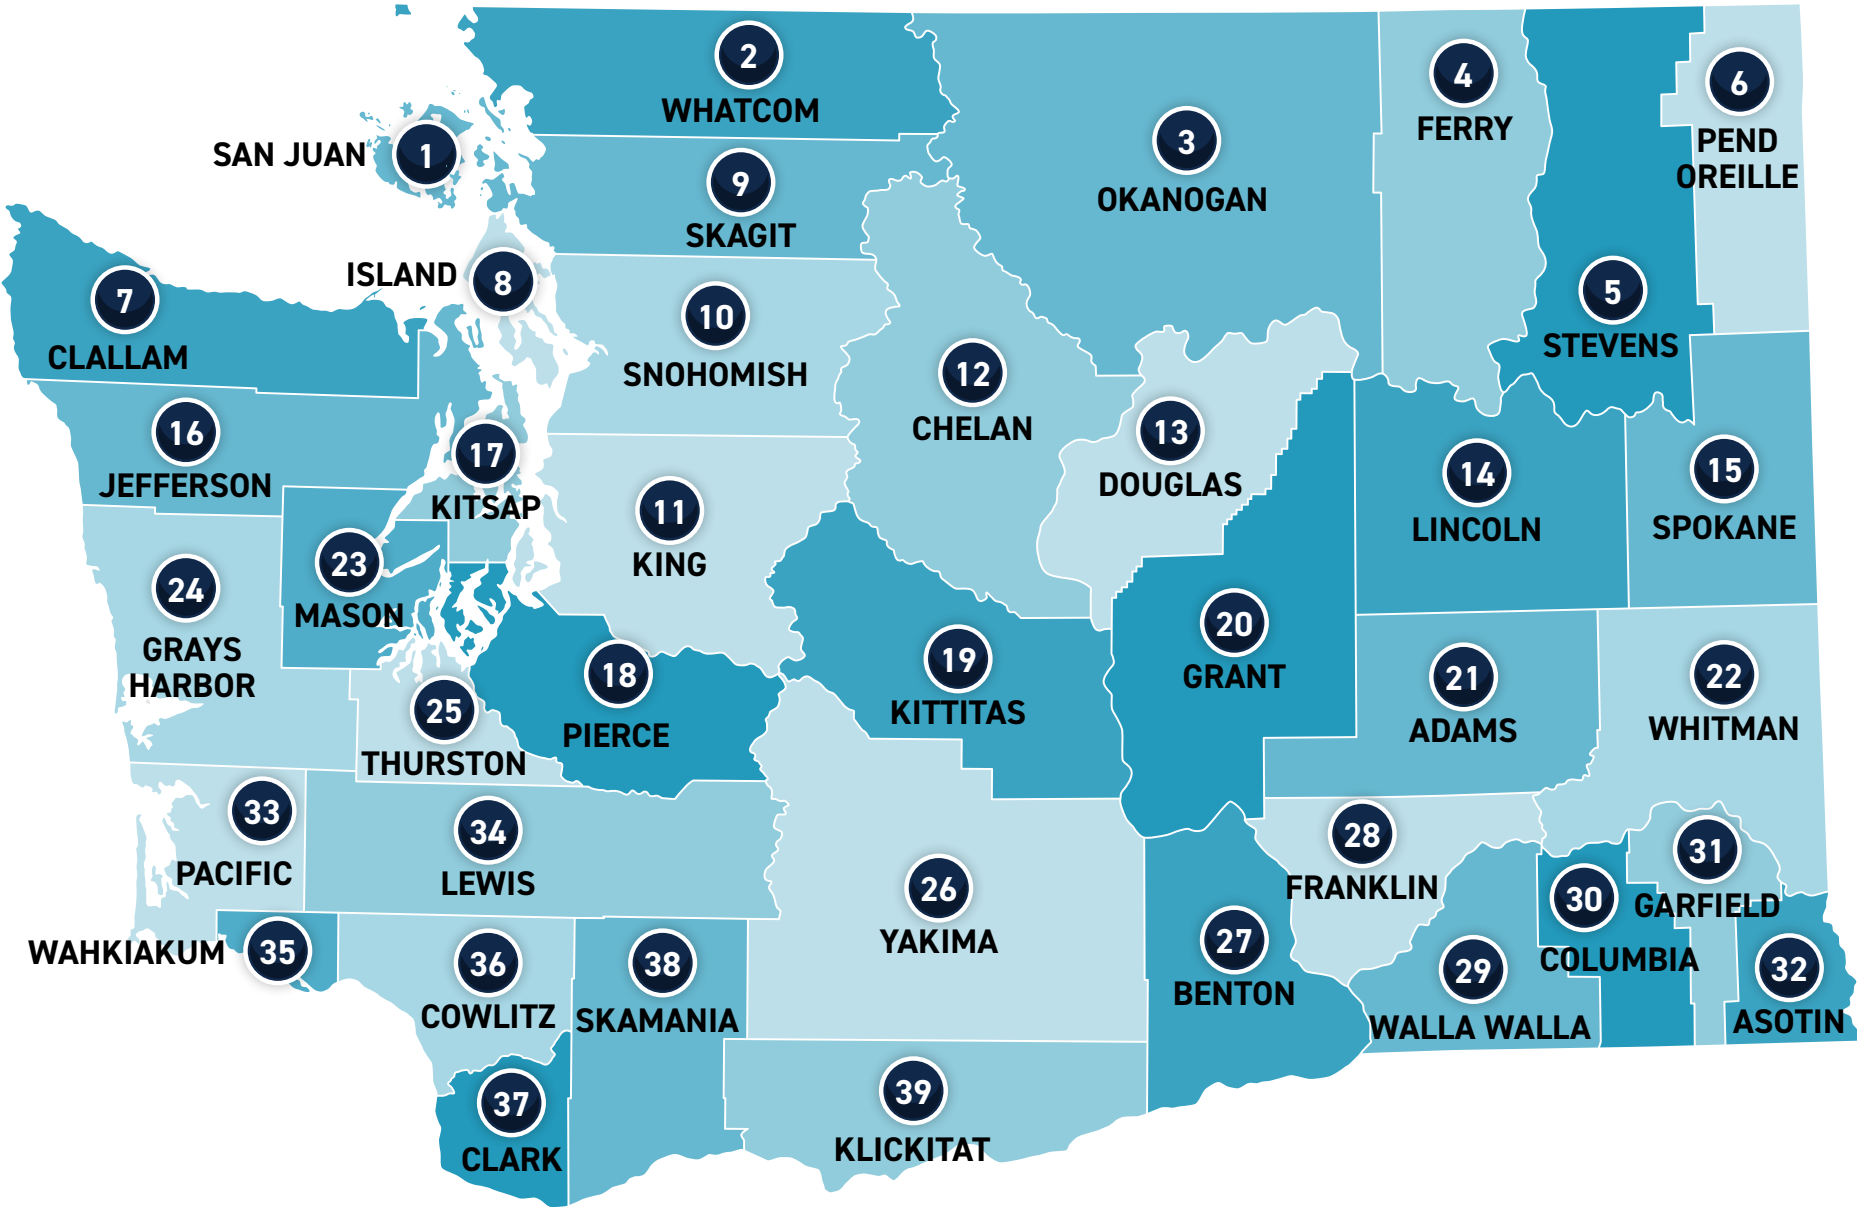

MASON

Engineer
Ryan Deem
360-628-7951
ryan.deem@doh.wa.gov


Planner
Benjamin Majors
564-669-0855
ben.majors@doh.wa.gov

Source Monitoring Staff
Sophia Petro
564-669-0856
sophia.petro@doh.wa.gov

Coliform Staff
Kacie Seyfert
564-669-0844
kacie.seyfert@doh.wa.gov

WFI & Disinfection Staff
Pi Kosarot (DBP & Surface Water Support)
564-669-3862
pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

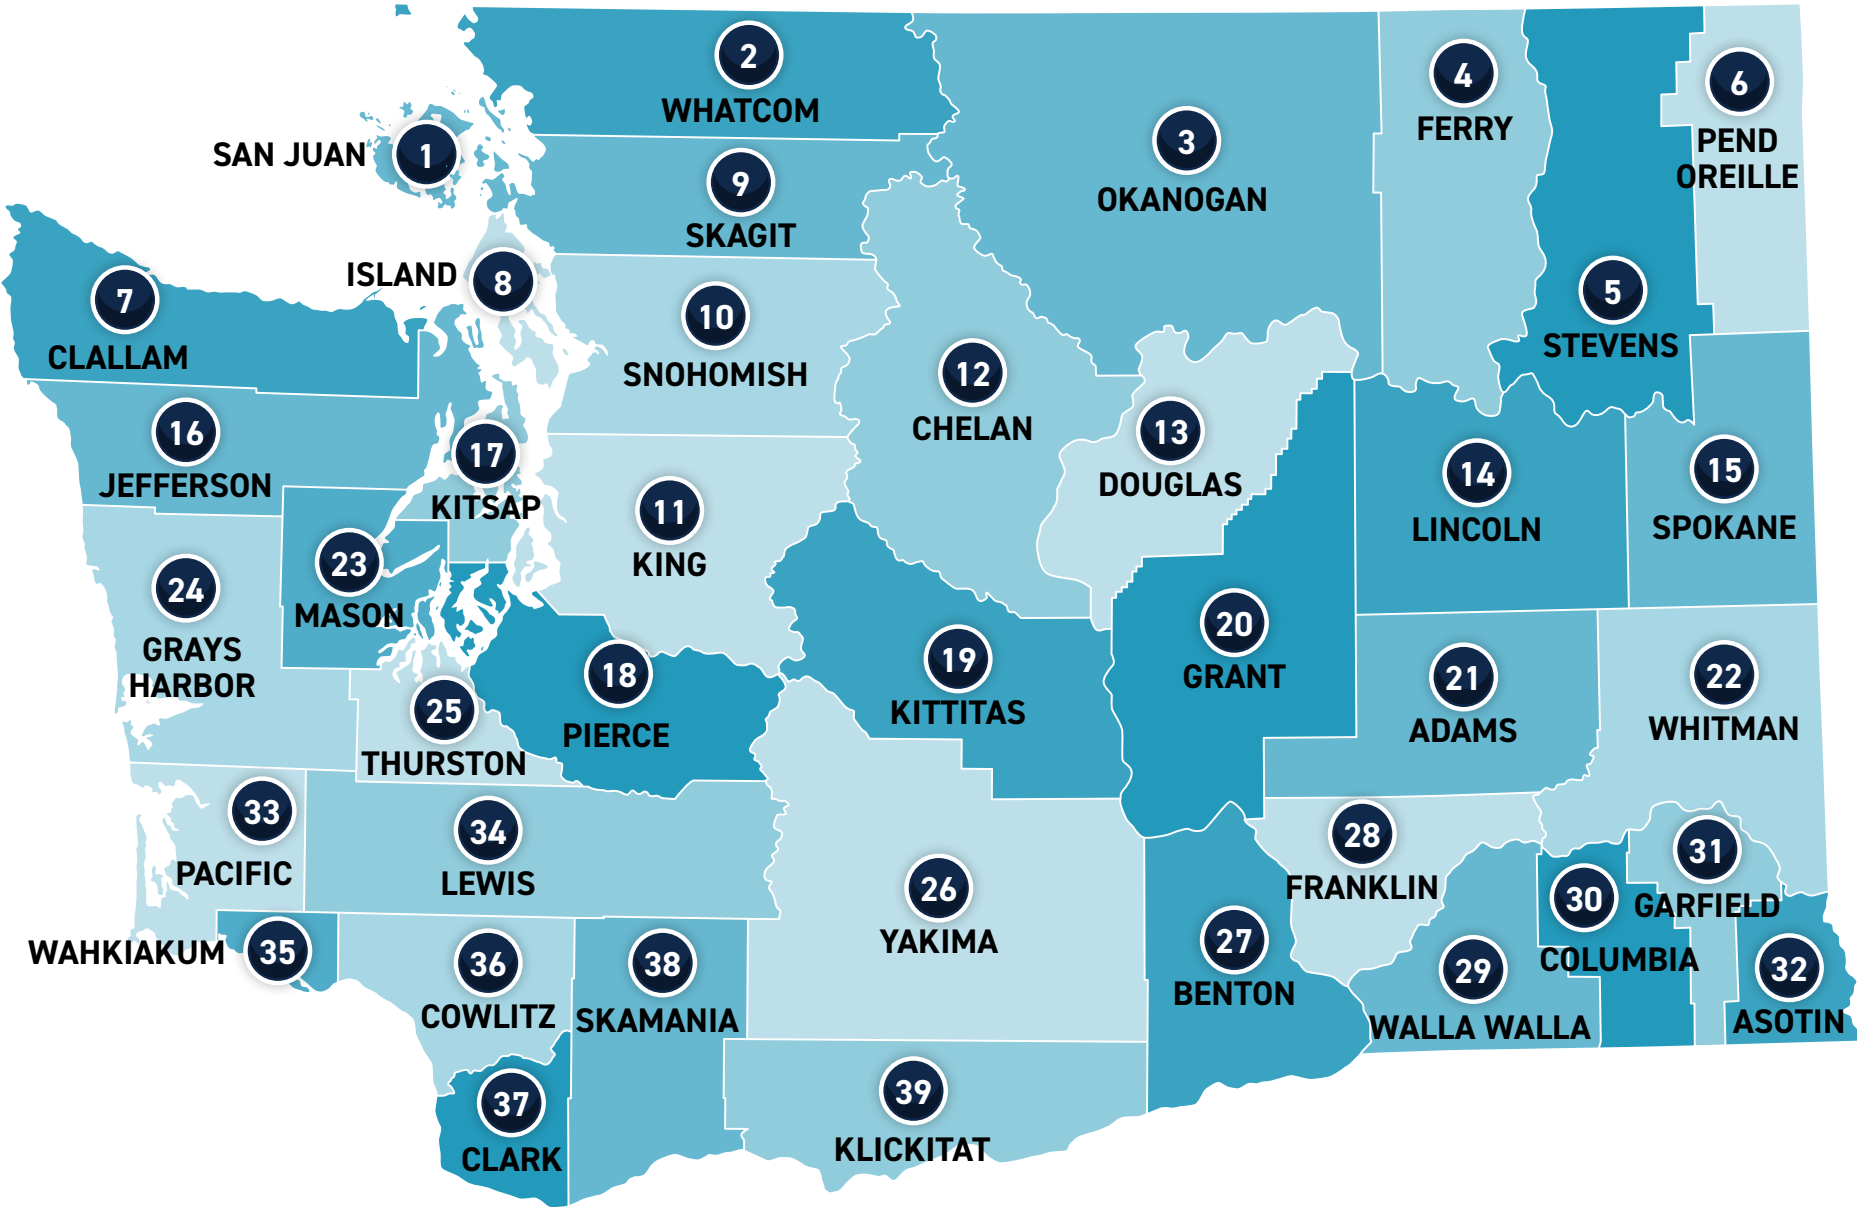

GRAYS HARBOR

Engineer

Phyo Kyaw

564-669-3849

phyo.kyaw@doh.wa.gov

Planner

Meredith Jones

564-233-1394

meredith.jones@doh.wa.gov

Source Monitoring Staff

Sophia Petro

564-669-0856

sophia.petro@doh.wa.gov

Coliform Staff

Kacie Seyfert

564-669-0844

kacie.seyfert@doh.wa.gov


WFI & Disinfection Staff

Pi Kosarot (DBP & Surface Water Support)

564-669-3862

pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

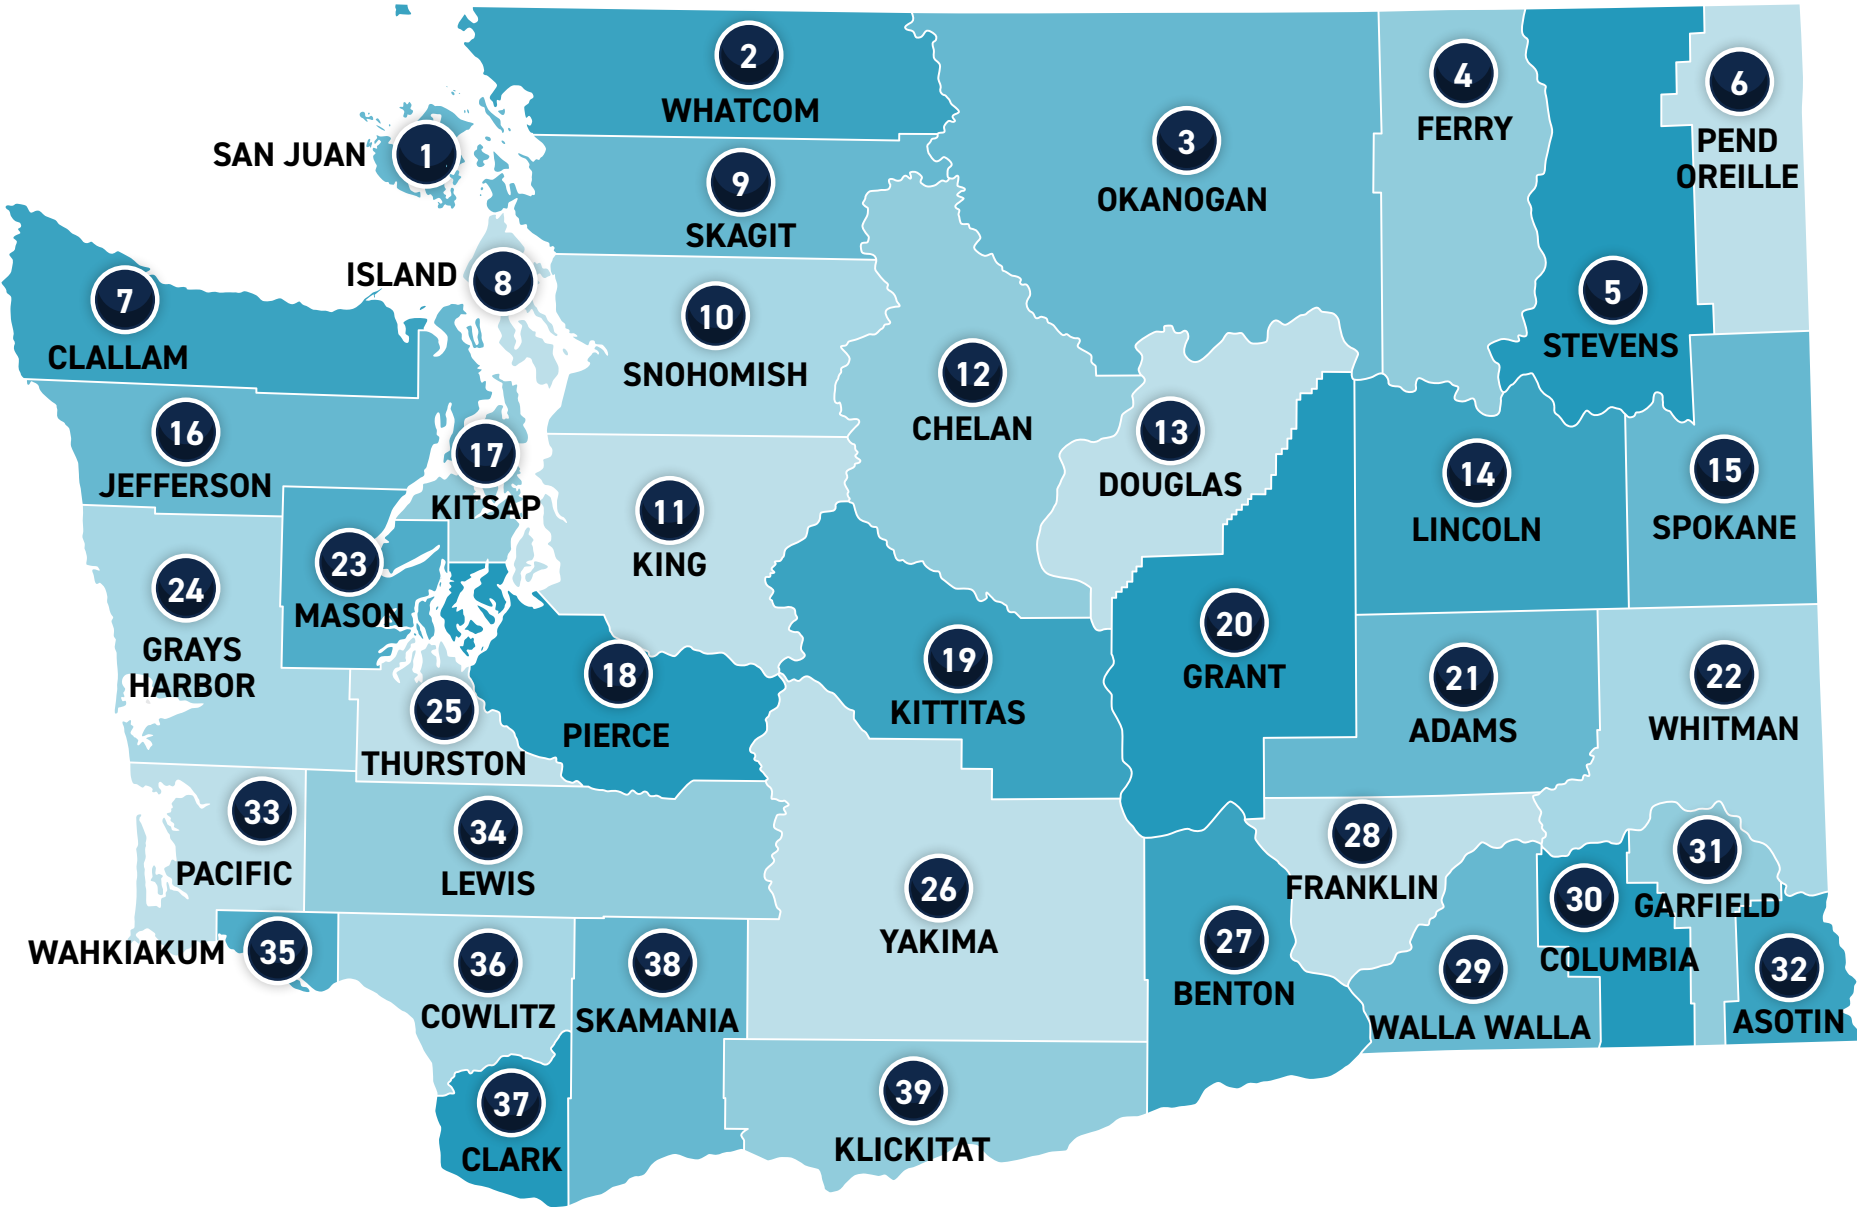

THURSTON

Engineer
Aasya Abdenmour
564-669-9792
aasya.abdenmour@doh.wa.gov

Candida Granillo-Dodds, PE
(Cities of Olympia, Lacey, & Tumwater only)
564-669-3170
candida.granillo-dodds@doh.wa.gov


Planner
Meredith Jones
564-233-1394
meredith.jones@doh.wa.gov

Source Monitoring Staff
Sophia Petro
564-669-0856
sophia.petro@doh.wa.gov

Coliform Staff
Kacie Seyfert
564-669-0844
kacie.seyfert@doh.wa.gov

WFI & Disinfection Staff
Pi Kosarot (DBP & Surface Water Support)
564-669-3862
pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

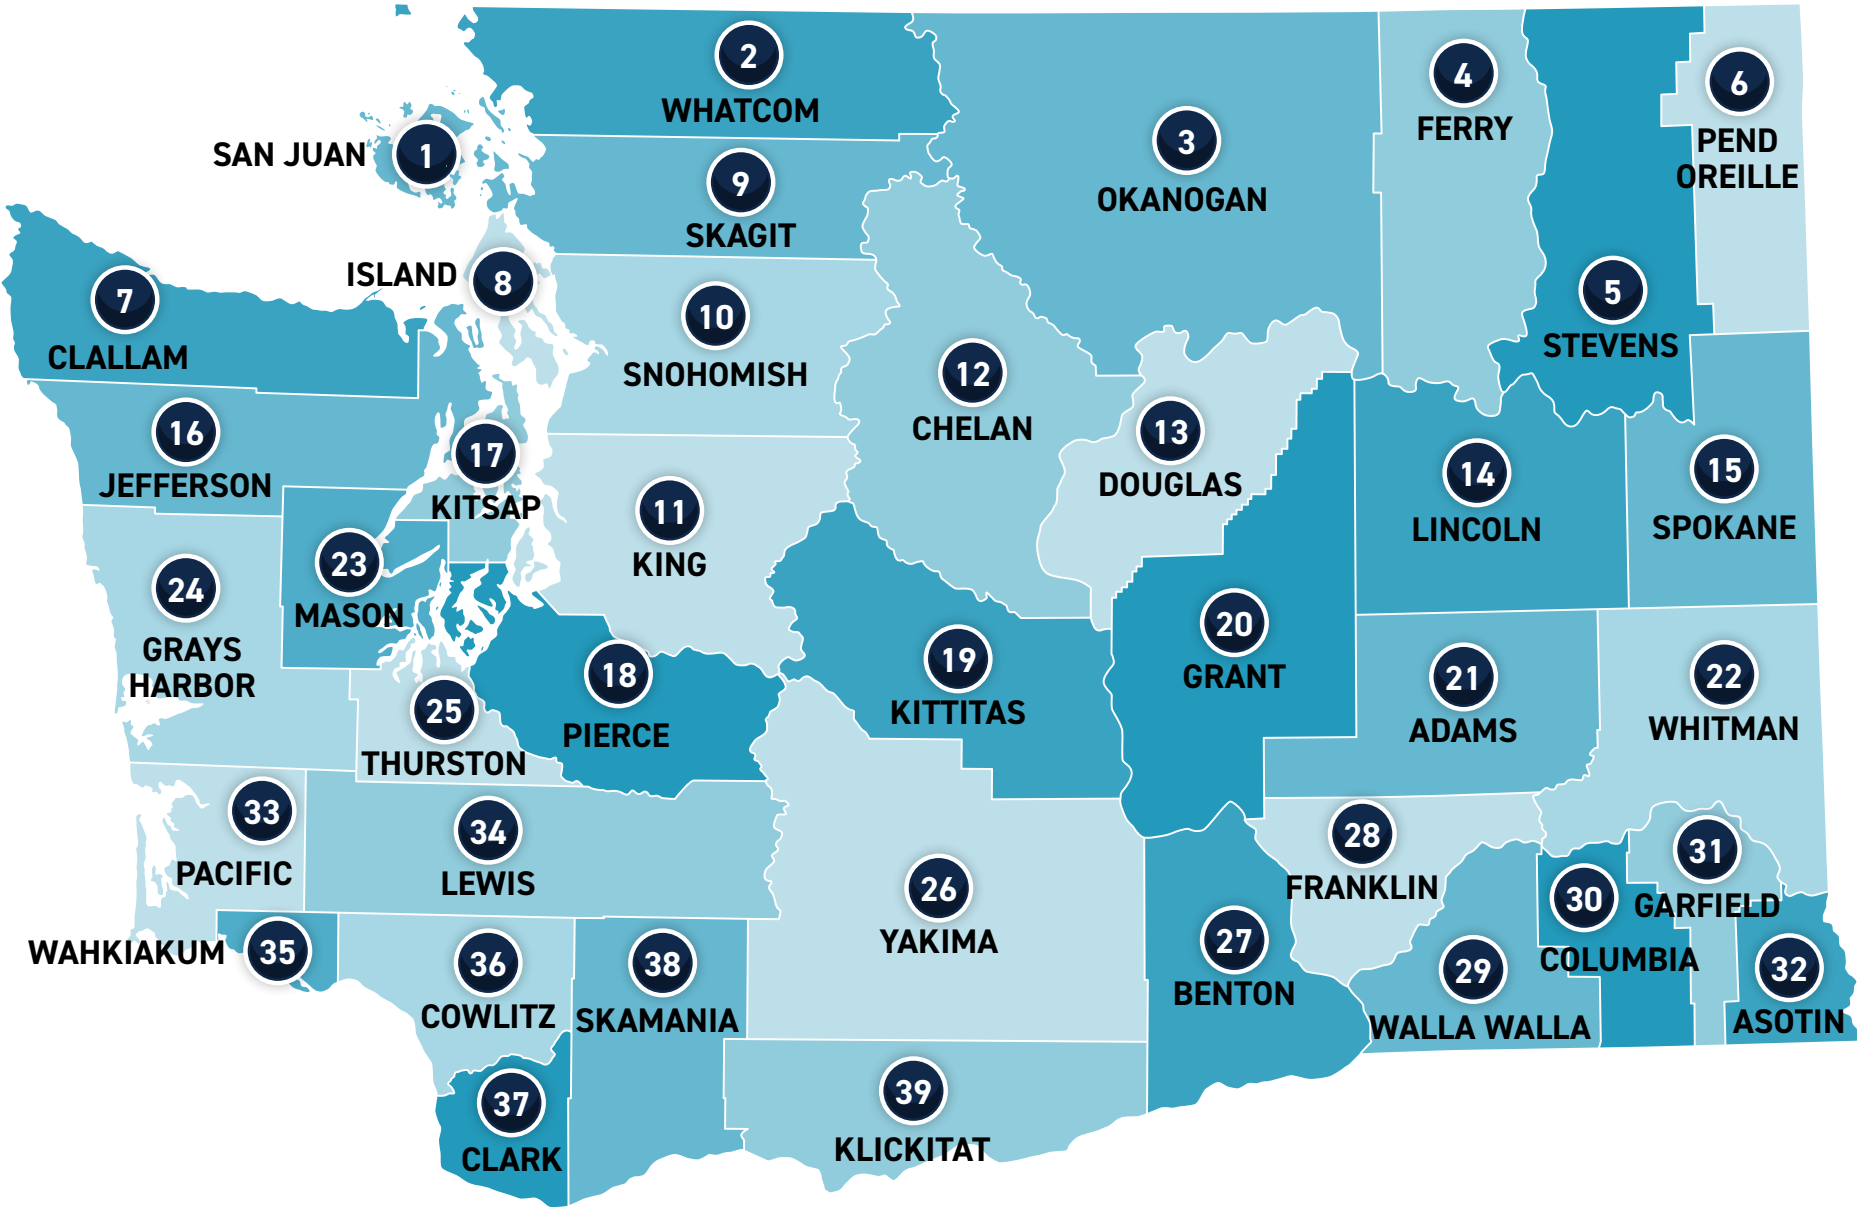

YAKIMA

Engineer
Andy Cervantes, PE
509-329-2120
andres.cervantes@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

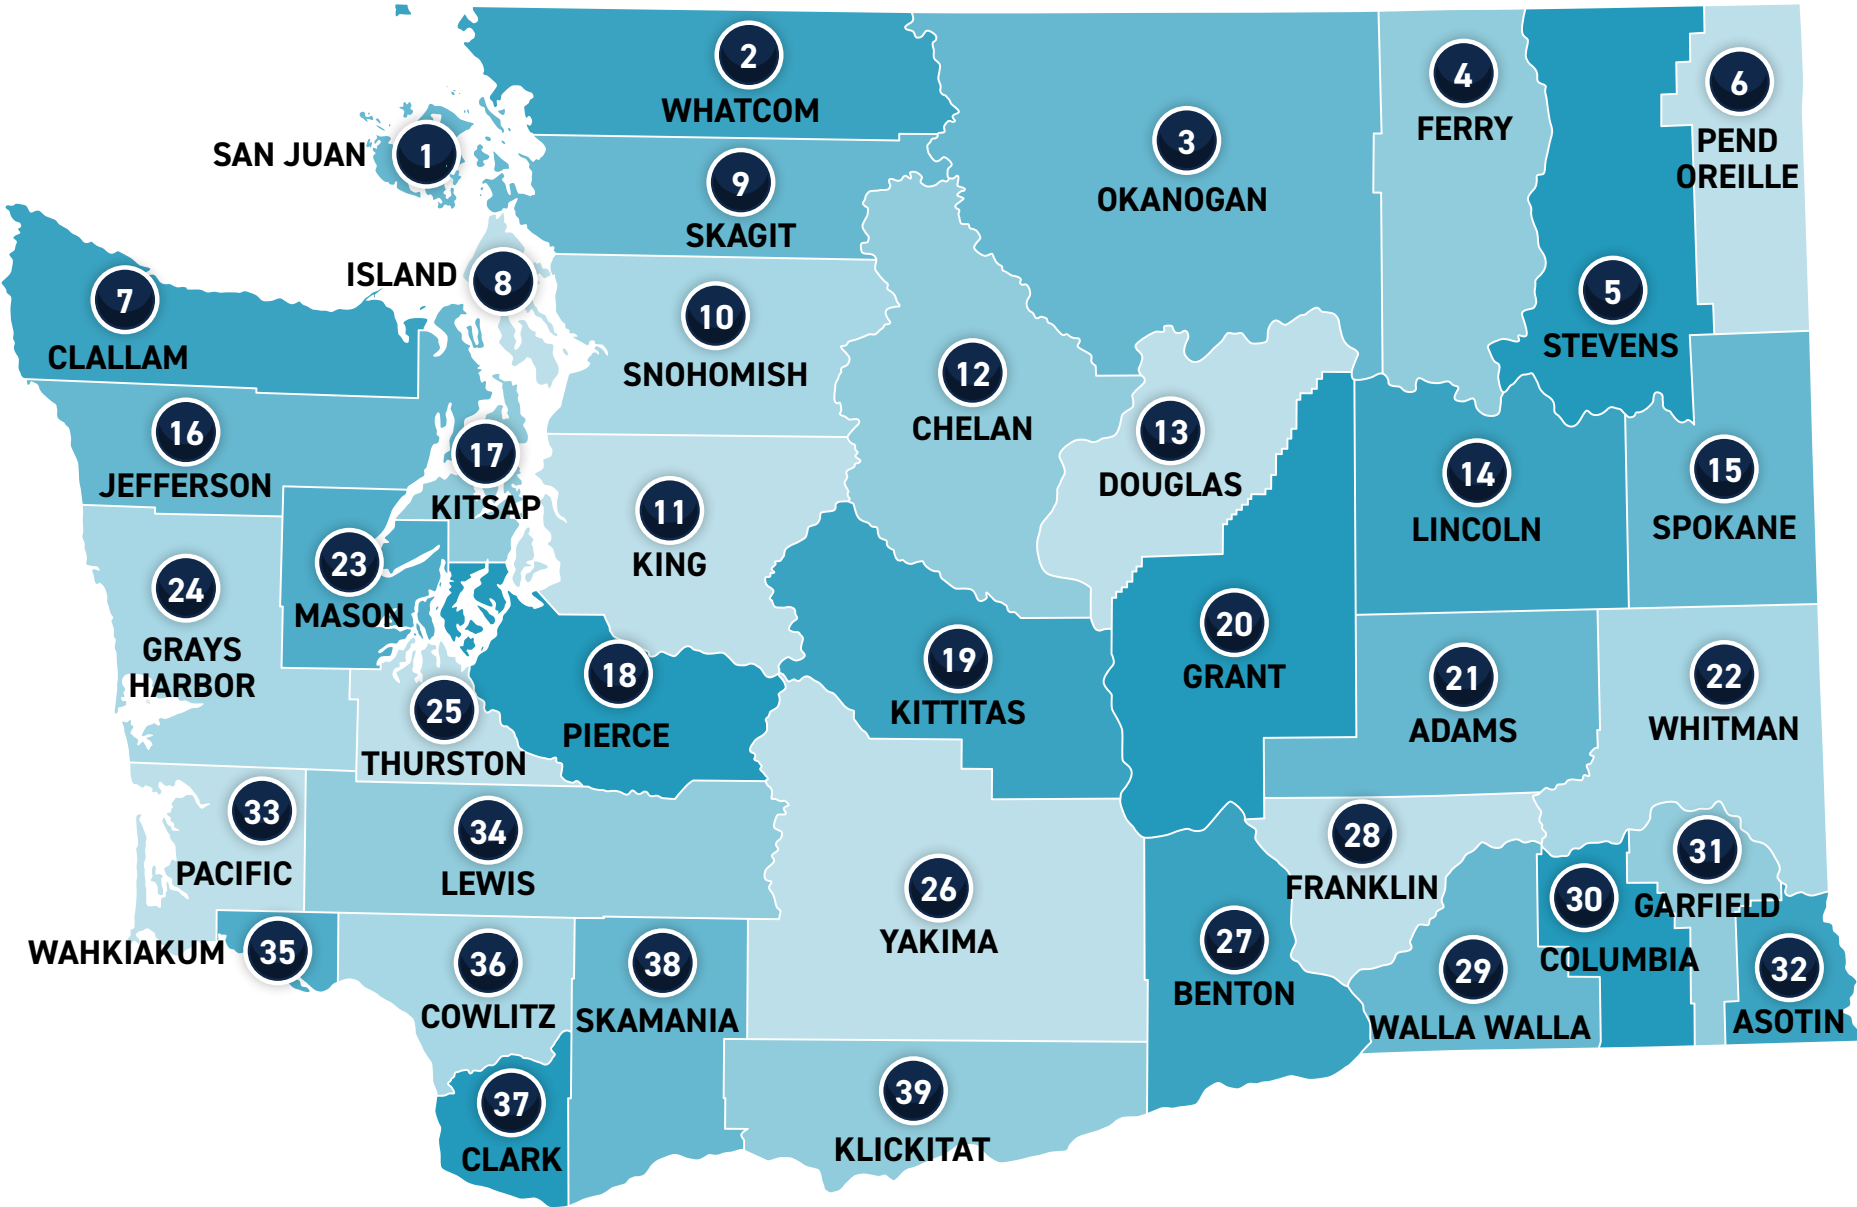

BENTON

Engineer
Lupe Gonzalez
509-329-2147
lupe.gonzalez@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

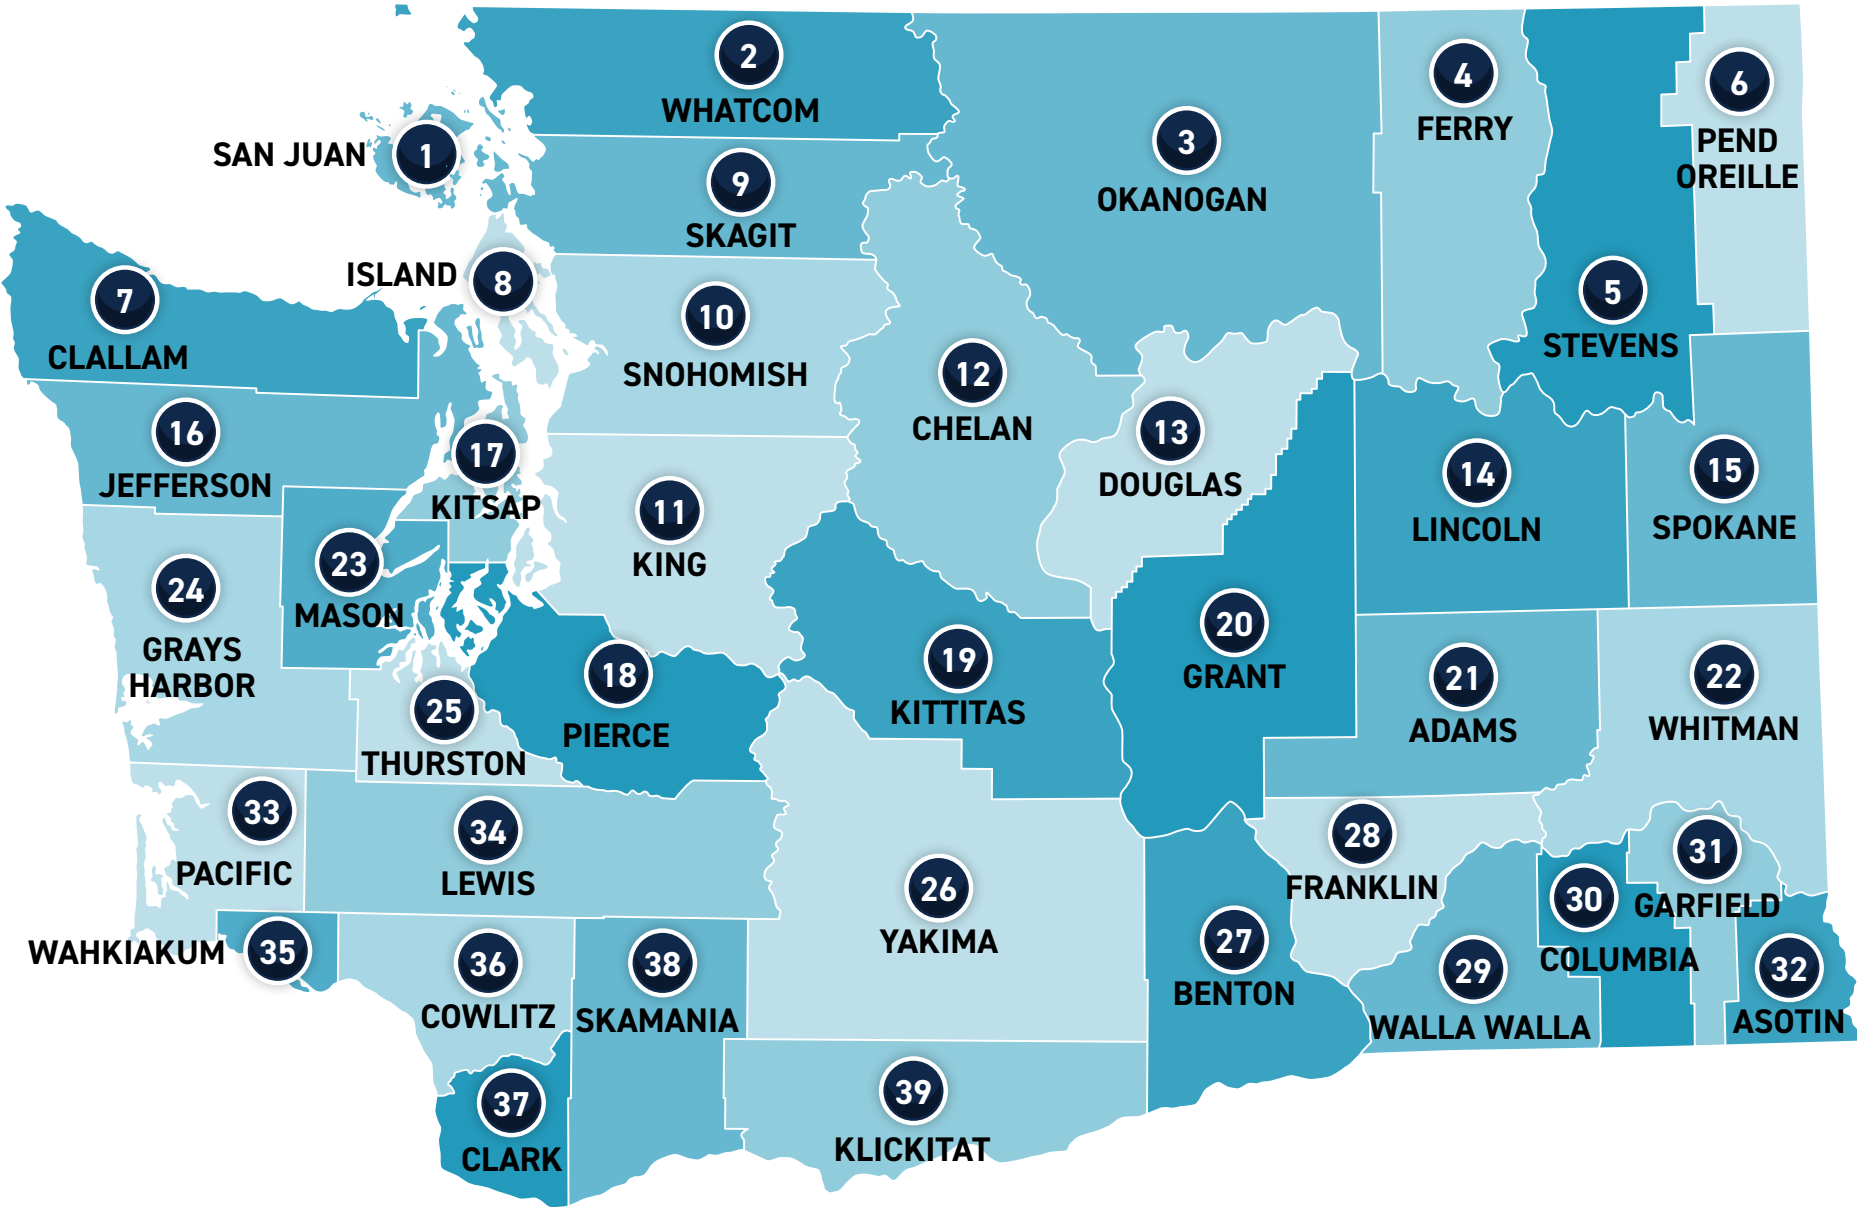

FRANKLIN

Engineer
Lupe Gonzalez
509-329-2147
lupe.gonzalez@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

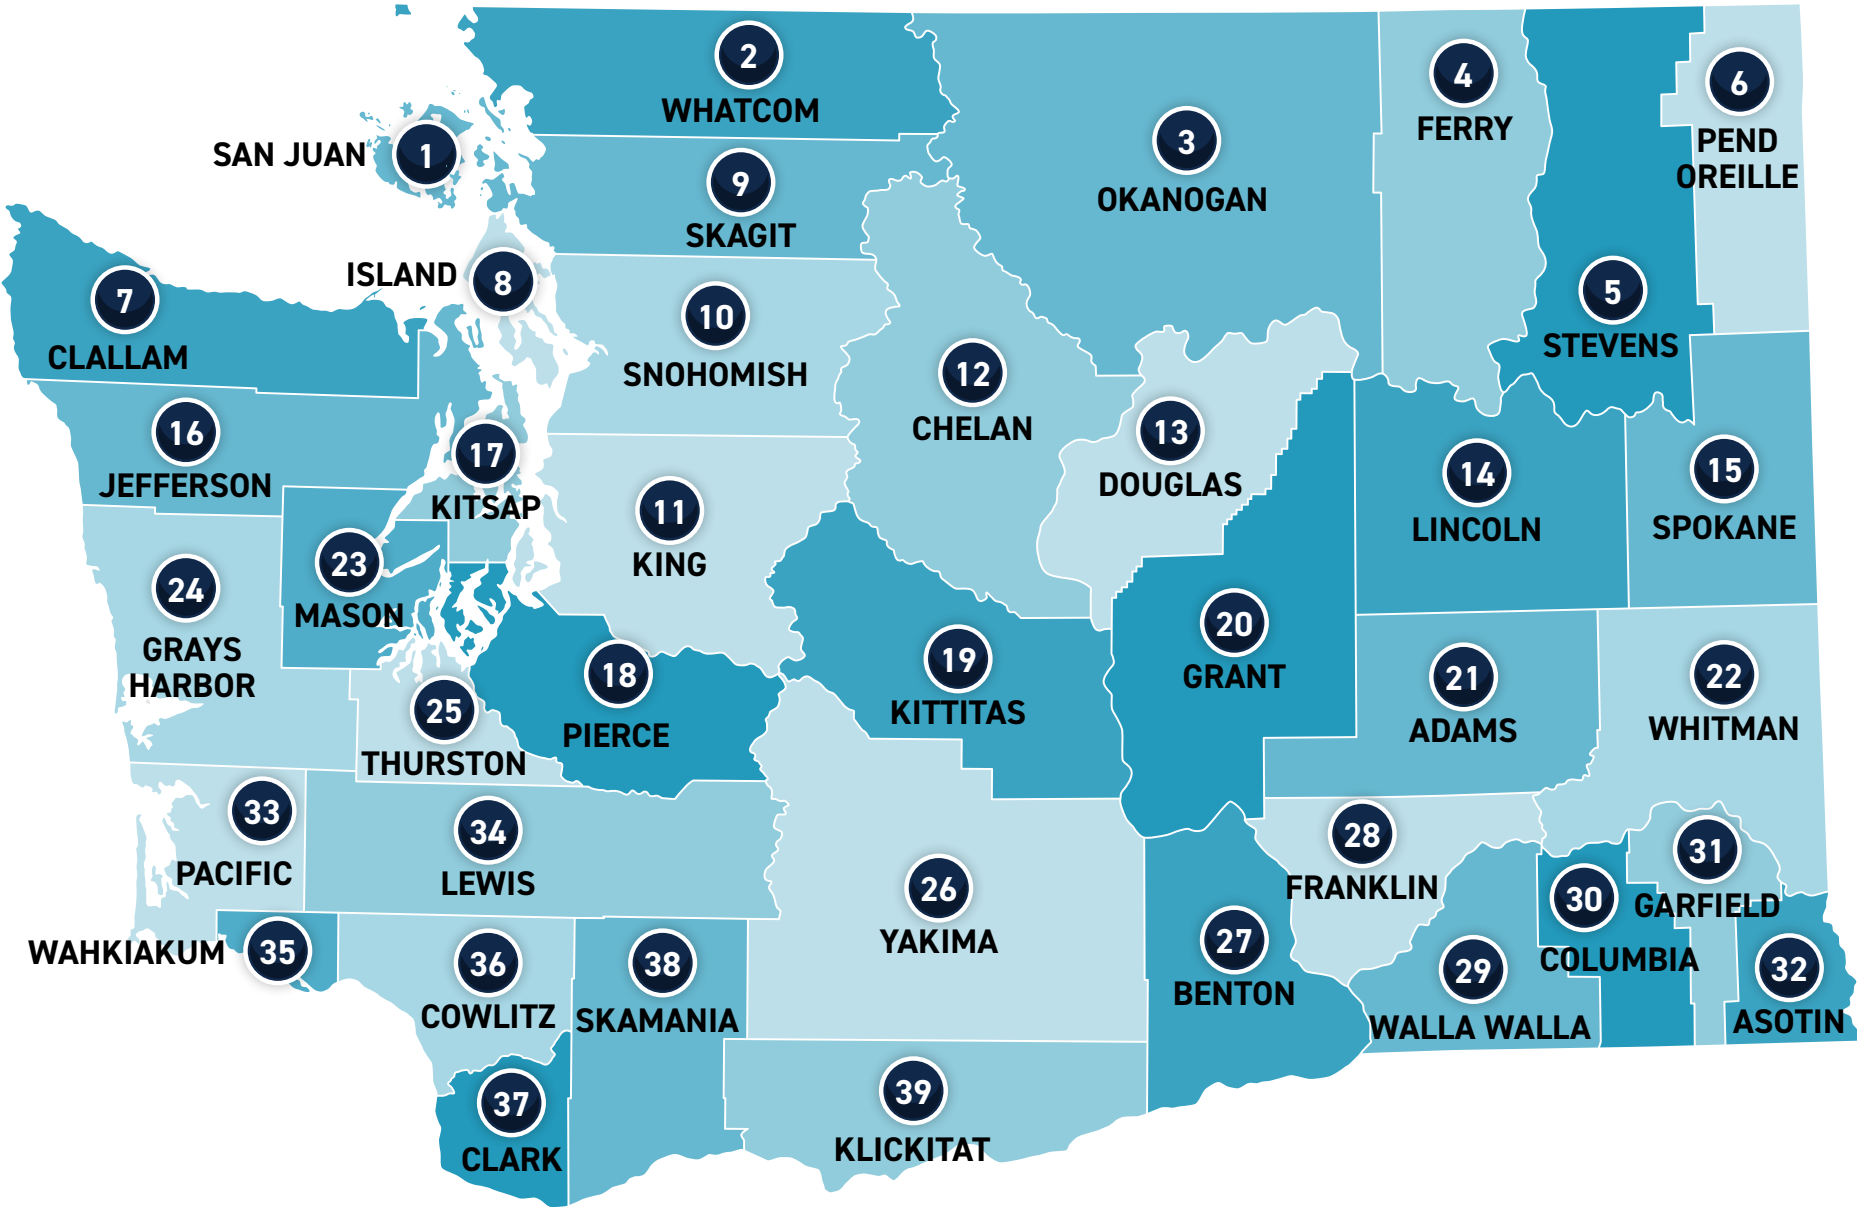

WALLA WALLA

Engineer

Lupe Gonzalez

509-329-2147

lupe.gonzalez@doh.wa.gov

Planner

Jamie Clark

564-669-3893

jamie.clark@doh.wa.gov

Source Monitoring Staff

Ashly Beebe

(Lead & Copper and Nitrate only) 564-669-4112

ashly.beebe@doh.wa.gov

Anna Duron

509-507-0504

anna.duron@doh.wa.gov

Coliform Staff

Vacant

ero.coli@doh.wa.gov


WFI & Disinfection Staff

Kelsey Russell

509-507-0584

kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

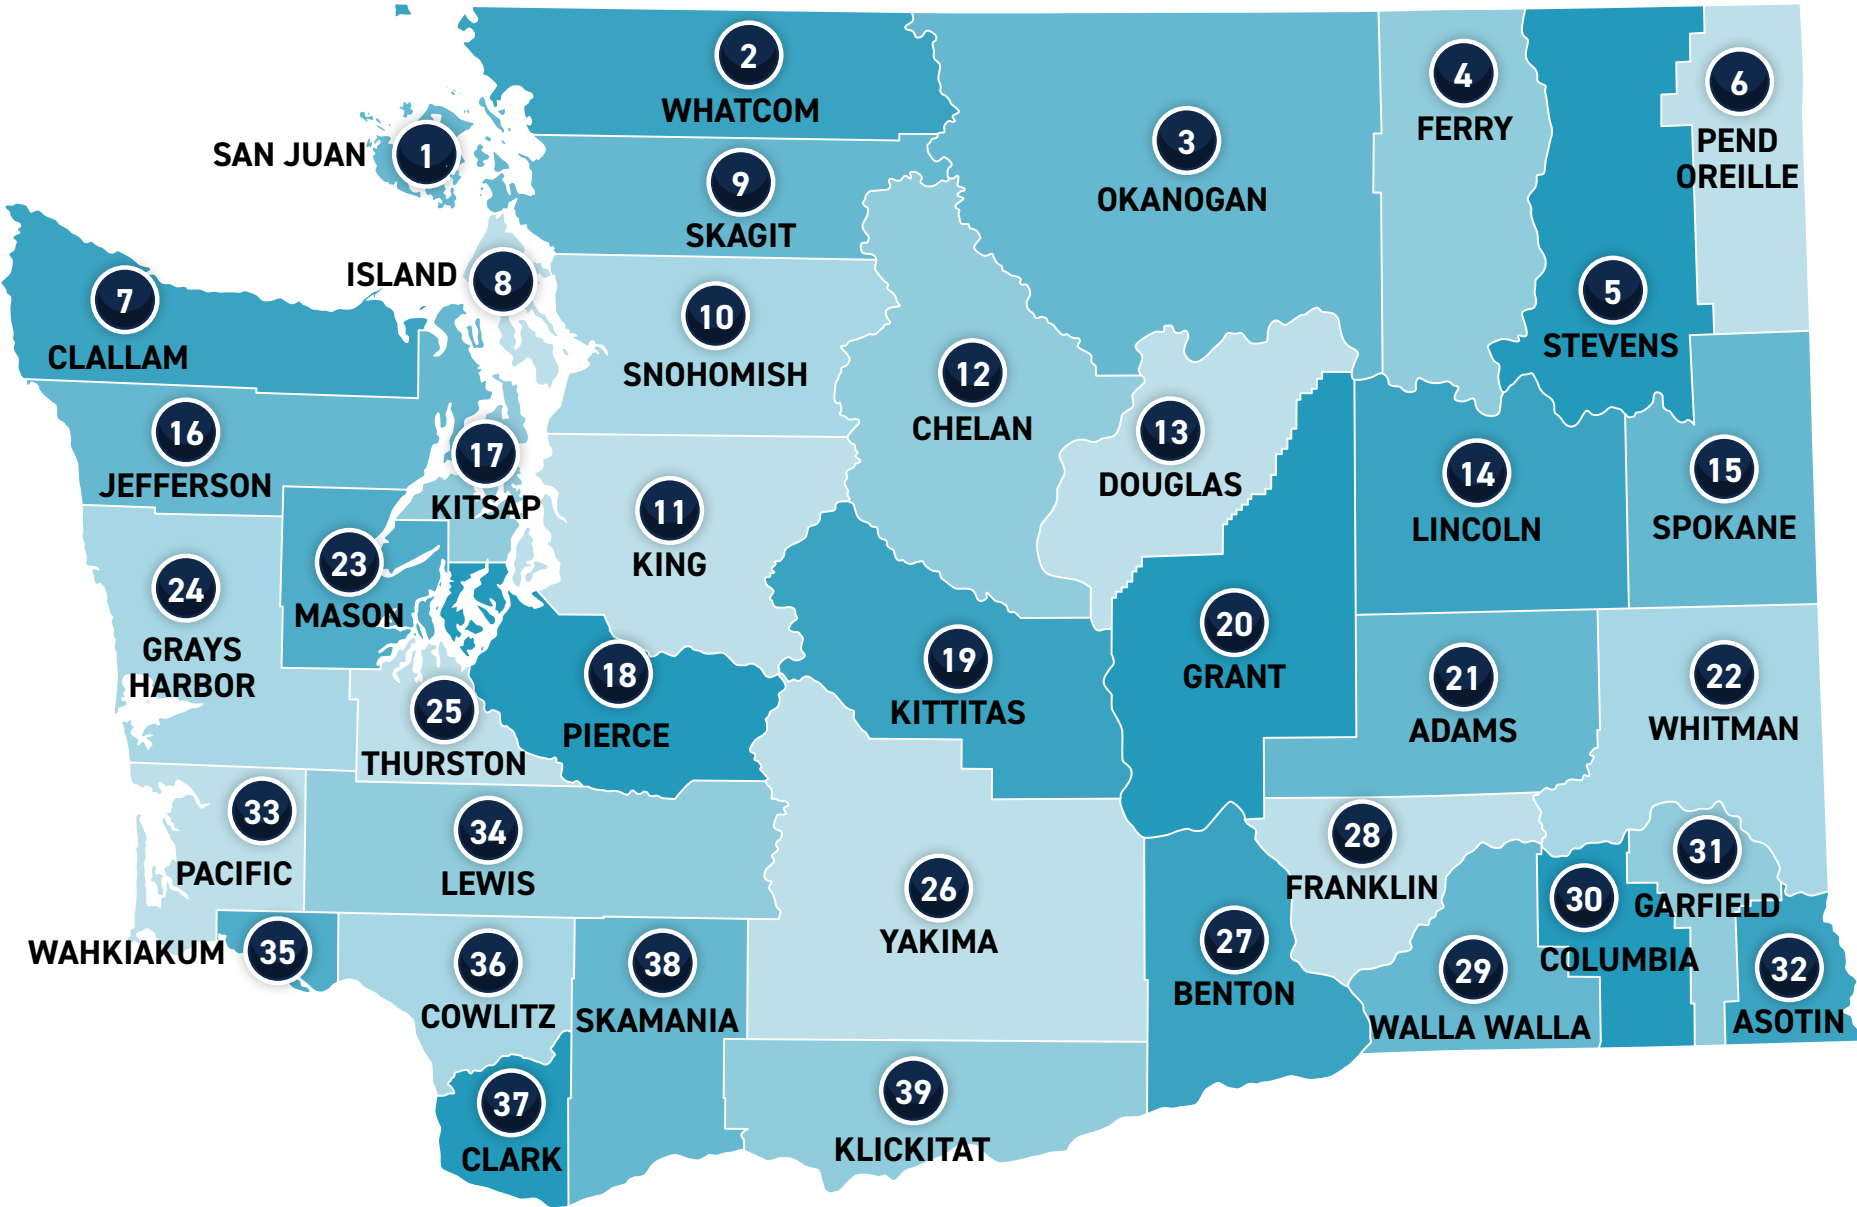

COLUMBIA

Engineer
Lupe Gonzalez
509-329-2147
lupe.gonzalez@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

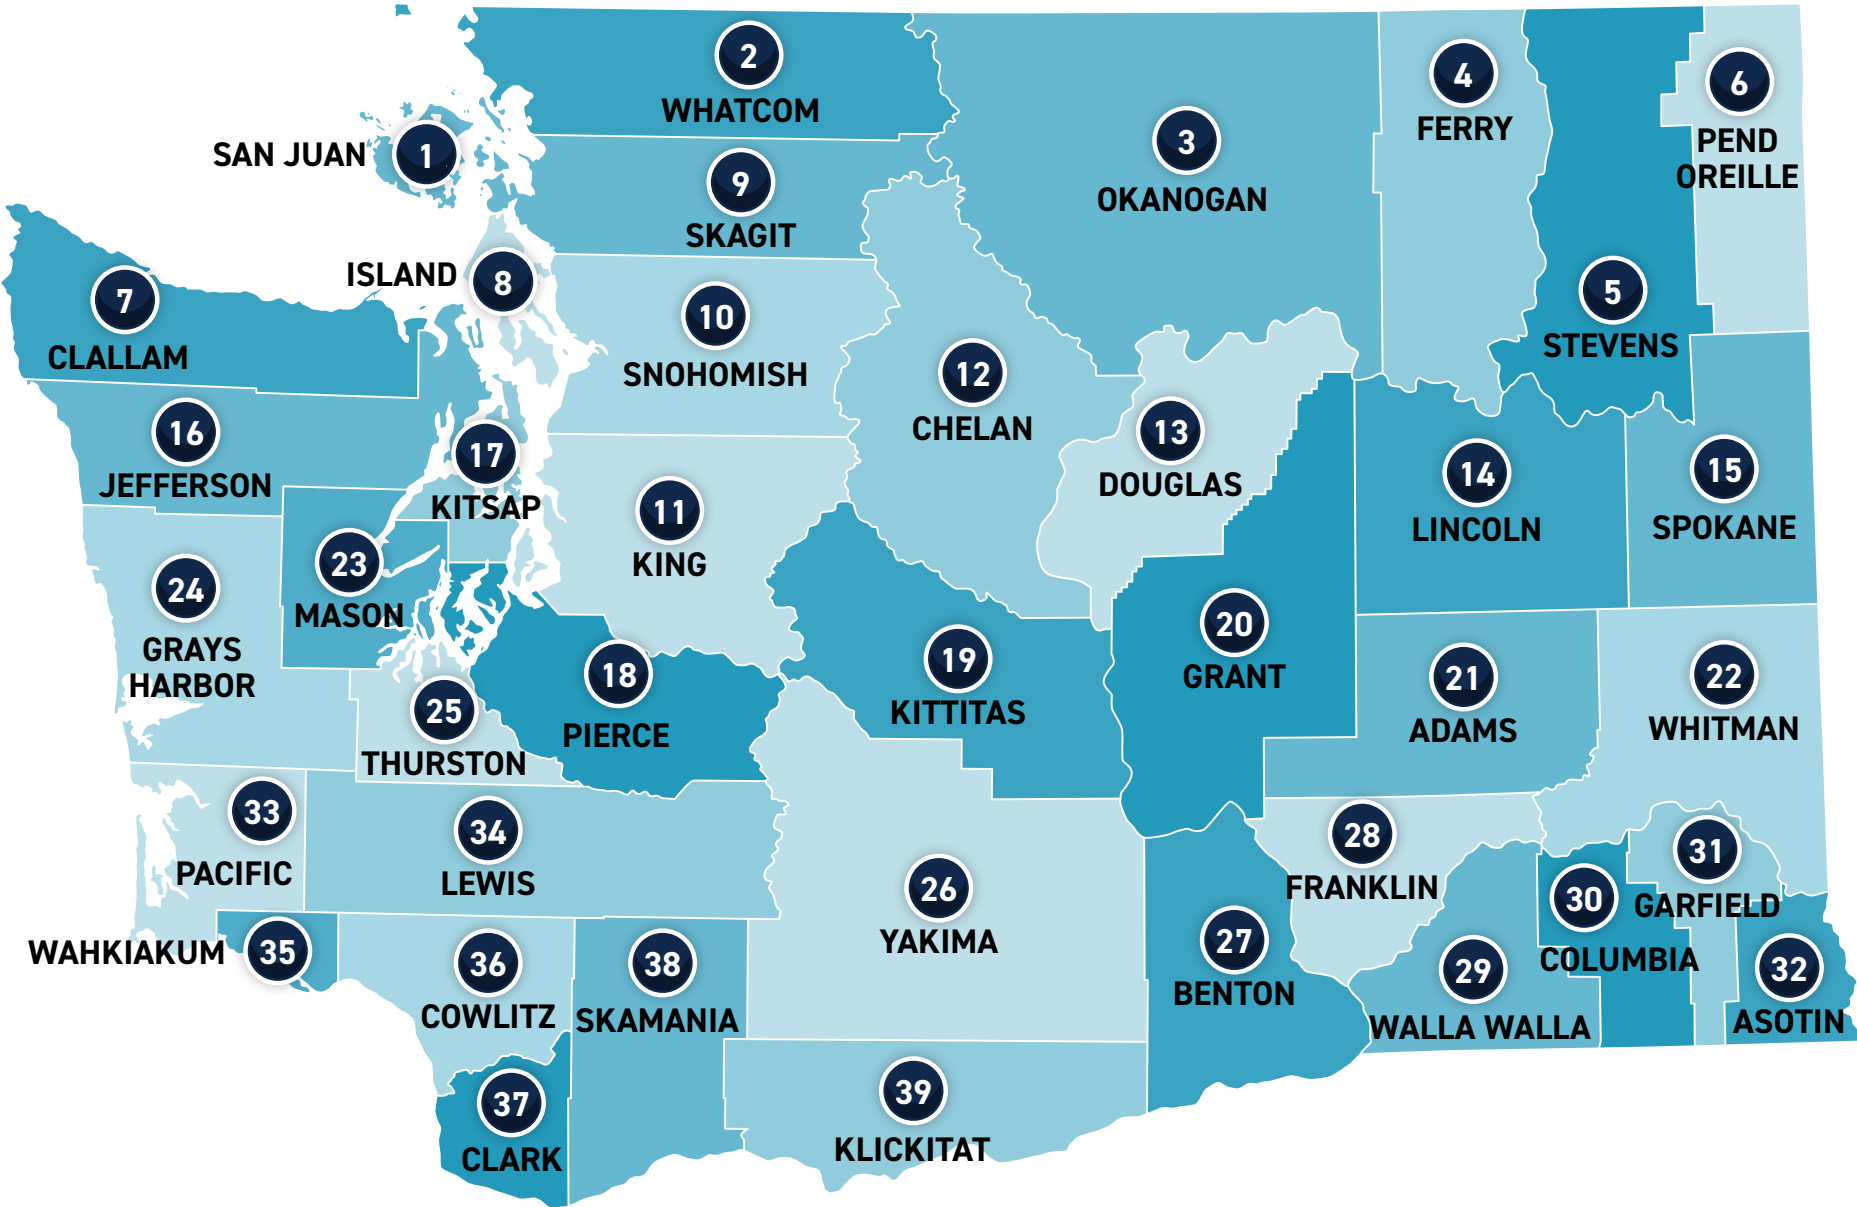

GARFIELD

Engineer
Lupe Gonzalez
509-329-2147
lupe.gonzalez@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

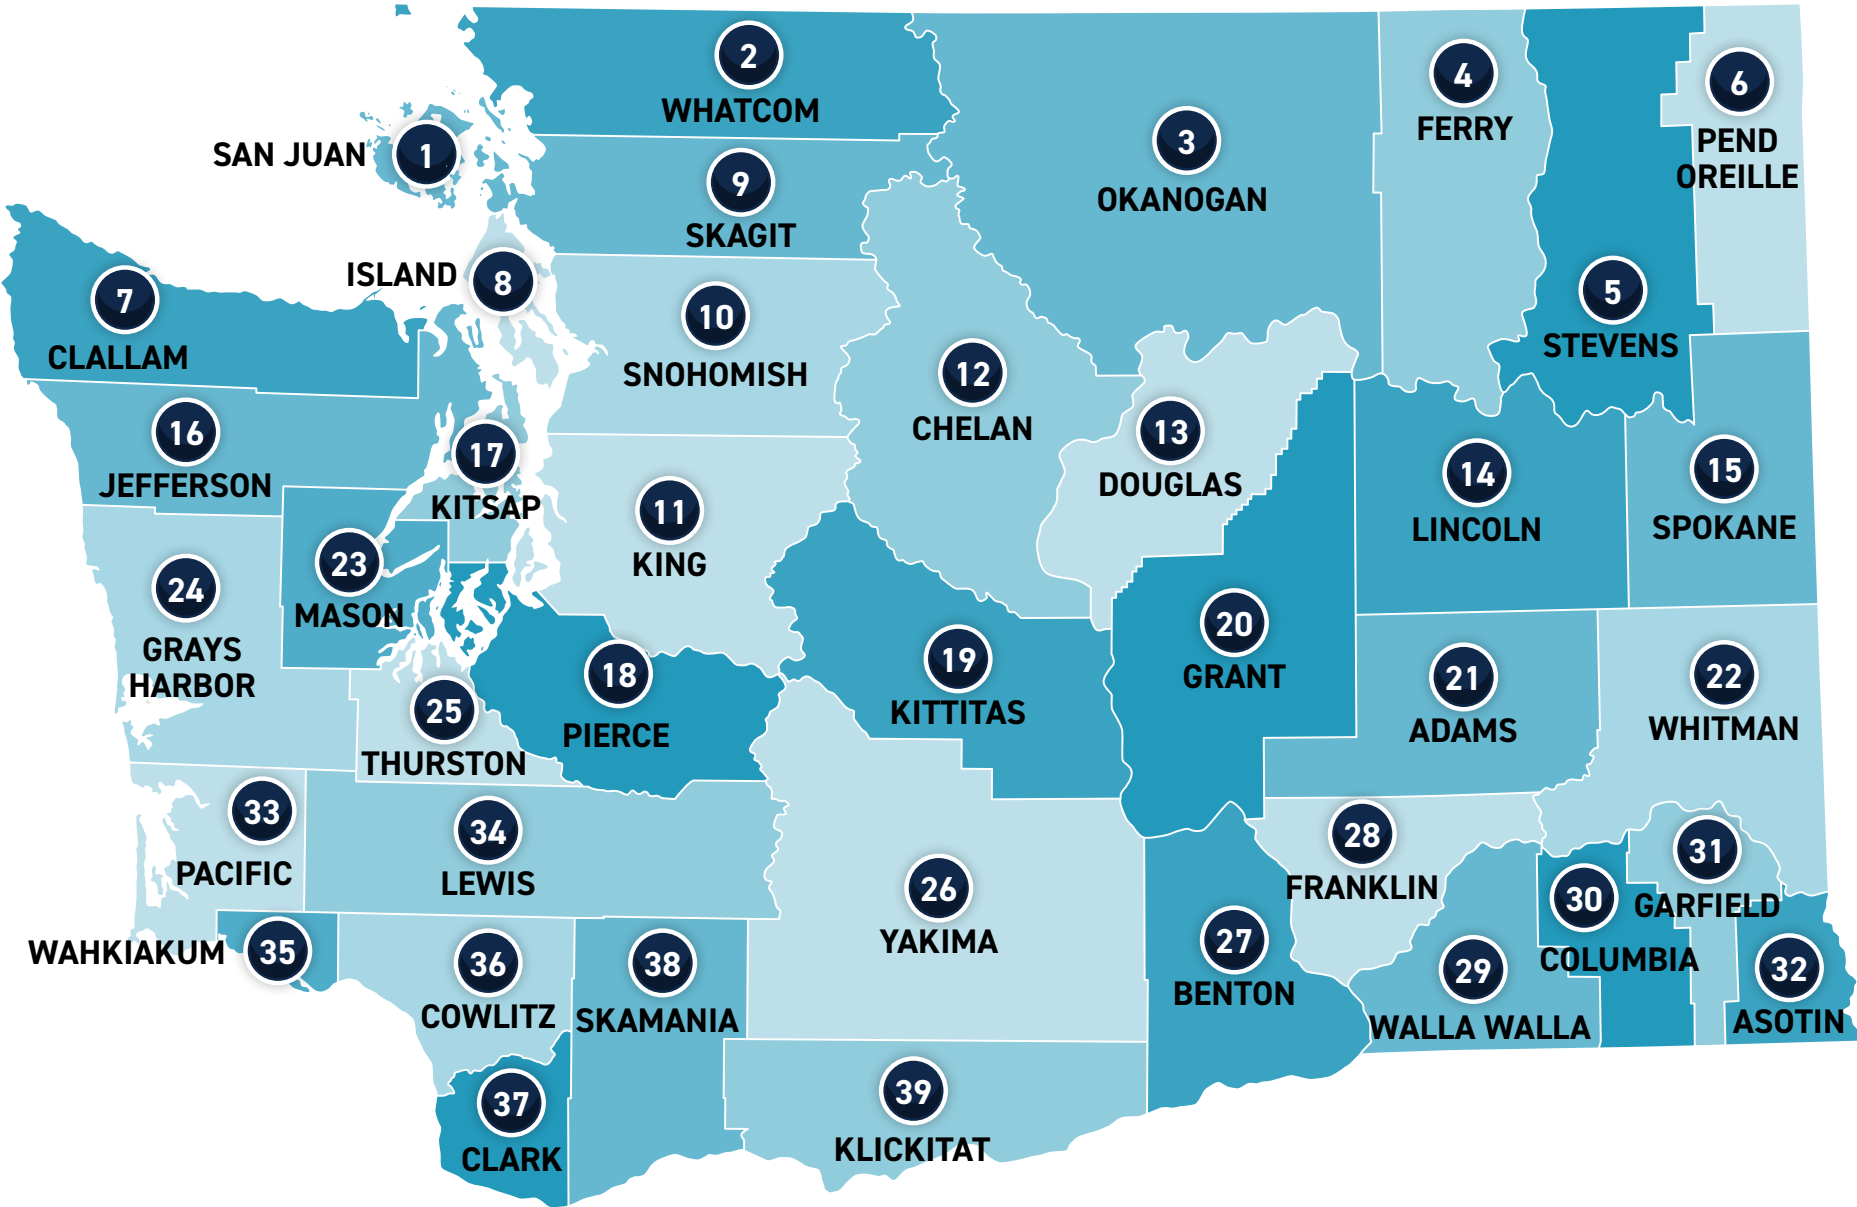

ASOTIN

Engineer
Lupe Gonzalez
509-329-2147
lupe.gonzalez@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov


Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov

Office of Drinking Water Contacts by County

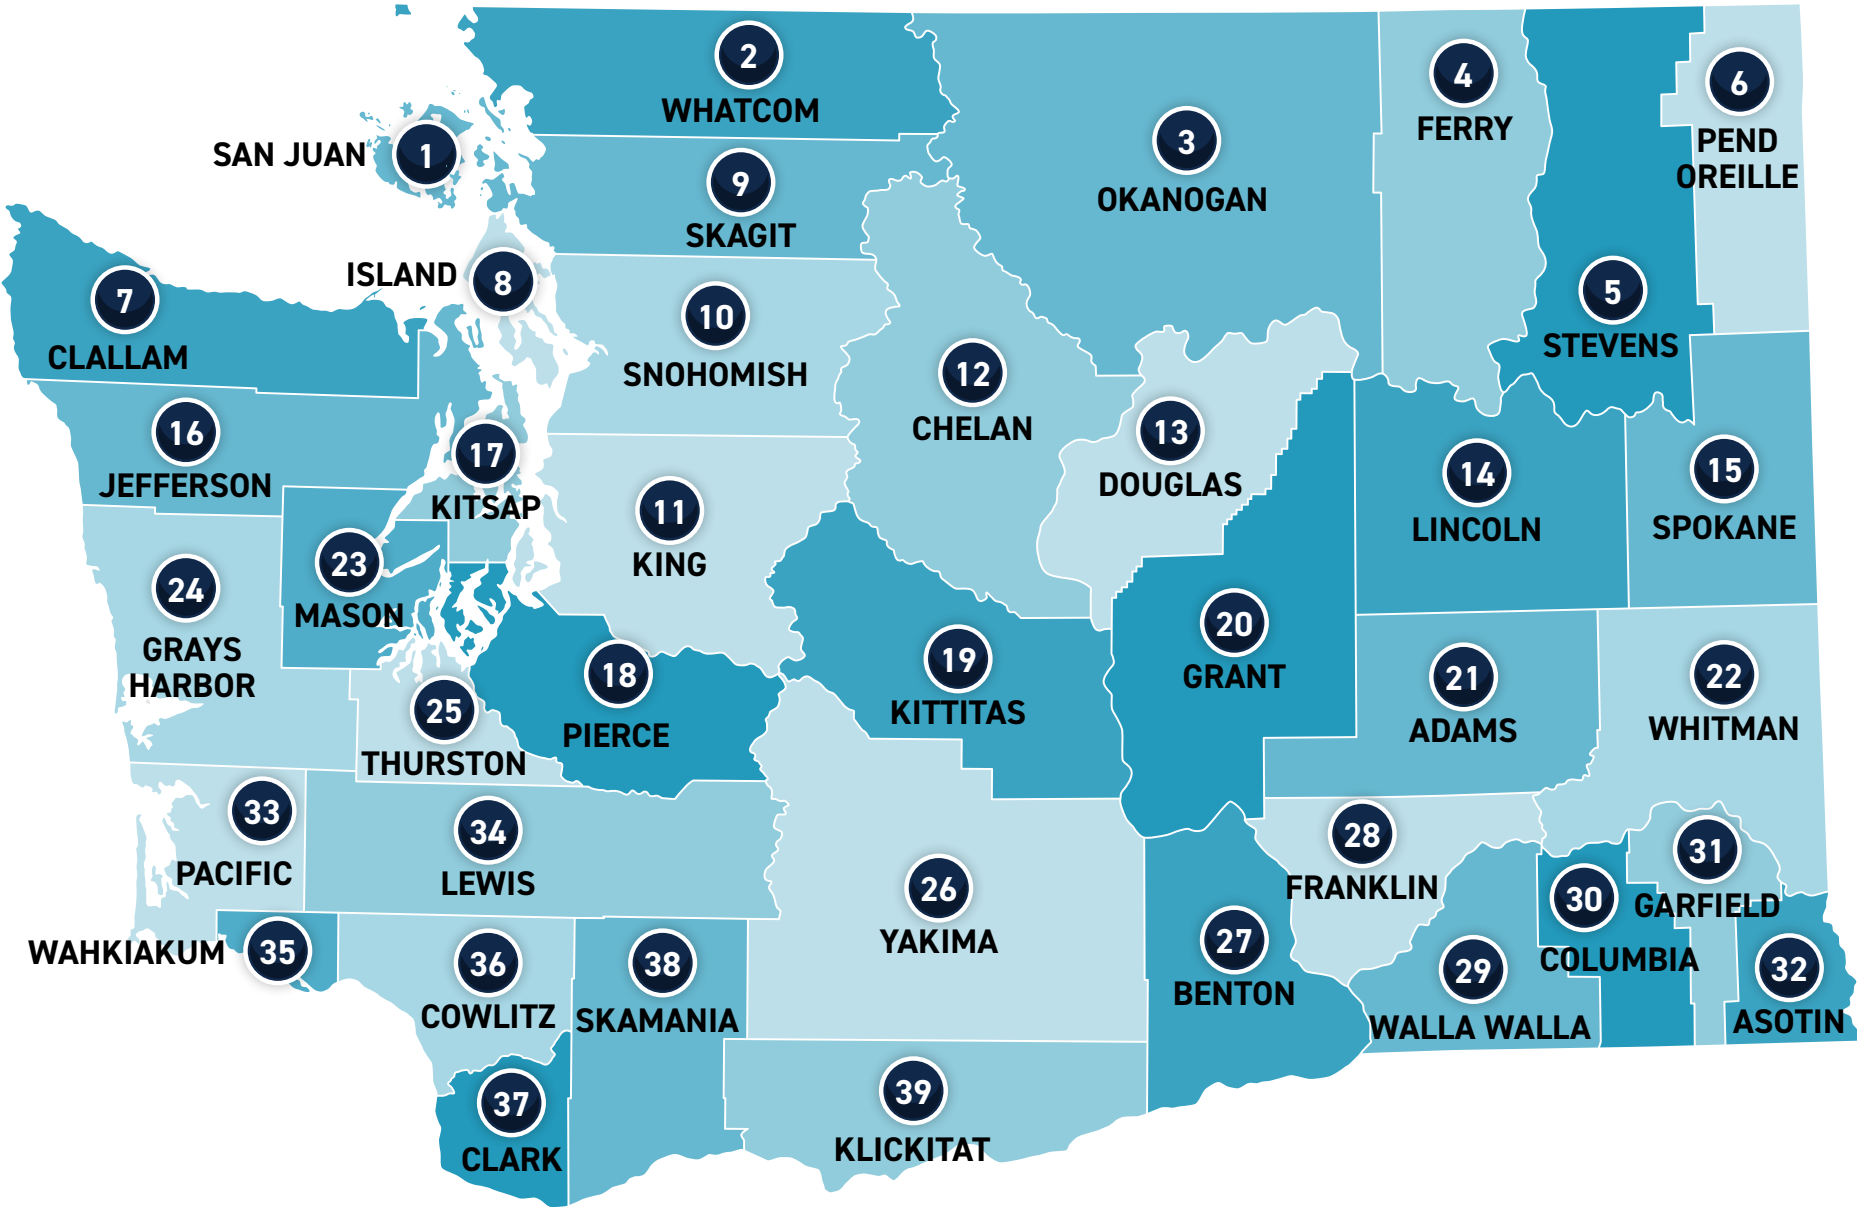

PACIFIC

Engineer

R. Scott Pollock, PE

564-669-0854

rscott.pollock@doh.wa.gov

Planner

Meredith Jones

564-233-1394

meredith.jones@doh.wa.gov

Source Monitoring Staff

Sophia Petro

564-669-0856

sophia.petro@doh.wa.gov

Coliform Staff

Kacie Seyfert

564-669-0844

kacie.seyfert@doh.wa.gov


WFI & Disinfection Staff

Pi Kosarot (DBP & Surface Water Support)

564-669-3862

pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

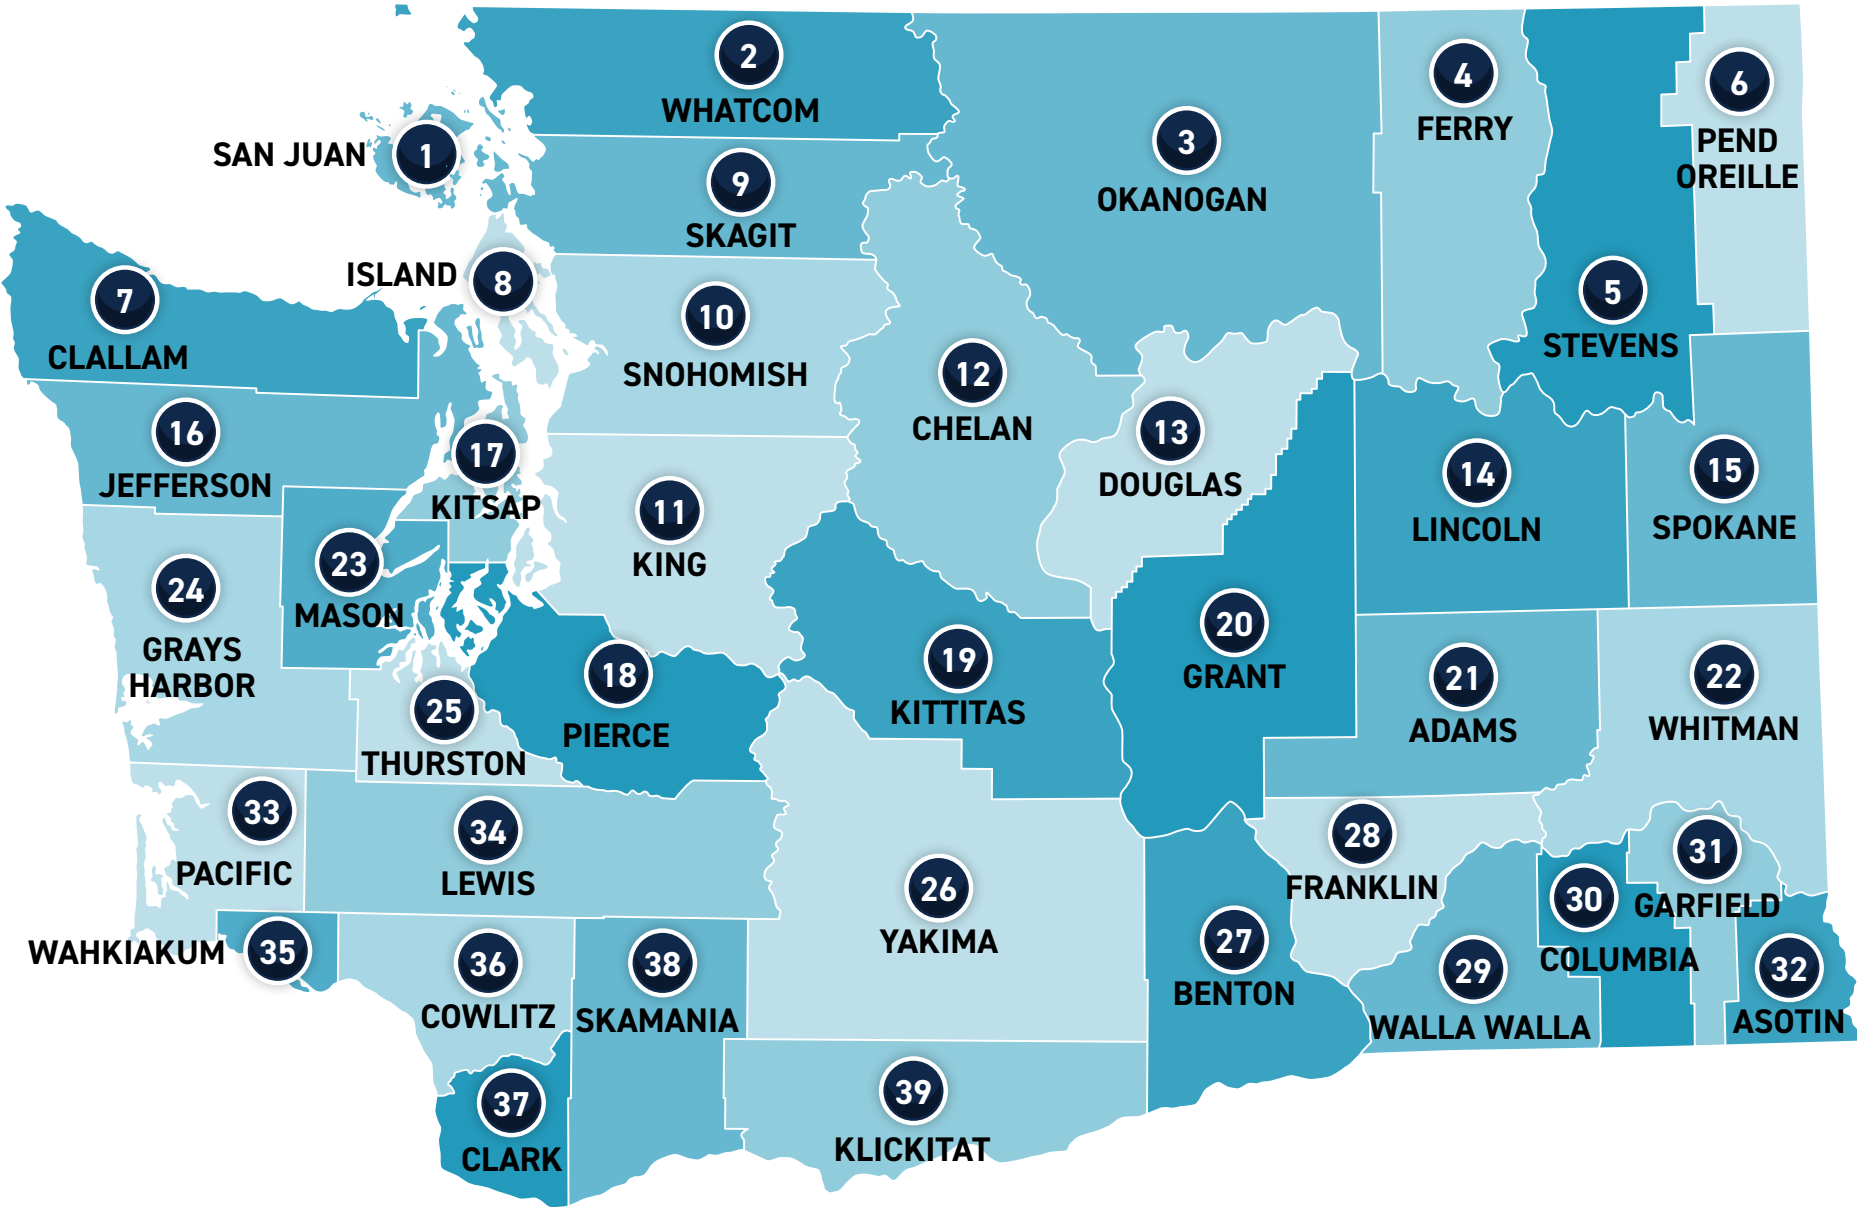

LEWIS

Engineer
Phyo Kyaw
564-669-3849
phyo.kyaw@doh.wa.gov


Planner
Benjamin Majors
564-669-0855
ben.majors@doh.wa.gov

Source Monitoring Staff
Sophia Petro
564-669-0856
sophia.petro@doh.wa.gov

Coliform Staff
Kacie Seyfert
564-669-0844
kacie.seyfert@doh.wa.gov

WFI & Disinfection Staff
Pi Kosarot (DBP & Surface Water Support)
564-669-3862
pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

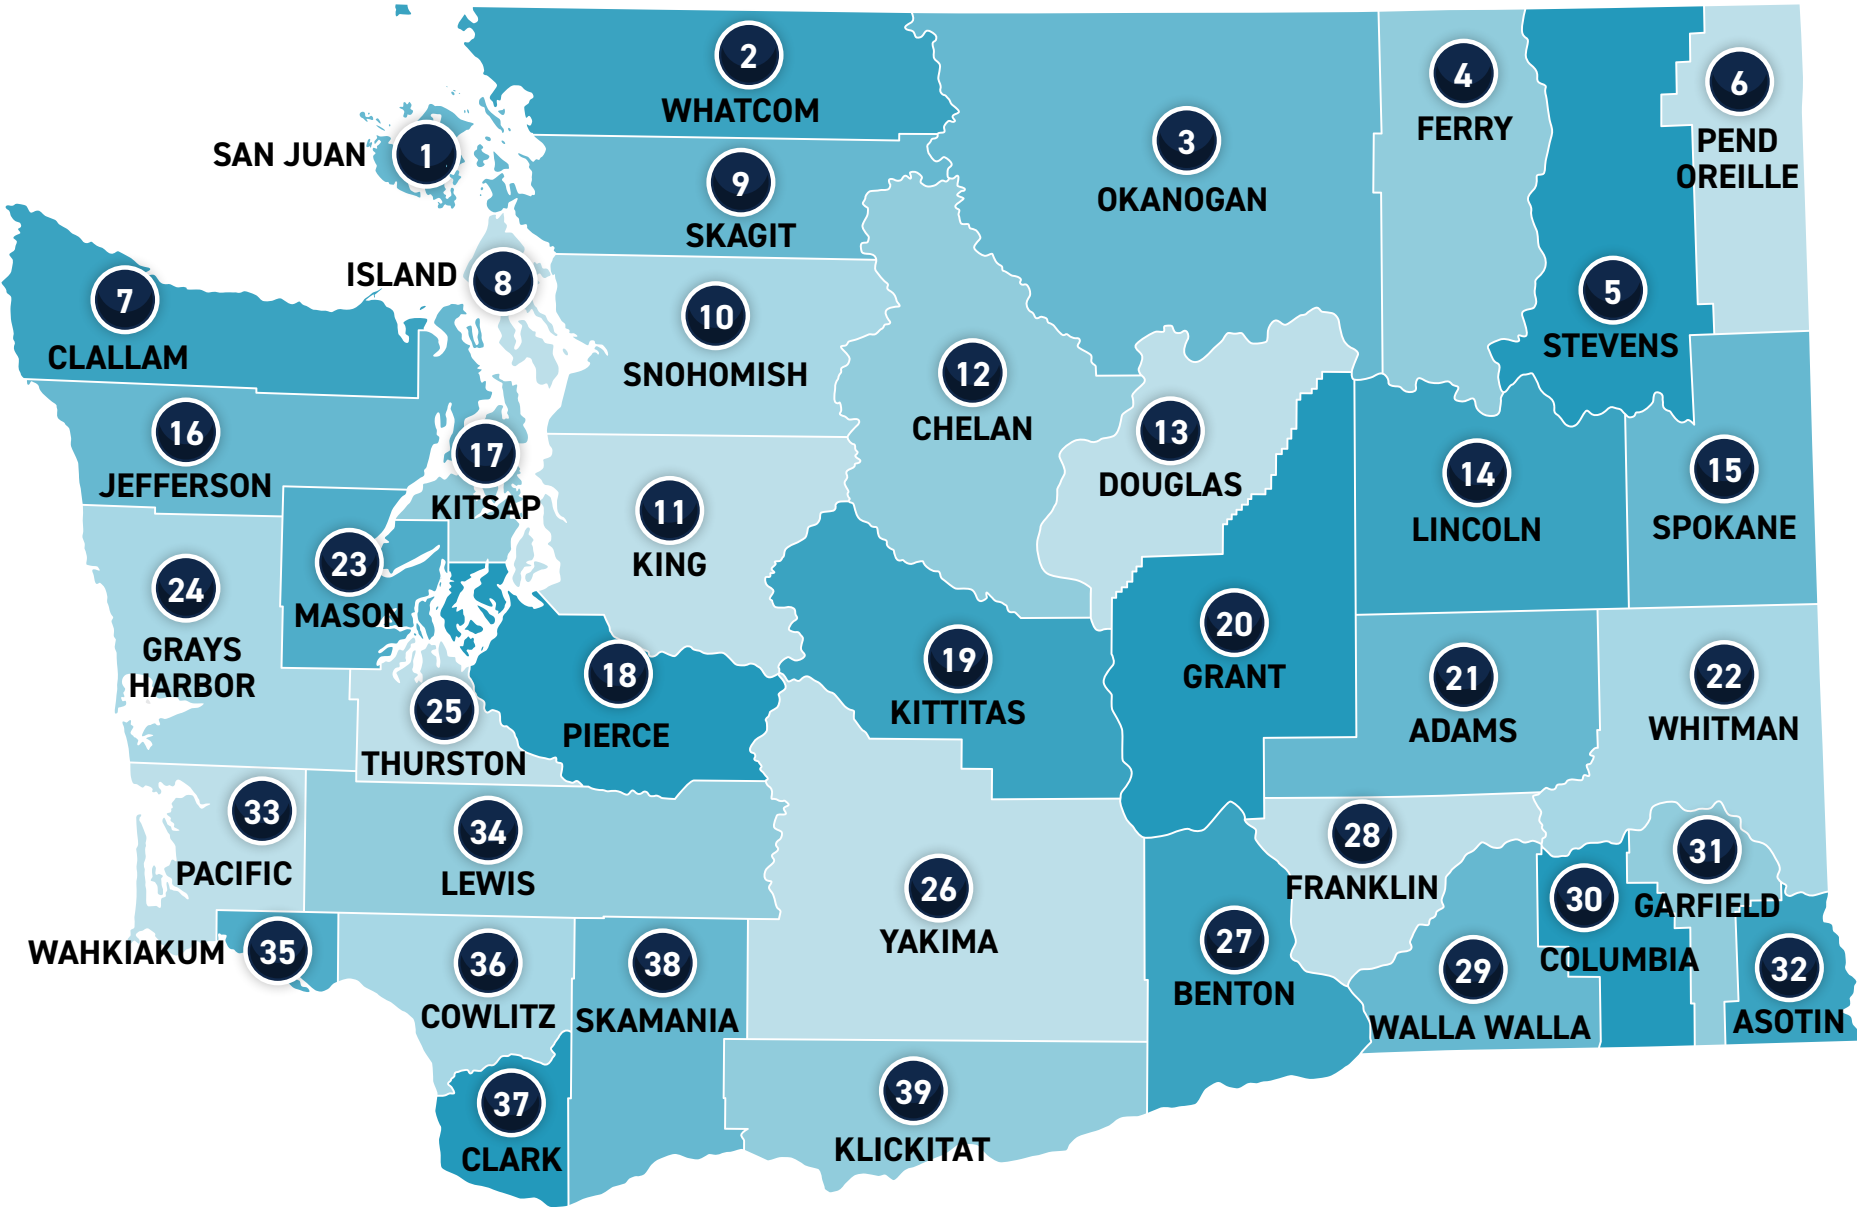

WAHKIAKUM

Engineer
Candida Granillo-Dodds, PE
564-669-3170
candida.granillo-dodds@doh.wa.gov


Planner
Meredith Jones
564-233-1394
meredith.jones@doh.wa.gov

Source Monitoring Staff
Sophia Petro
564-669-0856
sophia.petro@doh.wa.gov

Coliform Staff
Kacie Seyfert
564-669-0844
kacie.seyfert@doh.wa.gov

WFI & Disinfection Staff
Pi Kosarot (DBP & Surface Water Support)
564-669-3862
pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

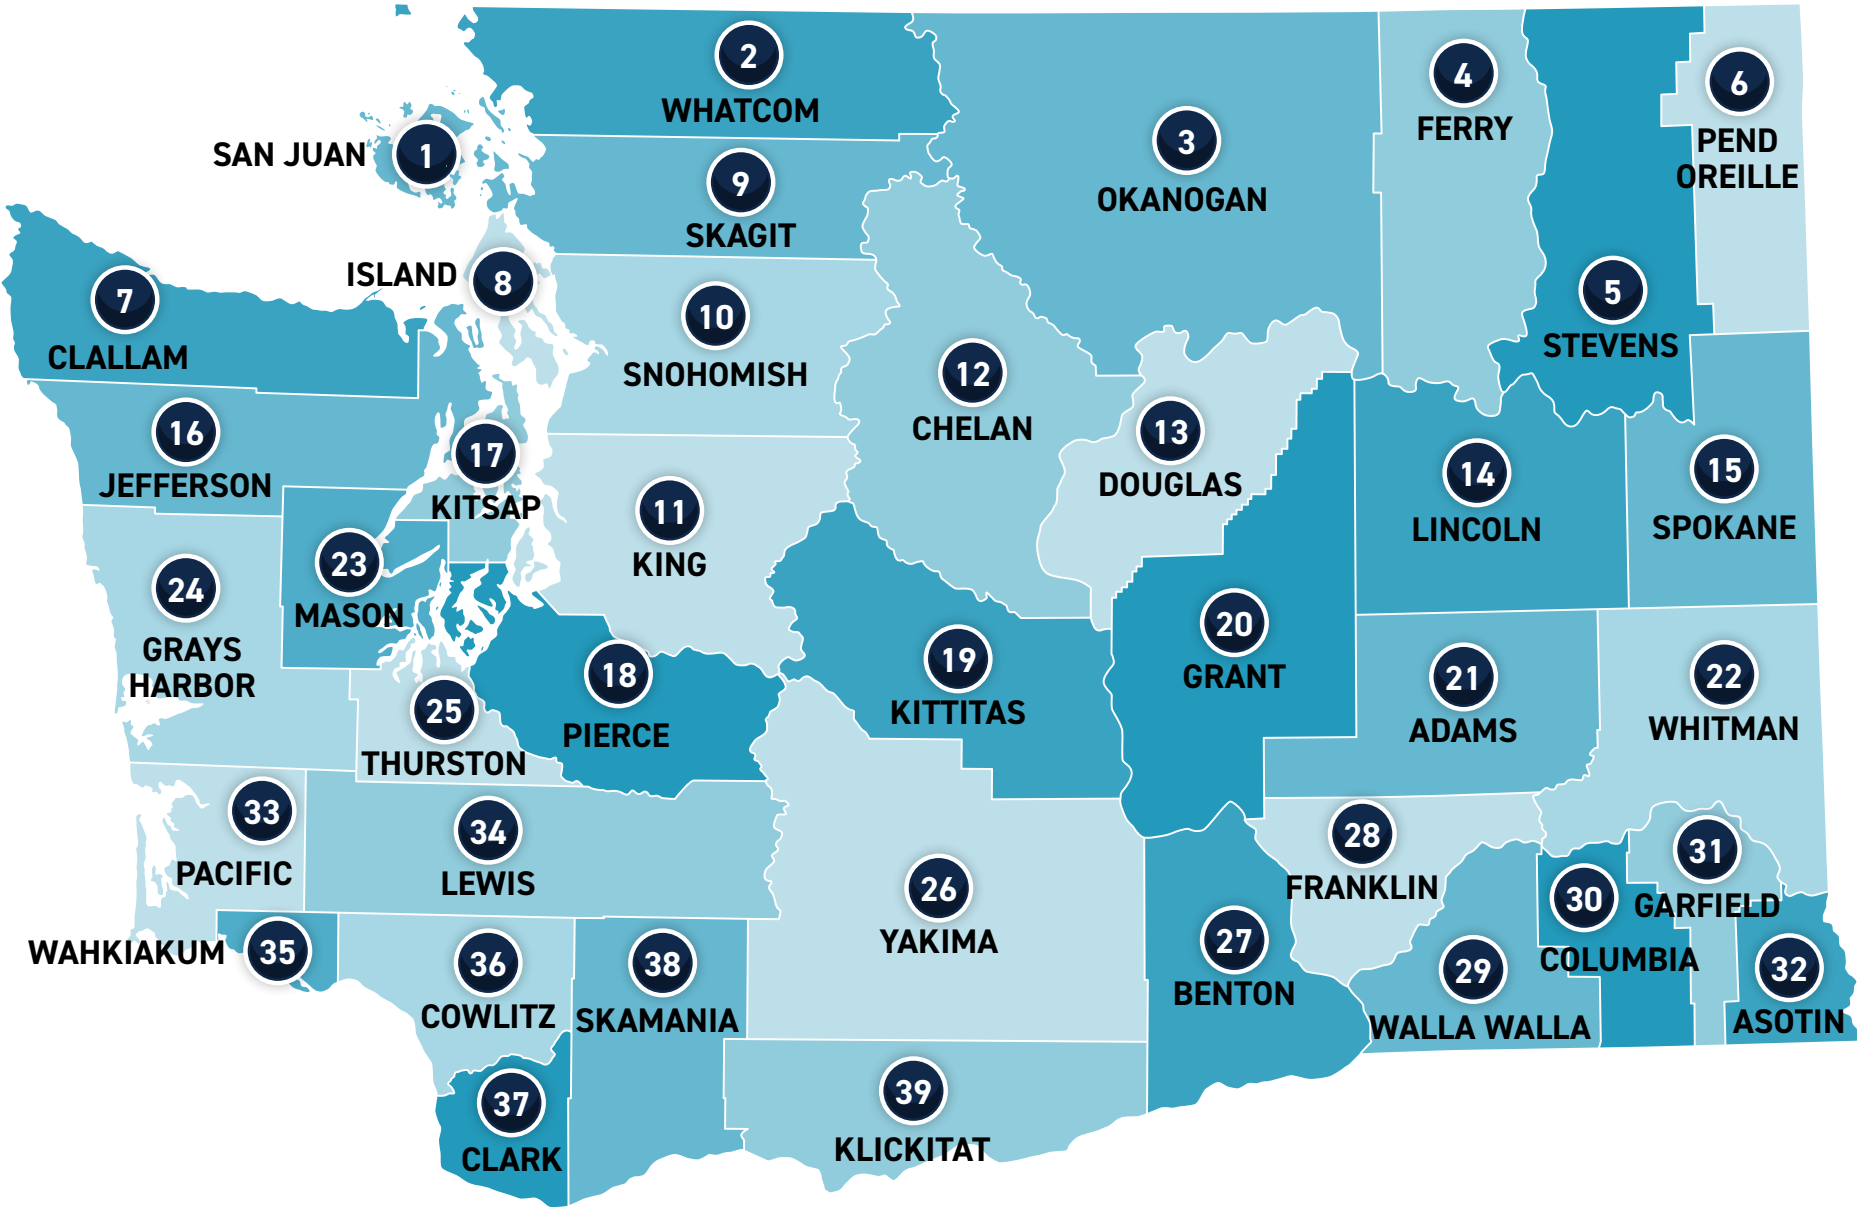

COWLITZ

Engineer
Ryan Deem
360-628-7951
ryan.deem@doh.wa.gov


Planner
Meredith Jones
564-233-1394
meredith.jones@doh.wa.gov

Source Monitoring Staff
Sophia Petro
564-669-0856
sophia.petro@doh.wa.gov

Coliform Staff
Kacie Seyfert
564-669-0844
kacie.seyfert@doh.wa.gov

WFI & Disinfection Staff
Pi Kosarot (DBP & Surface Water Support)
564-669-3862
pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

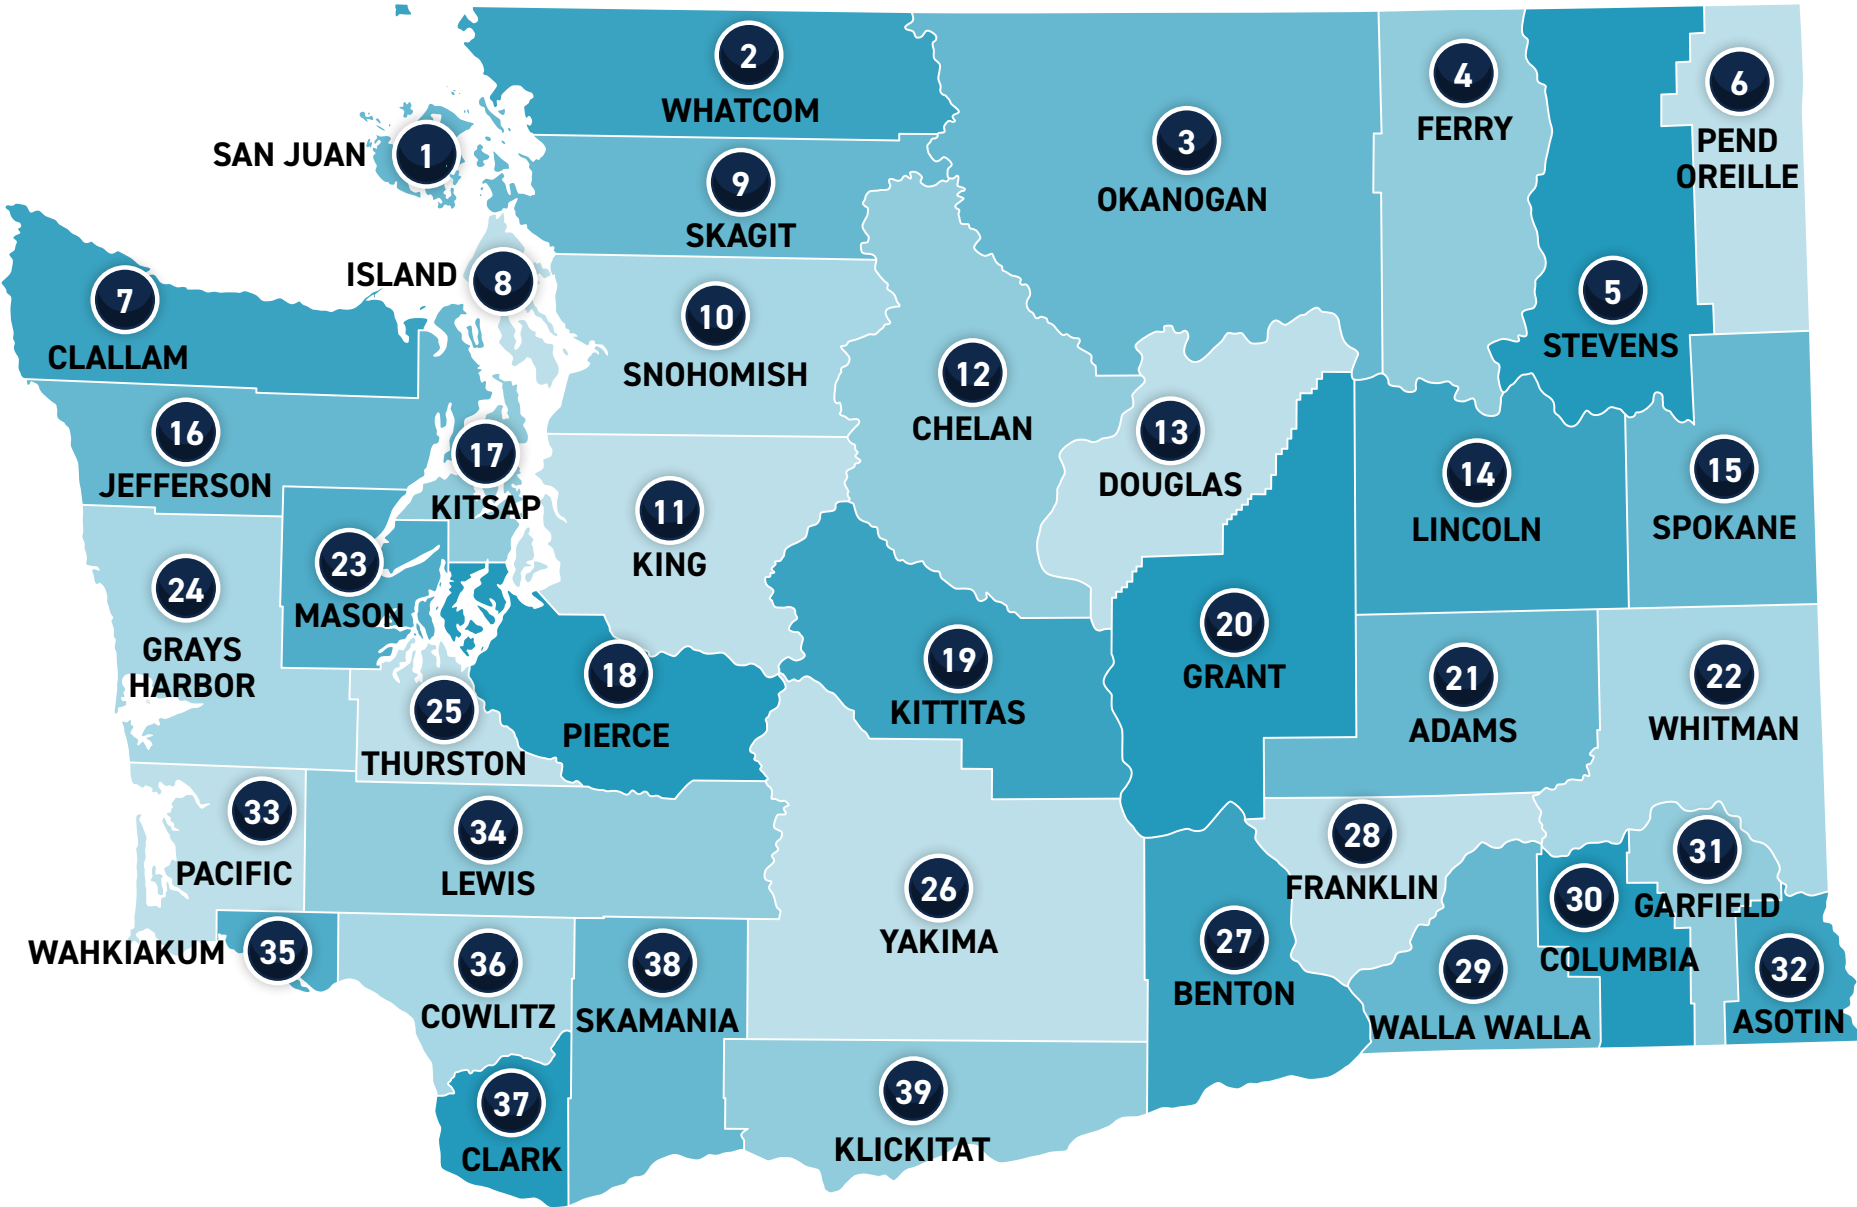

CLARK

Engineer
Vacant


Planner
Meredith Jones
564-233-1394
meredith.jones@doh.wa.gov

Source Monitoring Staff
Sophia Petro
564-669-0856
sophia.petro@doh.wa.gov

Coliform Staff
Kacie Seyfert
564-669-0844
kacie.seyfert@doh.wa.gov

WFI & Disinfection Staff
Pi Kosarot (DBP & Surface Water Support)
564-669-3862
pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

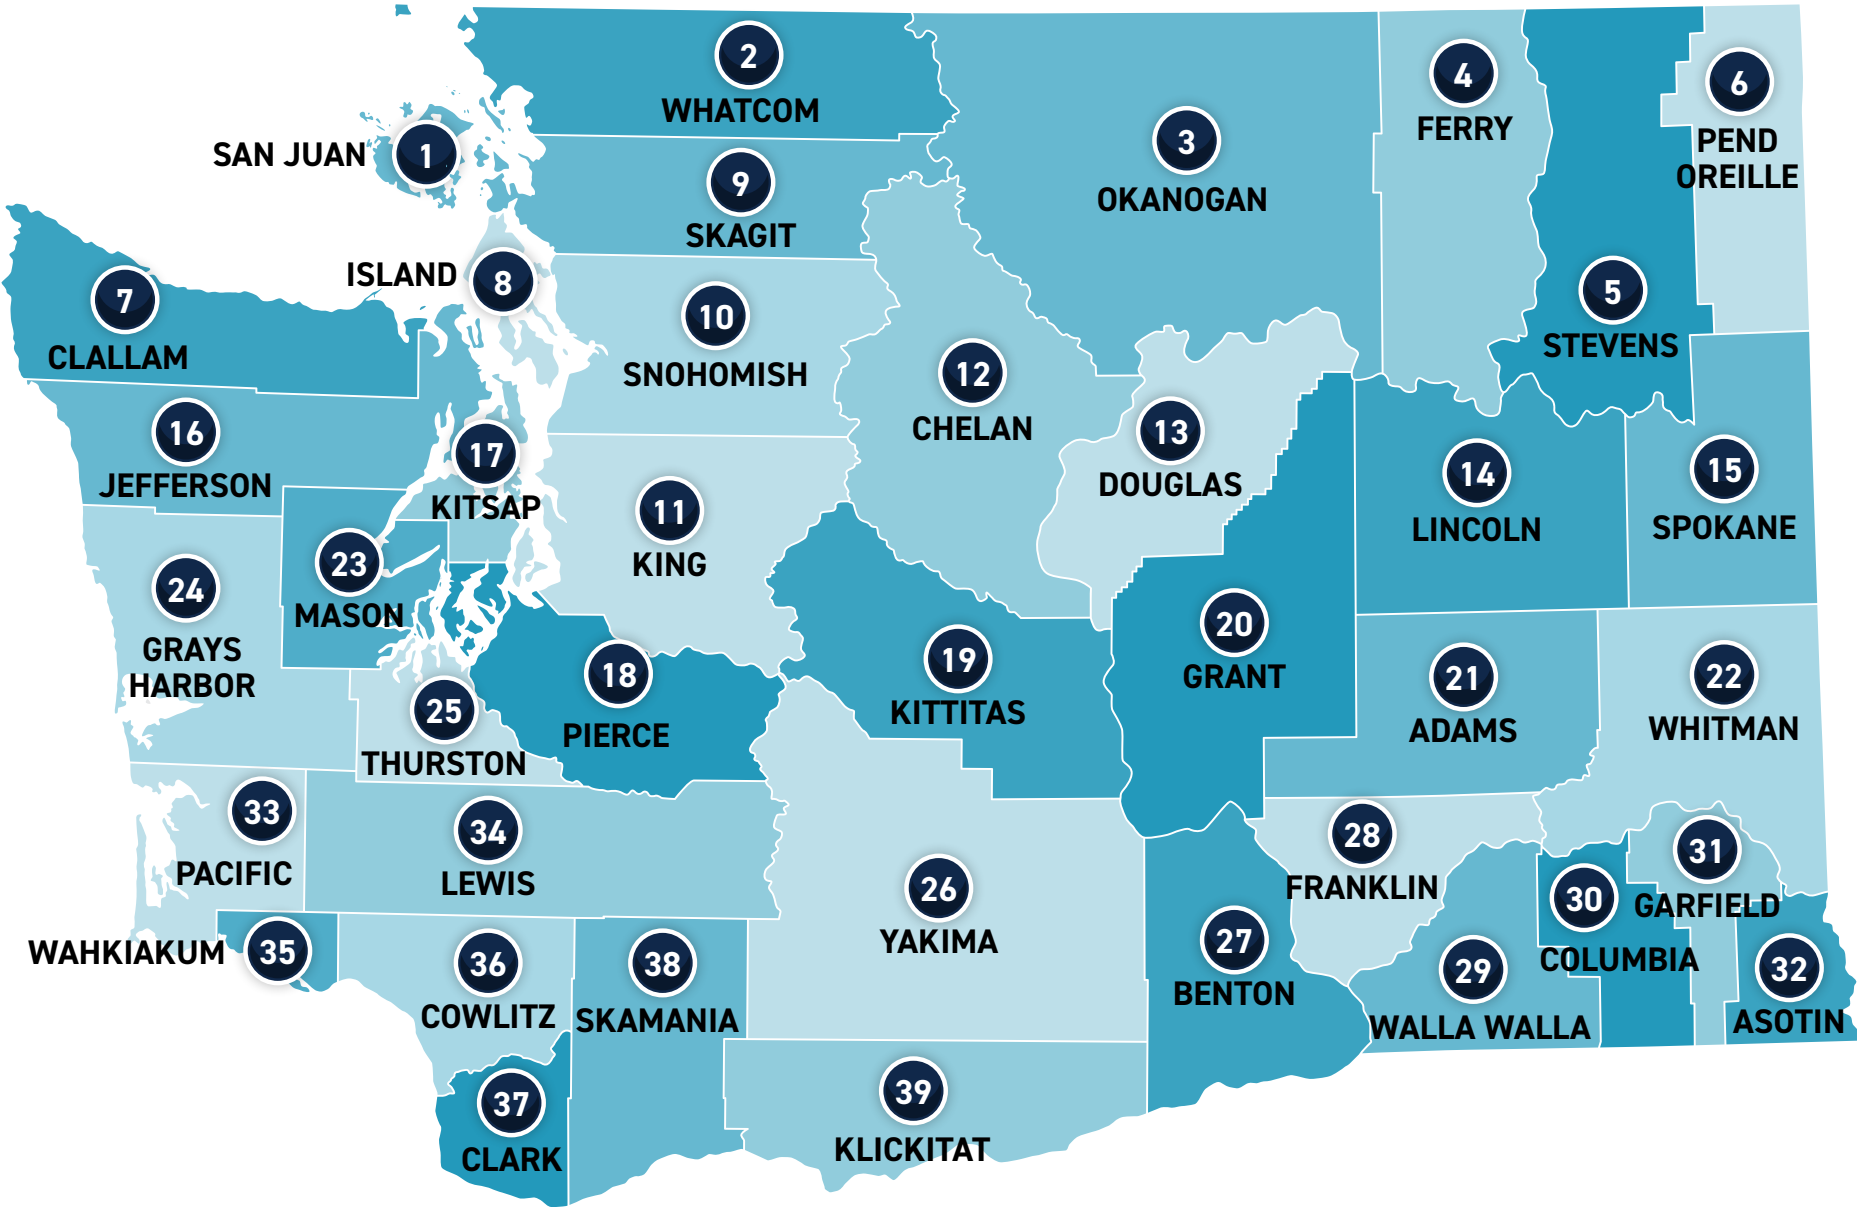

SKAMANIA

Engineer

R. Scott Pollock, PE

564-669-0854

rscott.pollock@doh.wa.gov

Planner

Meredith Jones

564-233-1394

meredith.jones@doh.wa.gov

Source Monitoring Staff

Sophia Petro

564-669-0856

sophia.petro@doh.wa.gov

Coliform Staff

Kacie Seyfert

564-669-0844

kacie.seyfert@doh.wa.gov


WFI & Disinfection Staff

Pi Kosarot (DBP & Surface Water Support)

564-669-3862

pi.kosarot@doh.wa.gov

Office of Drinking Water Contacts by County

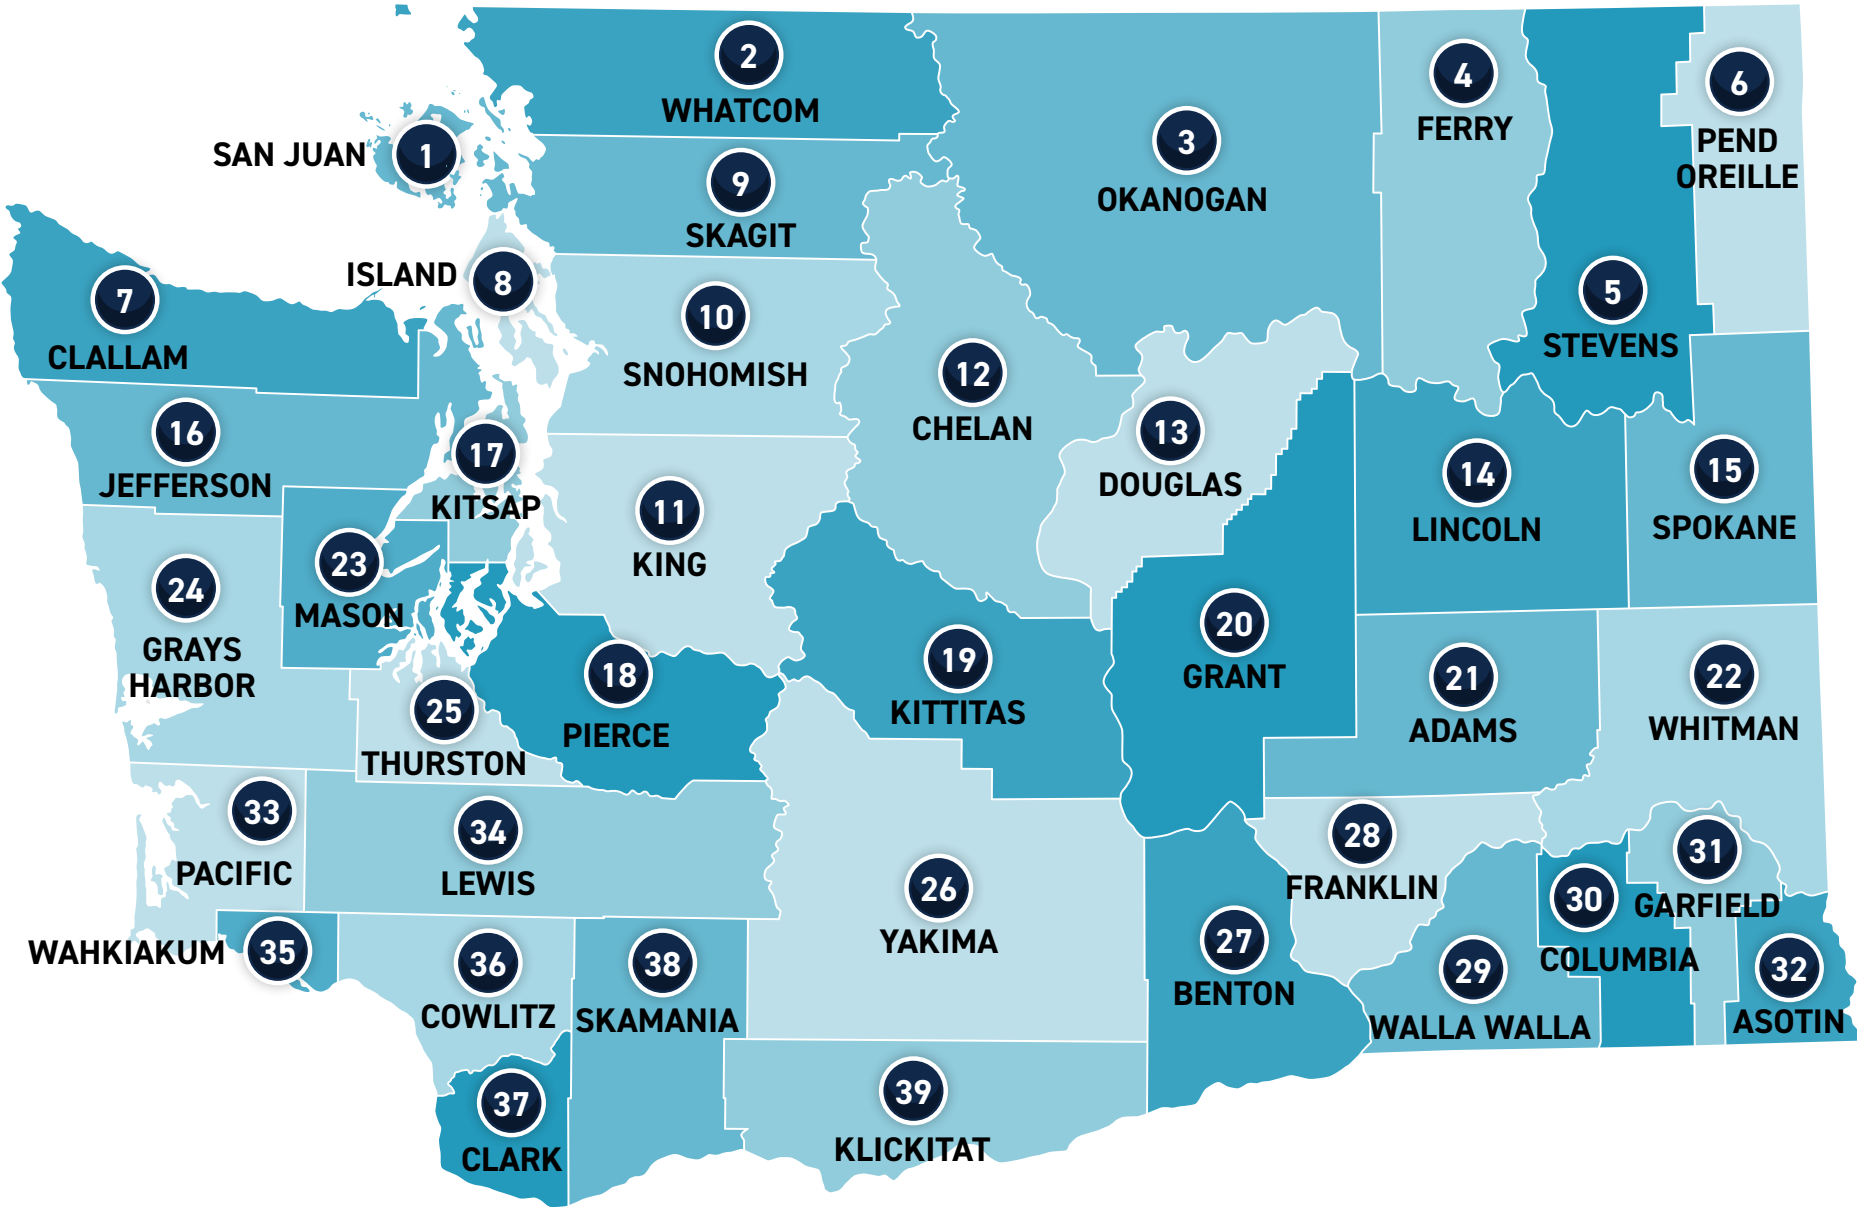

KLICKITAT

Engineer
Andy Cervantes, PE
509-329-2120
andres.cervantes@doh.wa.gov

Planner
Jamie Clark
564-669-3893
jamie.clark@doh.wa.gov

Source Monitoring Staff
Ashly Beebe
(Lead & Copper and Nitrate only) 564-669-4112
ashly.beebe@doh.wa.gov

Anna Duron
509-507-0504
anna.duron@doh.wa.gov

Coliform Staff
Vacant
ero.coli@doh.wa.gov

WFI & Disinfection Staff
Kelsey Russell
509-507-0584
kelsey.russell@doh.wa.gov